




Geotechnical Investigation Report

Proposed Residential and Commercial Development
Part Lot 13 Concession 5
Millbrook, Ontario

Report for
Vargas Properties Inc.

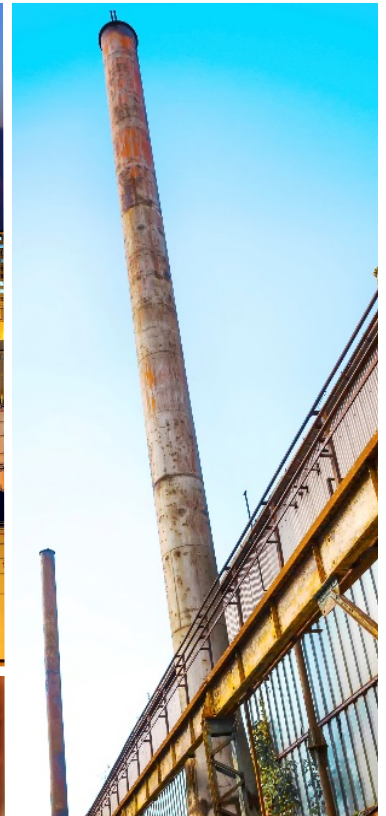



Executive Summary

This report presents the results of a geotechnical investigation that was conducted in support of the a proposed residential and commercial development being considered for a site situated on Part Lot 13, Concession 5 in the Township of Cavan Monaghan, County of Peterborough, Ontario (herein referred to as “the Property” and “the Site”). The Property is located near the southeast corner of the intersection between Fallis Line and County Road 10 in Millbrook. The Site encompasses an area of approximately 29.5 hectares (72.9 acres) and is undeveloped. The proposed development will be municipally serviced with piped potable water (water main) and sanitary sewer. GHD Limited (GHD) was retained by Vargas Properties Inc. (the Client) to complete this geotechnical investigation which includes a hydrogeologic component.

The study has included a site inspection, advancement of test holes (boreholes and test pits), soil sampling, water level monitoring, a well survey to compliment a review of available Ministry of the Environment, Conservation and Parks (MECP) well records, hydraulic conductivity testing and a water balance evaluation based upon preliminary concept information.

In summary, the proposed development area is generally comprised of topsoil underlain by silty sand over silty clay or glacial till. A permanent shallow groundwater table was not observed. It is our opinion that there will not be significant constraints for the proposed residential and commercial development areas from the seasonal variations of groundwater as the water can be handled with appropriate engineering techniques. It is expected that groundwater will generally be below the depth of the future development, although seepage may be encountered in deeper excavations or foundations. Seepage is expected to be seasonal in nature. If short-term pumping of groundwater at volumes greater than 50,000 L/day and less than 400,000L/day is required during the construction stage, the Environmental Activity Sector Registry (EASR) must be completed.

In summary, the proposed residential and commercial development is suitable from both a hydrogeologic and geotechnical perspective. There are minor impacts expected to groundwater and surface water as a result of the future development provided that appropriate planning (i.e. incorporation of LIDs as supported by the water balance calculations), mitigation measures and proper construction techniques are considered.

From a geotechnical perspective, the Site is suitable for construction of the proposed development including one to two-storey residential homes, townhomes, commercial buildings and associated servicing and asphalt paved roadways, parking and access areas. Detailed recommendations are provided in subsequent sections of this report.



Table of Contents

1.	Introduction	1
2.	Scope of Investigation	1
3.	Project Details	2
4.	Site Conditions	3
4.1	General	3
4.2	Subsurface	3
4.2.1	Regional Physiography and Geology	3
4.2.2	Local Geology	4
4.2.3	Groundwater	5
4.2.4	Water Quality	6
4.2.5	Hydraulic Conductivity	7
4.2.6	Infiltration Testing	8
5.	Hydrogeology	8
5.1	Existing Local Water Supplies	9
5.2	Source Water Protection Considerations	10
6.	Conclusions and Recommendations	11
6.1	Hydrogeology	11
6.1.1	Water Balance Evaluation	11
6.1.2	Impact on Groundwater Baseflow	13
6.1.3	Impact on Surface Water Bodies	14
6.1.4	Mitigation Measures	14
6.1.5	Servicing	14
6.1.6	Dewatering for Construction	14
6.2	Geotechnical	15
6.2.1	Site Preparation and Excavation	15
6.2.2	Service Installation	16
6.2.3	Pavement Structures	17
6.2.4	Foundation Design	18
6.2.5	Slab on Grade	21
6.2.6	Basement Retaining Walls	21
6.2.7	Stormwater Management Pond Design	21
6.2.8	Slope Stability Analysis	23
6.2.9	General Recommendations	24
6.3	Summary Conclusions	25
7.	References	27
8.	Statement of Limitations	28



Table Index

Table 4.1	Grain Size Distribution Summary.....	5
Table 4.2	Summary of Monitoring Well Information.....	6
Table 4.3	Potentiometric Water Level Summary.....	6
Table 4.4	Water Quality Summary.....	7
Table 5.1	Summary of MECP Water Well Data.....	9
Table 6.1	Pre Development Summary.....	12
Table 6.2	Post Development Summary (No Enhancements).....	12
Table 6.3	Post Development Summary (With Enhanced Infiltration).....	13
Table 6.4	Pavement Structure for New Roads.....	17
Table 6.5	Pavement Structure for Commercial Areas of Development.....	18
Table 6.6	Depth to Competent Bearing Native Soil.....	19
Table 6.7	Preliminary Bearing Pressures for Foundation Design.....	19

Enclosures

Vicinity Plan	Figure 1
Property Plan	Figure 2
Plot Plan	Figure 3
Concept Plan	Figure 4
Test Hole Plan	Figure 5
Groundwater Elevation	Figure 6
Physiography	Figure 7
Surficial Geology	Figure 8
Quaternary Geology	Figure 9
Source Water Protection Map	Figure 10



Appendix Index

Appendix A	Soil Exploration Data
Appendix B	MECP Well Records and Well Survey
Appendix C	Hydraulic Conductivity Data
Appendix D	Analytical Data
Appendix E	Water Balance Calculations
Appendix F	Slope Stability Analysis



1. Introduction

This report presents the results of a geotechnical investigation that was conducted in support of the a proposed residential and commercial development being considered for a site situated on Part Lot 13, Concession 5 in the Township of Cavan Monaghan, County of Peterborough, Ontario (herein referred to as “the Property” and “the Site”). The Property is located near the southeast corner of the intersection between Fallis Line and County Road 10 in Millbrook. The Site encompasses an area of approximately 29.5 hectares (72.9 acres) and is currently undeveloped. The proposed development will be municipally serviced with piped potable water (water main) and sanitary sewer. GHD Limited (GHD) was retained by Vargas Properties Inc. (the Client) to complete this geotechnical investigation which includes a hydrogeologic component.

The general location of the Site is illustrated on the Vicinity Plan, Figure 1. The location with respect to surrounding roads and land use is depicted on the Property Plan, Figure 2. Specific details of the Site and surrounding properties based on recent aerial photography is presented on the Plot Plan, Figure 3. A current plan (by The Biglieri Group Ltd. dated February 8, 2021) depicting the proposed development layout is provided on the Concept Plan, Figure 4. The borehole and test pit locations are illustrated on the Test Hole Location Plan, Figure 5. These plans and other figures can be reviewed in the Enclosures section.

2. Scope of Investigation

The purpose of the investigation was to define the prevailing hydrogeologic and geotechnical conditions at the Site. The hydrogeologic aspects of the study were completed to investigate the subsurface soil stratigraphy, groundwater movement, to assess groundwater supplies and evaluate potential impacts from the proposed development and related construction. The geotechnical investigation was conducted to provide recommendations relevant to earthwork construction, dewatering, foundation and slab on grade design, buried service installation and pavement structure. The following scope of work was performed to accomplish the foregoing purposes.

1. Reviewed available background information relevant to the Site such as geologic, physiographic and water resources reports and maps.
2. Carried out an inventory of available well record data on file with the Ministry of the Environment, Conservation and Parks (MECP) for the immediate area to evaluate the physical characteristics of the aquifer complexes that underlie the region. A field survey of the general area was carried out to supplement the MECP data. Representative groundwater samples were obtained from three (3) existing water wells which were subjected to chemical testing to evaluate surrounding groundwater chemistry.
3. A walkover inspection was conducted to review surficial ground characteristics.



4. The subsurface conditions were explored by advancing, sampling and logging a total of thirteen (13) boreholes and six (6) test pits. The subsurface conditions were recorded and are summarized in detail in Appendix A. The boreholes were advanced to depths ranging from 6.3 to 8.2m. The test pits were excavated to depths that varied from 3.0 to 3.5m. A monitoring well was installed in three (3) of the boreholes to facilitate water level measurements and further testing.
5. Falling head (slug) tests were completed at all three (3) monitoring well locations to evaluate hydraulic conductivity of the subsoils. The infiltration rate of the upper vadose zone was evaluated based on the soil type observed and in-situ testing.
6. Laboratory analyses of representative soil samples were completed by GHD including grain size testing, Atterberg Limits testing and moisture content determinations.
7. Obtained a representative groundwater sample from two (2) of the monitoring wells on-Site and subjected the samples to chemical testing to determine background chemistry.
8. Evaluate the stability of a proposed stormwater management pond and provide analysis using slope analysis software based on a concept plan provided by The Biglieri Group Ltd.
9. Completed a water balance that considers pre- and post-development conditions and evaluates groundwater baseflow conditions based on the current concept.
10. Prepared a detailed report using engineering analyses of the acquired data outlining our conclusions and recommendations presented herein.

The boreholes were advanced using a track mounted drill rig equipped with continuous flight, solid stem power augers. Representative, disturbed samples of the strata penetrated were obtained using a split-barrel, 50mm outer-diameter (OD) sampler advanced by a 63.5 kg hammer dropping approximately 760 mm. The results of these standard penetration tests (SPT's) are reported as "N" values on the borehole logs at the corresponding depths. Samples were also obtained directly from auger cuttings. The test pits were conducted using a track excavator.

Soil samples obtained from the test holes were inspected in the field immediately upon retrieval for type, texture, and colour. All test holes were backfilled following completion of the fieldwork. All samples were sealed in clean plastic containers and transported to the GHD laboratory for further visual-tactile examination, and to select appropriate samples for laboratory analysis.

3. Project Details

The preliminary conceptual plan is provided as Figure 4 (based on the Conceptual Draft Plan prepared by The Biglieri Group Ltd. (drawing No. CDP-01, dated February 8, 2021)). The information provided indicates that the overall area of the Site is 29.5 ha (72.9 acres) and that the proposed development will include a commercial block, ninety-six (96) single home residential lots, sixty-two (62) townhouse units, a multi-storey residential building, one (1) stormwater management (SWM) pond, supporting asphalt paved roadways and sidewalks. GHD has assumed that the structures will have one-level basements. The development will be municipally serviced for potable water and sanitary sewers.



4. Site Conditions

4.1 General

The field program consisted of a site inspection, soils investigation, hydraulic testing, and measurements of water levels in the monitoring wells. The boreholes were drilled on March 12 to 13, 2020 and April 15 to 16, 2020. The test pits were excavated on March 6, 2020. Borehole and test pit records and physical test results of representative soil samples are presented in Appendix A. A site reconnaissance was conducted by GHD prior to the subsurface investigation to observe the general surficial characteristics of the Site.

The Property is irregular in shape and is bounded by existing and future residential lots to the south, agricultural/residential lands to the north, County Road 10 and residential lands to the west and vacant, bush covered lands to the east. Local relief across the Site is on the order of 34 to 35m. Tributaries of Baxter Creek exist within the environmental areas (southern portion) of the Site. A residential dwelling and metal framed sheds exist on lands north of Fallis Line. Ground surface evidence indicated that the northern (upland) area of the Site has been used to support agricultural cash crops in the past.

4.2 Subsurface

4.2.1 Regional Physiography and Geology

The Property is situated in the physiographic region known as the Peterborough Drumlin Field (Chapman and Putnam, 1984) north of the Oak Ridges Moraine. As illustrated on the Figure 7, the Site exists within a sand plain with drumlinized till plains to the southeast. The surficial geology (Figure 8) is comprised of modern alluvial deposits within the southern parts of the Site and stone-poor, carbonated-derived silty to sandy till in the northern parts of the Site. The Ontario Geological Survey information (Figure 9) indicates that the Quaternary geology for the area is glaciolacustrine deposits of gravelly sand and nearshore and beach deposits with till, undifferentiated, predominantly sandy silt to silt matrix, commonly rich in clasts, often high in total matrix carbonated content to the north and glaciofluvial ice-contact deposits, gravel and sand, minor till, includes esker, kame end moraine, ice-marginal delta and subaqueous fan deposits to the west of the Site.

A review of available MECP water well records identified eight (8) wells within 0.25km of the Site. The well records indicate the presence of sand and/or gravel followed by clay and then variable layers of sand, gravel and clay or sandy clay with gravel (interpreted to be glacial till). The well records considered are included in Appendix B. Physical and hydraulic data are presented on some of the MECP well records. The water well information is discussed in Section 5.1.



4.2.2 Local Geology

The subsurface stratigraphy was investigated by drilling thirteen (13) boreholes on March 12 to 13, 2020 and April 15 to 16, 2020. Monitoring wells were installed in three (3) of these boreholes to facilitate water level measurements and testing. A shallow standpipe piezometer was installed adjacent to the monitoring wells in boreholes BH-4 and BH-7 to detect the possible presence of a permanent shallow groundwater table. Six (6) shallow test pits were excavated on March 6, 2020 in areas between the boreholes. The locations of the test holes are illustrated on the Test Hole Plan, Figure 5. Details of the subsurface conditions encountered are graphically presented in Appendix A. It should be noted that the boundaries between the strata have been inferred from the test hole observations and non-continuous samples. They generally represent a transition from one soil type to another and should not be inferred to represent an exact plane of geological change. Further, conditions may vary between and beyond the test holes.

The soils encountered generally consisted of topsoil underlain by silty sand and then glacial till and/or silty clay. Isolated layers of silty sand and/or sand and gravel were encountered sporadically throughout southern parts of the Site. A surficial layer of topsoil was encountered in all test holes and was observed to range from 150 to 300mm in thickness. This soil was observed to be in a damp, loose state, with a silty, highly organic content. As such, it is expected to be devoid of any structural engineering properties.

Silty sand or sandy silt was encountered below the topsoil in all test holes with the exception of test pit TP-2. The silty sand/sandy silt extended to the full depth of investigation in borehole BH-12 and to depths ranging from 0.3 to 2.7m in the remaining boreholes. Moisture content tests conducted on samples of the silty sand/sandy silt yielded values ranging from approximately 7 to 36 % moisture by weight indicating that it exists in a moist to wet state. SPT N values obtained from within the silty sand layer varied from 2 to 41 blows/300mm, indicating a very loose to dense in-situ state of relative density. Grain size distribution analyses conducted on representative samples of the silty sand/sandy silt suggests the following composition: 0 to 4 % gravel, 33 to 53% sand, and 47 to 63% silt and clay-sized particles by weight (Unified Soil Classification System (USCS)). Hydrometer analyses conducted on these sample suggest that the silty sand/sandy silt contains 41 to 48% particles between 5 and 75 μ m in size. Grain size data have been summarized in Table 4.1.

A layer of silty clay was encountered beneath the silty sand/sandy silt layers in borehole BH-9 to BH-11, and BH-13. The silty clay extended to the full depth of investigation in the boreholes BH-10, BH-11 and BH-13, to 7.6m in borehole BH-9. The silty clay exists in a generally moist to wet condition with moisture contents ranging from 7 to 42% moisture by weight. The consistency of the clayey silt is generally described as very soft to hard based on SPT N values that ranged from 1 blows/300mm to 34 blows/300mm. Grain size distribution analyses conducted on two (2) representative samples of the clayey silt suggests the following compositional ranges: 0 to 2% gravel, 8 to 9% sand, and 90 to 91% silt and clay-sized particles (USCS). Hydrometer analyses conducted on these samples suggest that the clayey silt contains 23 to 33% particles between 5 and 75 μ m in size. An Atterberg Limits test conducted on a representative sample of the silty clay indicated a Plasticity Index of 22% and Liquid Limit of 44%.



Glacial till was encountered in all test holes with the exception boreholes BH-10 to BH-13. The till was brown to grey in color and generally consisted of silty sand or sandy silt containing varying amounts of clay and gravel. Occasional cobbles were encountered in the till at some test hole locations. The till exists in a generally moist to wet condition with moisture contents ranging from 4 to 22% moisture by weight. The relative density of the till is generally described as loose to very dense based on SPT N values that ranged from 5 blows/300mm to over 100 blows/300mm. A grain size distribution analysis conducted on a representative sample of the till suggests the following composition: 13% gravel, 29% sand, and 58% silt and clay-sized particles (USCS). A hydrometer analysis conducted on this samples suggest that the till contains 33% particles between 5 and 75 μm in size.

Intermittent layers/seams of silty sand or sand and gravel were observed within the till or silty clay in two (2) of the test holes, i.e. BH-5 and BH-13. The silty sand and sand and gravel layers were observed in a generally wet condition with moisture contents ranging from 18 to 21% moisture by weight. SPT N values obtained from within these layers varied from 10 to 21 blows/300mm indicating a compact in-situ state of relative density. A grain size distribution analysis conducted on a representative sample of the silty sand suggests the following composition: 0% gravel, 91% sand, and 9% silt and clay-sized particles (USCS).

Table 4.1 Grain Size Distribution Summary

Location	Depth (m)	Grain Size Distribution				Observed Soil Unit
		%Gravel	%Sand	%Fines		
				%Silt	%Clay	
BH-3, SS-4	2.3 – 2.9	13	29	33	25	Sandy Silt Till
BH-7, SS-1	0.1 – 0.6	4	33	48	15	Sandy Silt
BH-9, SS-5	3.1 – 3.7	2	8	23	67	Silty Clay
BH-10, SS-3	1.5 – 2.1	0	9	33	58	Silty Clay
BH-11, SS-6A	4.6 – 4.9	0	91	9		Silty Sand
BH-12, SS-6	4.6 – 5.2	0	53	41	6	Silty Sand

Notes: %Fines indicates silt and clay particles; grain size distribution based on Unified Soil Classification System.

4.2.3 Groundwater

Groundwater seepage was observed in ten (10) of the boreholes and one (1) of the test pits (TP-3) at depths ranging from 1.8 to 4.0m during the drilling and excavation operations, respectively. GHD notes that artesian groundwater conditions were not encountered in any of the test holes although it has been reported at nearby properties. It is expected that artesian conditions may be encountered at depths greater than what was explored for this investigation. Monitoring wells were installed in three (3) boreholes (BH-4, BH-7, and BH-13) in order to facilitate monitoring of groundwater levels. A summary of the monitoring well details is provided in Table 4.2.



Table 4.2 Summary of Monitoring Well Information

Location	Depth of Well (m)	Pipe Stick-Up (m)	Effective Well Screen Interval (m)	Water Seepage Depth (m)
BH-4	7.6	0.77	6.1 – 7.6	Not Encountered
BH-7	6.1	0.78	4.6 – 6.1	Not Encountered
BH-13	6.1	0.77	4.6 – 6.1	2.7

Groundwater potentiometric levels were measured on May 19, 2020 in the installed monitoring wells. The data has been plotted on Figure 6 and summarized in Table 4.3.

Table 4.3 Potentiometric Water Level Summary

Location	Ground Elevation (m)*	Water Level (m) May 19, 2020	GW Elevation (m) May 19, 2020
BH-4	247.1	Dry	Dry
BH-7	238.8	Dry	Dry
BH-13	213.8	2.4	211.4

Notes: m = metres; GW = groundwater; (*) Elevations interpreted from contours on Topographic plan prepared by IBW Surveyors File Name "P-0400_Topo_v4.dwg" dated Jan. 14, 2020. The elevations presented are for the purposes of evaluating groundwater elevation and flow direction and should not be relied upon as a legal survey or topographic elevation survey.

Based on the water level data collected and the surrounding topography, the overall shallow groundwater flow direction is to the southeast towards tributaries that lead to Baxter Creek. The direction of shallow groundwater movement is illustrated on the Groundwater Elevation plan, Figure 6. It is expected that groundwater seepage will be encountered intermittently at depths ranging from 1.8 to 4.0m (similar to what encountered during the subsurface explorations). It should be noted that groundwater levels are transient and tend to fluctuate with the seasons, periods of precipitation and temperature.

4.2.4 Water Quality

A groundwater sample was collected from the monitoring wells installed in BH-7 and BH-13 and from an existing water well that is present on adjacent property north of Fallis Line for the purpose of determining background water quality. The certificates of chemical analysis are presented in Appendix D. The water quality data are summarized and compared with the Ontario Drinking Water Standards (ODWS) in Table 4.4.



Table 4.4 Water Quality Summary

PARAMETER	Monitoring Well			ODWS		
	BH-7	BH-13	W-3 (Water Well N of Site*)	MAC	IMAC	AO/OG
Alkalinity (as CaCO ₃)	209	216	246	--	--	30 to 500
Ammonia - Total	0.03	0.05	<0.03	--	--	--
Calcium	93.2	91.5	113	--	--	--
Chloride	4.2	4.1	11.7	--	--	250
Colour (T.C.U.)	<2	5	2	--	--	5
Conductivity (mS/cm)	433	435	548	--	--	--
Copper	<0.002	<0.002	<0.002	--	--	1.0
Fluoride	<0.1	<0.1	<0.1	1.5	--	--
Hardness (as CaCO ₃)	265	261	309	--	--	80 to 100
Iron	0.187	0.082	<0.005	--	--	0.3
Magnesium	7.84	7.73	6.41	--	--	--
Manganese	0.030	0.026	<0.001	--	--	0.05
Nitrite (N)	<0.1	<0.1	<0.1	1.0	--	--
Nitrate (N)	<0.1	<0.1	3.0	10	--	--
pH (units)	8.02	7.81	8.00	--	--	6.5 to 8.5
Potassium	1.4	1.3	0.9	--	--	--
Sodium	4.1	4.0	6.7	--	--	200
Sulphate	7	7	4	--	--	500
Turbidity (N.T.U.)	17.8	1180	0.8	1	--	5
Zinc	<0.005	<0.005	<0.005	--	--	5.0

Notes: All units in mg/L (i.e. parts per million) unless otherwise noted. MAC = maximum acceptable concentration (health related); IMAC = Interim MAC (insufficient data to establish MAC or not feasible to establish MAC to desired level); AO/OG = aesthetic objective or operational guideline (not health related). **Bolded value** exceeds ODWS. (*) see L-5 water well location on Enclosure B.4 in Appendix B.

The groundwater beneath the Site is relatively hard which is common in Southern Ontario due to overburden materials containing calcium. In general, the water quality is relatively good with no indication of organic pollution as evidenced by the lack/low concentrations of nitrite and nitrate.

4.2.5 Hydraulic Conductivity

Hydraulic conductivity (K) testing was completed at the monitoring wells installed in boreholes BH-4, BH-7, and BH-13. The testing consisted of falling and/or rising head testing and was completed by introducing a one-metre long slug within the well or by filling the monitoring well with potable water, and then measuring the water levels using a data logger programmed to record readings at three (3) second intervals. The data was analyzed using AQTESOLV and the Bouwer-Rice solution for each test (see Appendix C for solution data).

The K values for the hydraulic conductivity testing range from on the order of 10^{-3} to 10^{-5} cm/sec. The K values from the test data indicate that the monitoring wells were screened within medium (sand) to low (till) hydraulic conductivity units. The hydraulic conductivity testing suggests that excavations within these soils are expected to yield low to little water. However, increased amounts of water may be expected when pockets or layers of sand and/or gravel are intersected.



4.2.6 Infiltration Testing

For purposes of Low Impact Development strategies, infiltration data of the shallow site soils is presented in this section. In-situ constant head permeameter tests were conducted at six (6) locations in test pits TP-2 (at 0.6 and 1.2m depth), TP-5 (0.3m depth), TP-6 (1.0m), and near boreholes BH-4 (at 0.6m depth) and BH-7 (0.6m depth). The importance of infiltration is for the implementation of low impact development strategies to recharge precipitation into the ground at pre-development or near pre-development values. Infiltration testing was completed using an ETC Pask (constant head well) permeameter. The testing was not successful at test pits TP-1, TP-3, TP-4 due to unknown subsurface conditions that may have been related to clayey till, boulders or some other condition.

Based upon the infiltration testing conducted near test pits TP-2, TP-5 and TP-6, the upper vadose zone has a field saturated hydraulic conductivity ranging from 10^{-3} to 10^{-5} cm/sec (Appendix C). The infiltration test results provide preliminary infiltration values for the Site and are indicative of silty sand or sandy silt material. Although LIDs can be applied to any soil type, additional testing should be considered at the detailed design stage when infiltration areas are known.

Based on the Supplementary Guidelines to the Ontario Building Code 2012, this correlates to an infiltration rate in the order of 30 to 75 mm/hr. It is noted, however, that slight variations in the soil stratigraphy may cause variations in the permeability of the soil in both vertical and horizontal orientations.

Based on the Low Impact Development Stormwater Management Planning and Design Guide, the infiltration rate used to design the infiltration facility must incorporate a safety correction factor that compensates for potential reductions in soil permeability due to compaction or smearing during construction, gradual accumulation of fine sediments over the lifespan of the infiltration facility and uncertainty in measured values when less permeable horizons exist within 1.5m below the bottom of the infiltration facility.

5. Hydrogeology

The hydrogeology of the area is characterized by rolling topography of soils that generally consists of silty clay or glacial till with intermittent layers of silty sand and sand and gravel. Seasonal water is expected to flow within the sandy layers. Limited vertical migration is expected within the silty clay and till. Only a minor portion of the existing infiltration is expected to recharge the deeper aquifers that are confined below the silty clay and till. Information regarding groundwater characteristics of the immediate area was obtained from an inventory of well records. A total of eight (8) records were found to be available within 0.25km of the Site. The well records indicate the presence of clay and stones (which is interpreted to be glacial till) with occasional sand and gravel or sand layers. Bedrock was reported in two (2) of the local wells at depths ranging from 65 to 69m. The well records considered are provided and shown in Appendix B. Physical and hydraulic data are presented on the MECP records. The records include six (6) drilled overburden wells and two (2) drilled bedrock wells.



5.1 Existing Local Water Supplies

Nearby surrounding lands include residential developments to the west across County Road 10, south along Nina Court and occasional residential homes along Buckland Drive. These areas are municipally serviced. In addition, the proposed development (Site) will be municipally serviced. The compiled MECP data included eight (8) well records within 0.25km of the Property. The well records considered are presented in Appendix B. Physical and hydraulic data are presented on some of the MECP well records. The records indicate the presence of clay and stones (interpreted to be glacial till) with occasional sand and gravel or sand layers. The information indicates the presence of two (2) principal aquifer systems:

1. Interbedded overburden of sand and gravel within the till tapped by some wells; and
2. Deeper saturated fractures within the underlying bedrock formation tapped by other drilled wells.

The groundwater was generally described as “fresh” in the well records reviewed (when indicated). The drilled overburden wells extend to depths ranging from 16.5 to 63.7m and groundwater was encountered at depth ranging from 16.2 to 63.7m. These wells reportedly produce test yields of 18.2 to 100.1 L/min. In comparison, the bedrock wells extended to depths ranging from 70.1 to 72.2m and reportedly produce test yields ranging from 9.1 to 13.7 L/min. Artesian (flowing) conditions were reported in two (2) of the drilled wells situated to the southwest of the Site within 0.25km. The MECP well data has been summarized in Table 5.1.

Table 5.1 Summary of MECP Water Well Data

Total Number of Wells Inventoried:		8		
Drilled Wells (Overburden):		6 (75%)		
Drilled Wells (Bedrock):		2 (25%)		
Parameters	Statistical Summary			
	Drilled – Overburden		Drilled – Bedrock	
WELL YIELDS				
Range	18.2 – 100.1L/min	4.0 – 22 lgpm	9.1 - 13.7 L/min	2.0 – 3.0 lgpm
Average	55.4 L/min	12.2 lgpm	11.4 L/min	2.5 lgpm
REPORTED YIELDS	Frequency			
Not Reported	0	0%	0	0%
Dry	0	0%	0	0%
0 to 1 lgpm	0	0%	0	0%
2 to 4 lgpm	1	17%	2	100%
5 to 9 lgpm	1	17%	0	0%
≥10 lgpm	4	66%	0	0%
STATIC WATER LEVELS				
Range	0.0 – 53.3 m	0.0 – 175 ft	20.1 – 21.3 m	66 – 70 ft
Average	17.5 m	57.5 ft	20.7 m	68.0 ft
WATER ENCOUNTERED				
Range	16.2 – 63.7 m	53.0 – 209 ft	65.8 – 68.6 m	216 – 225 ft
Average	41.2 m	135.3 ft	67.2 m	220.5 ft
WELL DEPTH				
Range	16.5 – 63.7 m	54.0 – 209 ft	70.1 – 72.2 m	230 – 237 ft
Average	41.5 m	136.2 ft	71.2 m	233.5 ft

Notes: Data based on MECP well record information (see Appendix B). L/m represents litres per minute, lgpm indicates Imperial gallons per minute and m is metres.



To supplement the MECP well records reviewed, GHD staff conducted a well survey of the area to investigate where private wells may still be in use (Appendix B). Information was collected during the survey from a total of three (3) homes close to the Site including the identification of two (2) drilled wells. An existing bored well was identified on the property located north of Fallis Line and a shallow dug/bored well was identified immediately west of Site. Three (3) homeowners interviewed during the well survey reported that their property supported a water well but that they are currently connected to available municipal servicing, i.e. watermain. One (1) homeowner indicated that the water produced by their well was cloudy and had methane gas. Interviewed homeowners indicated that they had no additional water quality or quantity issues related to the wells. Groundwater samples were collected from three (3) of the water wells. The certificate of chemical analysis is presented in Appendix D.

5.2 Source Water Protection Considerations

Where proposed developments are being planned, it is important to determine the presence of Significant Groundwater Recharge Areas (SGRAs) and Highly Vulnerable Aquifers (HVAs) in the area. These areas are protected under the Clean Water Act (2006). In general, SGRAs are defined as areas where water seeps into an aquifer from rain and melting snow, supplying water to the underlying aquifer. An HVA aquifer occurs where the subsurface material offers limited protection from contamination resulting from surface activities.

GHD considered the potential for SGRAs and HVAs by reviewing the "Source Protection Information Atlas" that is currently available through the MECP website. The published information is dated February 4, 2021. In general, there are no HVAs in close proximity to the Site (see Figure 10). Further, the subsurface investigation by GHD has indicated that the existing glacial till and silty clay exhibits low hydraulic conductivity indicating that it has a relative lower contribution to underlying aquifer complexes.

As defined in the Clean Water Act (2006), an area is a significant groundwater recharge area if,

- the area annually recharges water to the underlying aquifer at a rate that is greater than the rate of recharge across the whole of the related groundwater recharge area by a factor of 1.15 or more; or
- the area annually recharges a volume of water to the underlying aquifer that is 55% or more of the volume determined by subtracting the annual evapotranspiration for the whole of the related groundwater recharge area from the annual precipitation for the whole of the related groundwater recharge area.

The entire site is located outside SGRAs as shown on Figure 10. GHD does acknowledge that SGRAs are present near Nina Court to the south (score of 2). Therefore, the proposed development will consider maintaining pre-development infiltration. As such, no impacts are expected to the SGRAs.



6. Conclusions and Recommendations

Supporting data upon which our recommendations are based have been presented in the foregoing sections of this report. The following recommendations are governed by the physical properties of the subsurface materials that were encountered at the Site and assume that they are representative of the overall site conditions. It should be noted that these conclusions and recommendations are intended for use by the designers only. Contractors bidding on or undertaking any work at the Site should examine the factual results of the investigation, satisfy themselves as to the adequacy of the information for construction, and make their own interpretation of this factual data as it affects their proposed construction techniques, equipment capabilities, costs, sequencing, and the like.

Comments, techniques, or recommendations pertaining to construction should not be construed as instructions to the contractor. Based on the results of the geotechnical investigation, it is our professional opinion that the Site is suitable for the proposed residential development and there is low potential for groundwater impact as a result of developing the Site. It is recommended that good construction and mitigation techniques must be used to minimize the potential for impact. Detailed conclusions and recommendations are presented in the following sections regarding the water balance and potential impacts to groundwater and surface water resources.

6.1 Hydrogeology

6.1.1 Water Balance Evaluation

An evaluation of the water balance was completed to compute the potential impacts that may occur in the recharge/discharge characteristics related to the proposed development. This evaluation is based upon a preliminary conceptual plan. The objective of the water balance is to illustrate that post-development infiltration within the developable area can meet or be close to pre-development values. The computations have used detailed parameters such as precipitation (Peterborough A), regional evapotranspiration, infiltration and runoff. Weather data from Peterborough A was selected as it was the closest weather station to the Site (~10.2km to the northeast). The detailed calculations can be reviewed in Appendix E. The total Site area is 29.5ha based on information provided. The following is a summary of the expected pre-development water balance values for the proposed residential and commercial development based on current information.

Pre development Water Balance

The pre-development water balance incorporated the existing soils, slope and ground cover areas. The infiltration factor for the area was calculated from the table of values presented in the "Land Development Guidelines" (MOEE, 1995). It is based on three sub-factors which are:

- Topography sub-factor;
- Soil sub-factor; and
- Cover sub-factor.

The slope of the site was considered as "hilly" (slope of 28m to 47m per km). The soils are generally comprised of sandy silt, till or silty clay material and will be considered a medium clay and loam to a tight impervious clay as per the water balance calculations. Table 6.1 summarizes the expected pre-development water balance values for the Site.



Table 6.1 Pre Development Summary

Total Precipitation (Peterborough A):	- 855 mm/year
Regional Evapotranspiration:	- 556 mm/year
Recharge Available:	- 299 mm/year
Area of Recharge Available (Site):	- 294,789 m ²
Total Water Surplus:	- 88,193 m ³ /year
Total Estimated Infiltration:	- 41,098 m ³ /year
Total Estimated Runoff:	- 47,095 m ³ /year

Based upon these values, the Site infiltrates on the order of 41,098m³ per year (~140 mm/year).

Post Development Water Balance (No Enhancements)

The computation of the water budget was repeated for the proposed development assuming no mitigation techniques, that is, runoff from impervious surfaces is unrecoverable and not infiltrated into the ground. The anticipated impact of the development is related to increased runoff from impervious surfaces, such as asphalt surface (access roads, driveways and parking areas) and building rooftops. These are assumed to be impervious surfaces with zero infiltration capacity in this model. A summary of the computations is provided in Table 6.2.

Table 6.2 Post Development Summary (No Enhancements)

Area of Site:	- 294,789 m ²
Impervious Surfaces:	- 112,158 m ²
Area Available for Infiltration:	- 182,631 m ²
Total Water Surplus:	- 131,390 m ³ /year
Total Estimated Infiltration:	- 27,375 m ³ /year
Infiltration % Difference (pre- vs. post-):	- (-33%) (decrease)
Total Estimated Runoff:	- 104,016 m ³ /year
Runoff % Difference (pre- vs. post-):	- 121% (increase)

The impermeable surface area of proposed paved areas and building rooftops was estimated based on the concept plan presented in Figure 4 and information provided by the Client. Under this scenario, the total infiltration volume decreased by 33% and runoff volume increased by 121%. Within the areas evaluated, the infiltration has reduced and the runoff increased versus the pre-development values. Groundwater base flow would be expected to decrease over time in this scenario. However, recharge via infiltration through the underlying till and silty clay to the lower aquifer from these lands is expected to be minor. Based upon this scenario, mitigative strategies are required to minimize infiltration losses and reduce storm water runoff. The following section discusses the water balance after considering enhanced infiltration options.



Post Development Water Balance (Enhanced Infiltration)

The post-construction water budget computations were repeated considering enhanced infiltration options which are also known as Low Impact Development (LID) technologies. These technologies include and are not restricted to rainwater harvesting, downspout disconnection, infiltration trenches, vegetated filter strips, bioretention, permeable pavement, enhanced grass swales, dry swales and perforated pipe systems in order to balance the water budget and maintain any wetland features including nearby creeks. The shallow subsurface soils are silty sand/sandy silt over silty clay and/or glacial till material. It is noted that LIDs can work in any soil type. The primary enhancement for this Site is to promote infiltration and to move water from impervious surfaces to areas where infiltration can occur.

The post-development water balance was modelled to include the disconnection of downspouts from storm sewers and directing water from the buildings roof top to sodded areas or undeveloped grass areas which can be enhanced with increased topsoil depths. GHD notes that this was done solely for demonstration purposes and specific LID design criteria will be the responsibility of the stormwater engineer for the development. A summary of the post-construction water budget with enhancements for infiltration is presented in Table 6.3.

Table 6.3 Post Development Summary (With Enhanced Infiltration)

Area of Site:	- 294,789 m ²
Total Water Surplus:	- 131,390 m ³ /year
Total Estimated Infiltration:	- 41,098 m ³ /year
Infiltration % Difference (pre- vs. post-):	- (0%) (nil)
Total Estimated Runoff:	- 90,293 m ³ /year
Runoff % Difference (pre- vs. post-):	- 92% (decrease)

Under this scenario, the total infiltration volume is maintained and runoff volume decreased to 92% compared to pre development values. Within the areas evaluated, the infiltration and runoff amounts have improved compared to post development (no mitigation) numbers. Runoff will need to be managed as per the storm water management plan.

It is expected that recharge via infiltration through the till to the lower aquifers is a small component and impacts to the groundwater aquifer are expected to be insignificant. It is our professional opinion that there would be minimal impact to the local groundwater regime and minimal impact to the down-gradient surface water regime from a quantity perspective.

6.1.2 Impact on Groundwater Baseflow

The importance of the groundwater baseflow is that it provides discharge to water bodies, wells and may have some hydraulic functionality with the on-site features. Water balance calculations suggest that the infiltration to the subsurface can be kept near pre-development values if appropriate LID technologies are used. It is GHD's professional opinion that there is not expected to be a significant impact to the shallow groundwater baseflow that may be supplying baseflow to the down-gradient tributaries to Baxter Creek.



6.1.3 Impact on Surface Water Bodies

The impacts to surface water bodies are related to the reduction of the groundwater baseflow and water quality concerns related to human activities such as salting of paved areas, minor fuel and oil leaks, fertilizer application, etc. It is expected that there will be minor impacts to groundwater and neighbouring surface water bodies. Runoff from the development will be collected by an internal storm sewer system and treated using a stormwater management pond or other LID strategies. Further details are provided within the Functional Servicing Report regarding the stormwater management.

6.1.4 Mitigation Measures

Several mitigative techniques have been recommended in order to address concerns relating to the potential for impact to the base flow. The impact and mitigation measures can be arranged into two (2) distinct categories: construction phase and operational phase. Prior to construction, storm water management techniques should be incorporated to control additional surface water runoff and permit enhanced infiltration into the surrounding ground. Storm water management techniques will minimize the potential for groundwater impact and also minimize the amount of silt or other fine-grained soil particles becoming mobile and entering into down-gradient areas. The installation of strategically placed silt fences will filter any excess storm water runoff prior to entering the infiltration areas.

During the operational phase of the development, it is expected that storm water excess will be controlled as indicated in the Functional Servicing Report. It is recommended that all roof leader drains of the future residential buildings be allowed to drain onto the ground surface for infiltration. Swales may be required in some areas to divert the runoff water where required. Other LIDs will be required to reduce storm water runoff and will be evaluated by the detailed design.

6.1.5 Servicing

Private services for water and septic disposal are not considered as the Site will be connected to municipal services. However, any wells at the Site (including monitoring wells) are recommended to be decommissioned in accordance with Ontario Regulation 903 prior to development of the Site.

6.1.6 Dewatering for Construction

Based on groundwater-related observations and the depth of excavations expected for this development, it is generally anticipated that groundwater seepage will be encountered. It is expected that pumping from collection sumps to an acceptable outlet will control this expected groundwater infiltration. However, should any excavations require more intensive dewatering or groundwater control, the use of filtered sumps, or other suitable method of dewatering and/or sheet piling is recommended. Based on local knowledge and previous experience in the area, it is expected that artesian (pressured) groundwater conditions exist in the confined aquifer located at depth below this area. It is also known that the aquitard (i.e. confining) soil layer within which excavations for this construction will occur, can be “leaky”, in that it can allow upwards leakage of the pressurized groundwater into excavations via hydraulically-conductive seams/senses of sand.



For dewatering purposes, hydraulic conductivities on the order of about 10^{-3} to 10^{-5} cm/sec may be expected for the subgrade soils encountered in our boreholes and test pits. It should be noted that hydraulic conductivities can vary over a vertical and horizontal extent and may be outside the stated range if pockets or seams of soils with different grain size (e.g. sand seams) are encountered.

If short-term pumping of groundwater at volumes greater than 50,000 L/day and less than 400,000 L/day is required during the construction stage, the Environmental Activity Sector Registry (EASR) must be completed. The EASR streamlines the process and water pumping may begin once the EASR registration is completed, the fee paid and supporting document prepared. If water taking in excess of 400,000 litres/day is required, a Permit to Take Water (PTTW) must be obtained in advance. PTTW applications may take up to 90 working days for the MECP to review and approve. The actual rate of groundwater taking performed during construction will be a function of the final design, time of year, and the contractor's schedule, equipment, and techniques.

6.2 Geotechnical

Supporting data upon which our recommendations are based have been presented in the foregoing sections of this report. The following recommendations are governed by the physical properties of the subsurface materials that were encountered and assume that they are representative of the overall Site conditions. It should be noted that these conclusions and recommendations are intended for use by the designers only. Contractors bidding on or undertaking any work at the Site should examine the factual results of the investigation, satisfy themselves as to the adequacy of the information for construction, and make their own interpretation of this factual data as it affects their proposed construction techniques, equipment capabilities, costs, sequencing, and the like. Comments, techniques, or recommendations pertaining to construction should not be construed as instructions to the contractor. It should be noted that where the Municipality has design standards that apply to specific aspects of this project, such standards shall take precedence over any corresponding dissimilar recommendations contained herein.

The soils encountered generally consisted of topsoil underlain by silty sand/sandy silt and then glacial till and/or silty clay. Isolated layers of silty sand and/or sand and gravel were encountered sporadically throughout southern parts of the Site. GHD notes that artesian groundwater conditions were not encountered in any of the test holes. Groundwater seepage was observed in ten (10) of the boreholes and one (1) of the test pits (TP-3) at depths ranging from 1.8 to 4.0m during the drilling and excavation operations. Groundwater level measurements obtained from the well installed in borehole BH-13 yielded a water level of 2.4m on May 19, 2020. The monitoring wells installed in boreholes BH-4 and BH-7 were dry on May 19, 2020.

6.2.1 Site Preparation and Excavation

Any and all topsoil, vegetation, fill, disturbed earth, organic and organic-bearing material is to be stripped and removed from the access roads and building envelope areas (including floor slab areas) prior to commencing earthwork construction. Overly loose, organic, or otherwise deleterious materials will require removal and replacement with an approved backfill material. The subexcavated surface must be proof rolled and/or approved by a member of GHD prior to placement of fill or foundations.



Excavations should be carried out to conform to the manner specified in Ontario Regulation 213/91 and the Occupational Health and Safety Act and Regulations for Construction Projects (OHSA). All excavations above the water table not exceeding 1.2m in depth may be constructed with vertical, unsupported slopes. The soils encountered during this investigation are generally classed by OHSA as Type 3. As such, unsupported / unshored walls of excavations in these soils must be sloped to the bottom of the excavation, with a slope having a gradient of 1 horizontal to 1 vertical (1H:1V) or flatter, or be retained using a suitably designed shoring system. The soils located beneath the groundwater table should be considered Type 4 soils, requiring unsupported / unshored walls of excavations to be sloped at 3H:1V or flatter to the base of the excavation.

It is expected that some of the excavation spoils may be suitable for reuse as trench and/or pavement subgrade backfill provided they are free of organics and at a moisture content that will permit adequate compaction (may require prior processing such as aeration to lower the moisture content). A final review and approval to reuse any soils should be made at the time of construction.

Prior to removing any excess soils from the Site, it is recommended that such materials be subjected to chemical testing to characterize the excess soils for handling and disposal purposes.

6.2.2 Service Installation

The materials encountered during this investigation at the anticipated service invert elevations (2 to 6m below existing ground surface) typically consists of either glacial till or silty clay material. As such, normal compacted bedding material, placed in the Class "B" or Class "C" arrangement, is recommended for all underground services. The recommended bedding material is Granular "A" or 19mm crusher run (angular) stone, as per Ontario Provincial Standard Specifications (OPSS). The minimum recommended bedding thickness for the underground services is 150mm. All bedding materials should be compacted to 98% of their Standard Proctor Maximum Dry Density (SPMDD).

It is recommended that cover backfilling of the underground services be accomplished using Granular "A", sand, or other suitable material as allowed by the Municipality's standards, to a minimum of 300mm above the pipe. Compaction of this material should attain 100% SPMDD. It is expected that some of the excavated soils may be suitable for reuse as trench backfill, conditional upon suitable moisture content (within 2% of optimum), final review and approval by an experienced geotechnical engineer at the time of construction, and regular monitoring and inspection of such reuse throughout construction. Compaction of any native soil in service trenches is recommended to be a minimum of 98% of its SPMDD. The soils observed may require processing (such as aeration) to lower the moisture content to appropriate levels prior to being considered as backfill material.

It is recommended that trench plugs be installed at appropriate locations along the trench alignment (in particular, the main north/south alignments of the storm and sanitary sewers) to minimize and control any flow of groundwater along the trench bedding and backfill materials. It should be noted that concrete trench plugs for shallower watermain trench are susceptible to differential movement and heaving in relation to surrounding soils, particularly where plugs are located within the frost penetration depth (up to 1.5 to 1.6m). Clay plugs should be used in such instances, utilizing frost tapers to minimize movement within the frost zones.



6.2.3 Pavement Structures

Based on the results of this investigation, we would recommend the following procedures be implemented to prepare the proposed new roadways and asphalt paved parking areas for construction.

1. Remove any free organic topsoil, fill, disturbed earth, organics and organic-bearing materials, loam, frozen earth, and boulders larger than 150mm in diameter encountered at subgrade elevation for the full width of construction.
2. Proof roll the subgrade for the purpose of detecting possible zones of overly wet or soft subgrade. Any deleterious areas thus delineated should be replaced with approved earth fill or granular material compacted to a minimum of 98% of its SPMDD. Approved excavated soils can be reused as road subgrade backfill provided the soil is workable and at a moisture content that will permit adequate compaction. Saturated silts, organics and wet clay should not be reused. A final review and approval to reuse any soils must be made during construction.
3. Contour the subgrade surface to prevent ponding of water during the construction and to promote rapid drainage of the sub-base and base course materials.
4. To maximize drainage potential, and ensure satisfactory pavement performance, 150mm diameter perforated pipe subdrains should be installed along any curb lines. The pipe should be encased in filter fabric and surrounded by clear stone aggregate. It is recommended that the subdrains outlet to the storm sewer system.
5. Construct transitions between varying depths of granular subbase materials at a rate of 1:25 minimum.

Depending on the final proposed grades, the subgrade soils at this site are expected to consist of native silty sand/sandy silt, glacial till or clay. For overall pavement design purposes, the frost susceptibility of the native soils is assessed as being generally moderate to high. The Township's pavement structures standard (for both asphalt depths and granular depths) are considered sufficient. In this regard, the following minimum flexible pavement structure is recommended for the construction of the new roadways.

Table 6.4 Pavement Structure for New Roads

Profile	Material	Minimum Thickness (mm)		In Conformance with OPSS Form
		Local Residential	Collectors & Arterial	
Asphalt Surface	H.L.3	30	30	1150
Asphalt Base	H.L.4	50	70	
Granular Base	Granular “A”	150		1010
Granular Subbase	Granular “B”	450		

The subgrade materials in the proposed asphalt paved parking and access areas for proposed commercial areas of the development will generally consist of sandy silt till. The frost susceptibility of this soil is assessed as being generally moderate. The following minimum flexible pavement structures are recommended for these areas.



Table 6.5 Pavement Structure for Commercial Areas of Development

Profile	Material	Thickness (mm)		In Conformance with OPSS Form
		Light Duty	Heavy Duty	
Asphalt Surface	H.L.3	40	40	1150
Asphalt Base	H.L.8	50	50	
Granular Base	Granular "A"	150	150	1010
Granular Subbase	Granular "B"	300	450	

The following steps are recommended for optimum construction of paved areas.

1. The Granular "A" and "B" courses should be compacted to a minimum 100 % of their respective SPMDD's.
2. All asphaltic concrete courses should be placed, spread and compacted conforming to OPSS Form 310 or equivalent. All asphaltic concrete should be compacted to a minimum 92.0 percent of their respective laboratory Maximum Relative Densities (MRD's).
3. Adequate drainage should be provided to ensure satisfactory pavement performance.

It is recommended that all fill material be placed in uniform lifts not exceeding 200 mm in thickness before compaction. It is suggested that all granular material used as fill should have an in-situ moisture content within 2% of their optimum moisture content. All granular materials should be compacted to 100 % SPMDD. Granular materials should consist of Granular "A" and "B" conforming to the requirements of OPSS Form 1010 or equivalent.

It is noted that the above recommended pavement structure is for the end use of the project. During construction of the project, the recommended granular depths may not be sufficient to support loadings encountered.

6.2.4 Foundation Design

Relevant information for final design purposes including proposed final grades, finished floor elevations, and proposed underside of foundations were not available to GHD at the time of writing this report. As such, the recommendations contained in this Foundation Design section must be reviewed by GHD's geotechnical engineers once such development design parameters become available. Structural loading for the proposed residential dwellings (and commercial buildings) may be supported on strip and spread footings. The footings should be placed on the undisturbed, compact to very dense (or firm to hard) native soils or on engineered fill place directly on the undisturbed, firm to hard or compact to very dense native soils. Table 6.6 summarizes the depths to suitably competent native soil encountered within each borehole.



Table 6.6 Depth to Competent Bearing Native Soil

Borehole ID	Depth (m) to Competent Native Soil	Borehole ID	Depth (m) to Competent Native Soil
BH-1	0.8	BH-8	1.5
BH-2	0.8	BH-9	7.6
BH-3	0.8	BH-10	1.5
BH-4	0.8	BH-11	1.5
BH-5	2.3	BH-12	0.8
BH-6	0.8	BH-13	0.8
BH-7	0.8		

It is noted that pockets of very soft to soft soils were observed in boreholes BH-9 and BH-10 which may be present at other locations. If such soils are encountered at the foundation subgrade level, they must be subexcavated and replaced with engineered fill. For preliminary design purposes, it is recommended that footings constructed on compact to very dense (or firm to hard) native soils or engineered fill be proportioned and designed using the following bearing capacities presented in Table 6.7.

Table 6.7 Preliminary Bearing Pressures for Foundation Design

Parameter	Bearing Pressure			
	Compact to Very Dense (Firm to Hard) Undisturbed Native Soils	Engineering Fill		
		Rock-based Fill ⁽²⁾	Granular Fill ⁽³⁾	Earth Borrow Fill ⁽³⁾
Factored Bearing Capacity at ULS ⁽¹⁾	130 kPa	210 kPa	170 kPa	130 kPa
Bearing Capacity at SLS	90 kPa	150 kPa	120 kPa	90 kPa

Notes: (1) Resistance factor $\Phi = 0.5$ applied to the ULS bearing pressure for design purposes.

(2) At least 1m of Rock-based fill. Quality of material is to be approved prior to use as engineered fill.

(3) At least 0.3m of Granular or Earth Borrow fill. Quality of material is to be approved prior to use as engineered fill.

Any engineered fill upon which foundations are placed must be a minimum thickness corresponding to the notes that accompany the above table. Rock-based fill must be completely encapsulated with suitable filter fabric to minimize any migration of fine-grained particles from surrounding soils into the voids within the rock fill.



The following is recommended for the construction of any engineered fill for the foundations.

1. Remove any and all existing vegetation, topsoil, fill, organics, and organic-bearing soils to the competent, undisturbed native soil from within the area of the proposed engineered fill.
2. The area of the engineered fill should extend horizontally 1m beyond the outside edge of the building foundations and then extend downward at a 1:1 slope to the competent native soil.
3. The base of the engineered fill area must be approved by a member of GHD prior to placement of any fill, to ensure that all unsuitable materials have been removed, that the materials encountered are similar to those observed, and that the subgrade is suitable for the engineered fill.
4. All engineered fill material is to be approved by GHD at the time of construction. Place approved engineered fill, in maximum 300mm lifts, compacted to 100% of its SPMDD. Any fill material placed under sufficiently wet conditions should consist of an approved, rock-based fill, with the inclusion of appropriate geotextile fabric around the rock-based fill should the rock fill contain enough voids to warrant.
5. Full time testing and inspection of the engineered fill will be required, to ensure compliance with material and compaction specifications.

All exterior foundations and/or foundations in unheated areas, should be founded at least 1.2m below the final adjacent grade for frost protection. Foundations and walls exposed to frost action should be backfilled with non-frost susceptible granular material, and positive drainage away from the structure should be ensured.

Under no circumstances should the foundations be placed above organic materials, loose, frozen subgrade, construction debris, or within ponded water. Prior to forming, all foundation excavations must be inspected and approved by a member of GHD's geotechnical group. This will ensure that the foundation bearing material has been prepared properly at the foundation subgrade level and that the soils exposed are similar to those encountered during this investigation.

For design purposes this site is conservatively classed as Site Class D for Seismic Site Response, in accordance with the Ontario Building Code.

For drainage purposes, it is recommended that perimeter drains be installed about the structures. The subdrains would serve to drain seepage water that infiltrates the backfill, intersect the groundwater, and help relieve hydrostatic pressures due to high groundwater levels. The drains should consist of a perforated pipe, at least 150 mm in diameter, surrounded by clear, crushed stone and suitable filter protection. The drain should discharge to a positive sump or other permanent frost free outlet.

For foundations constructed in accordance with the foregoing manner, total and differential settlements are estimated to be less than 25mm.



6.2.5 Slab on Grade

The ground floor of any proposed building may be constructed as a normal slab-on-grade, on clear stone fill over native, inorganic subsoils, prepared in accordance with Section 6.2.1 of this report. The floor slab of the basement should be formed over a base course consisting of at least 150mm of 19mm angular clear stone material, compacted to a minimum of 100 % of its SPMDD. All grade increases or infilling below the clear stone should be constructed in accordance with the engineered fill steps. All clear stone must be surrounded on bottom and sides by appropriate filter fabric to control the migration of fine-grained particles from surrounding soils. All fill placed as engineered fill must be inspected, approved and compaction verified by personnel from GHD.

If basements are considered, it is recommended that under floor drains consisting of 100mm diameter, perforated, filter-wrapped pipe at maximum 3m centres be installed below the clear stone. These pipes should be led into a header placed in the middle of the drainage system. The header should consist of a 150mm diameter, filter-wrapped, perforated pipe. The drainage system should appropriately drain into a positive sump or other permanent frost free outlet.

6.2.6 Basement Retaining Walls

It is recommended that free draining backfill to walls (basement) be provided. Such walls located above the groundwater table may be designed for lateral earth pressures using the following equation:

$p = k (w h + q)$, where:

- the lateral earth pressure in kPa acting on the subsurface wall at depth h ;
- k_a = the coefficient of active earth pressure;
(= 0.3 for walls restrained from the bottom only);
(= 0.5 for walls restrained at the top and bottom*);
- k_p = the coefficient of passive earth pressure, (= 3.0);
- w = the granular or native soil bulk density in kN/m^3 ;
(= 21.0 kN/m^3 for well compacted, OPSS-approved Granular "B");
(= 20.0 kN/m^3 for native soils);
- h = the depth (in metres) below the exterior grade at which the earth pressure is being calculated; and
- q = the equivalent value of any surcharge (in kN/m^2) acting adjacent to the walls.

(*) This value is recommended for rigid walls retaining compacted backfill.

The recommended value for the coefficient for sliding friction between the soil and the concrete is 0.4. In addition to the above, hydrostatic forces must be taken into account in the design where the walls extend below the groundwater table. Also, any additional surcharge loading that will influence the wall must be taken into account in its design.

6.2.7 Stormwater Management Pond Design

Recommendations provided in this report are for preliminary design purposes and does not include an analysis of the proposed SWM pond berm's stability. GHD can perform such stability analyses once overall grading plans for the Site are finalized.



It is GHD's understanding that a SWM pond is proposed for this development and is to be located in the area of test hole BH-13, as shown on Figures 4 and 5. The native soils encountered in borehole BH-13 consisted of layers of sandy silt, silty clay, silty sand and sand and gravel. The hydraulic conductive of the native soils in the proposed SWM pond areas is expected to be on the order of 10^{-3} to 10^{-6} cm/sec based on hydraulic conductivity testing and gradation results of representative samples of these materials. It is noted, however, that slight variations in the soil stratigraphy may cause variations in the permeability of the soil in both vertical and horizontal orientations.

Based on the soils observed, and the anticipated base elevations, it appears that construction of the SWM pond in this area is feasible. In general, excavation of the soils for the SWM pond are expected to be straightforward, provided that appropriate measures are taken during construction to minimize any overland or near-surficial flow of water into the area. Groundwater seepage and surficial water inflow into the open SWM pond excavation is expected. However, this is generally expected to be controlled by pumping from within the excavation, along with further measures if required, including up-gradient cutoff trenching with appropriate drainage out-letting.

It is recommended that the SWM pond subgrade surfaces be proof rolled, and a representative of GHD approve the subgrade prior to construction of the berms. Construction of the berms may utilize excess site till or silty clay soils having a hydraulic conductivity of 10^{-5} cm/sec or lower. Such operations should place with soil in lifts no thicker than 150mm prior to compaction, and compacted to at least 95% SPMDD.

Due to the aforementioned soil and groundwater conditions, it is recommended that the base of the SWM pond be protected with an appropriate liner. The native, disturbed silty sand till or sand soils in a re-compacted state would not be suitable to form the SWM pond liner since the expected permeability would be too high. Conversely, native, undisturbed silty clay, or till with finer-grained gradation (silts and clays) would have a sufficiently low permeability and could substitute for a liner. An inspection of the excavated and exposed SWM pond surfaces should be performed at the time of construction, to assess where areas of increased hydraulic conductivity are present within the exposed soils, so that such areas may be lined with a more suitable (i.e. less hydraulically conductive) material. It is expected that this can be accomplished using the silty clay and/or till soils (as encountered in boreholes BH-9 to BH-11 and BH-13), coordinated with geotechnical inspection and final approval of materials. It is recommended that construction of such approved material be at least 600mm thick and must be placed under full time geotechnical inspections.

For the purpose of the proposed SWM pond, the soils observed should be stable from slip circle failure if sloped at 3 horizontal to 1 vertical (3H:1V) or flatter in the long term both above and below the water table. Between the stable water level and the expected high water level, it is recommended that the slopes be lessened to 4H:1V (or flatter) to guard against erosion by wavelet action. The till material will require vegetative root mass (or otherwise suitable erosion protection) to minimize erosional forces on exposed slopes.

Slopes and berms of the SWM pond should be constructed so as to reduce or eliminate the effects of surficial erosion. Features to do so may include slope vegetation, installation of erosion or gabion mats, rip rap, and/or other acceptable stabilizing features.



It is recommended that a regular maintenance program for the SWM pond include monitoring of it for any potential slope erosion, degradation, or otherwise undesirable structural conditions. Should any such conditions become evident, immediate mitigative actions must be performed.

6.2.8 Slope Stability Analysis

Global stability analyses were carried out at three (3) cross-sectional locations identified in Figure F.1 in Appendix F. Global stability refers to the potential of a slope to undergo a relatively deep seated circular failure. The subsurface stratigraphy was based upon the GHD test hole logs and published geologic information for the local area.

The static slope stability analyses were performed using the Morgenstern and Price Method using the module Slope/W of the computer software Geo-Studio, developed and distributed by Geo Slope International Ltd.

The properties required for the stability analyses of the slopes include bulk density and shear strength parameters of the materials identified at the Site. The subsurface soils encountered in the test holes are generally comprised of shallow silty sand/sandy silt soils underlain by silty clay or glacial till. Based on SPT blow counts (recorded as 'N' values on the borehole logs), the silty clay layer is typically firm to stiff in consistency, and the till is generally compact to very dense in relative density.

The material parameters assigned to each soil layer in the slope stability analyses are provided on the respective slope stability analysis on Figures F.2 through to F.4 in Appendix F. The selected parameters are considered conservative while realistic based on the field and laboratory testing performed on representative samples of the soils, as well as published technical literature and our experience with similar materials.

Piezometric surfaces can affect the results of the slope stability analyses if they pass through the soil mass above the critical slip circle / plane. The conditions for a free groundwater table (aquifer) are not present at the Site. Using the groundwater observations obtained from the open boreholes, in conjunction with the data obtained from the groundwater monitoring well installed in BH-4 and BH-7 and BH-13, the groundwater was not observed in the area of cross section A-A' and B-B' and is conservatively assumed to follow a straight line path from the depth at which it was observed in borehole BH-13 to the bottom of the slope (tributary of Baxter Creek).

A factor of safety (FS) in slope stability analysis can be defined as the ratio of the available shear strength to that of the applied stresses along a potential failure plane. An FS of 1.0 or greater indicates stable conditions and a value of less than 1.0 represents unstable conditions. Typically, a target FS between 1.3 and 1.5 is considered reasonable for natural slopes, under static conditions. For the purposes of this study, a minimum FS of 1.5 was targeted.



The graphical outputs of the slope stability analyses are provided on Figures F.2 to F.4. The following summarizes the minimum FS obtained for each modelled cross-section:

- Section A-A': FS=1.95 (north end of Site);
- Section B-B': FS=2.14 (central area of Site); and
- Section C-C': FS=2.46 (south end of Site which will support SWM pond).

All Cross-sections obtained an FS above the minimum targeted value of 1.5 and therefore, are considered globally stable. It is recommended that any future development consider the following regarding the slope(s):

- The existing vegetative cover must not be disturbed by any future development for continuation (and stabilization) of the existing conditions;
- Storm water should not be directed to flow over the crest of the slope; and
- The slope must be inspected at regular intervals for signs of erosion / instability and any required remedial measures should be performed in consultation with a geotechnical engineer.

The geotechnical engineer should be consulted when the development plans have been finalized to ensure that the proposed development does not affect the stability of the existing slope(s).

6.2.9 General Recommendations

Test Pit During Tendering

It is strongly recommended that test pits be excavated at representative locations of this Site during the tendering phase, with mandatory attendance of interested contractors. This will allow them to make their own assessments of the groundwater and soil conditions at the Site and how these will affect their proposed construction methods, techniques and schedules.

Subsoil Sensitivity

The native subsoils are susceptible to strength loss or deformation if saturated or disturbed by construction traffic. Therefore, where the subgrade consists of approved soil, care must be taken to protect the exposed subgrade from excess moisture and from construction traffic.

Winter Construction

The subsoils encountered across the Site are frost-susceptible and freezing conditions could cause problems for the following reasons.

1. During winter construction, exposed surfaces intended to support foundations must be protected against freezing by means of loose straw and tarpaulins, heating, etc.
2. Care must be exercised so that any sidewalks and/or asphalt pavements do not interfere with the opening of doors during the winter when the soils are subject to frost heave. This problem may be minimized by any one of several means, such as keeping the doors well above outside grade, installing structural slabs at the doors, and by using well-graded backfill and positive drainage, etc.



3. Because of the frost heave potential of the soils during winter, it is recommended that the trenches for exterior underground services be excavated with shallow transition slopes in order to minimize the abrupt change in density between the granular backfill, which is relatively non-frost susceptible, and the more frost-susceptible native soils.

Design Review and Inspection

Due to the preliminary nature of the design details at the time of this report, we recommend that our firm be retained to review the foundation design and grading proposals when they are available. Geotechnical inspection and compaction testing must be carried out to ensure compliance with our recommendations.

6.3 Summary Conclusions

In summary, the proposed development area is generally comprised of topsoil underlain by silty sand/sandy silt over silty clay or glacial till. A permanent shallow groundwater table was not observed. It is our opinion that there will not be significant constraints for the proposed residential and commercial development areas from the seasonal variations of groundwater as the water can be handled with appropriate engineering techniques. It is expected that groundwater will generally be below the depth of the future development, although seepage may be encountered in deeper excavations or foundations.

Seepage is expected to be seasonal in nature. If short-term pumping of groundwater at volumes greater than 50,000 L/day and less than 400,000L/day is required during the construction stage, the EASR must be completed. In summary, the proposed residential development is suitable from both a hydrogeologic and geotechnical perspective.

There are minor impacts expected to groundwater and surface water as a result of the future development provided that appropriate planning (i.e. incorporation of LIDs as supported by the water balance calculations), mitigation measures and proper construction techniques are considered. From a geotechnical perspective, the Site is suitable for construction of the proposed development including one to two-storey single residential homes, townhomes, commercial buildings and associated servicing and asphalt paved roadways, parking and access areas. Detailed recommendations are provided in previous sections of this report.



The following Statement of Limitations should be read carefully and is an integral part of this report. We trust this report meets your immediate needs. Should any questions arise regarding any aspect of our report, please contact our office.

Sincerely,

Leandro Ramos, P.Eng.



David Workman, P.Geo.



Nyle McIlveen, P.Eng.



lr/dw/nm



7. References

Chapman and Putnam, 1966. The Physiography of Southern Ontario, 2nd Edition. University of Toronto Press.

Chapman and Putnam, 1984. The Physiography of Southern Ontario, 3rd Edition. Ministry of Natural Resources.

City of Toronto, November 2006. Wet Weather Flow Management Guidelines.

Credit Valley Conservation and Toronto and Region Conservation Authority. Low Impact Development Stormwater Management Planning and Design Guide. Version 1.0. 2010.

Freeze, R. Allan and Cherry, John A. 1979. Groundwater.

Ministry of the Environment, Conservation and Parks, February 4, 2021. Source Protection Information Atlas, available online at www.ontario.ca.



8. Statement of Limitations


This report is intended solely for Vargas Properties Inc. in assessing the geotechnical and hydrogeologic aspects of the land situated on Part Lot 13, Concession 5 (located near the southeast corner of the intersection between Fallis Line and County Road 10) in Millbrook, Ontario and is prohibited for use by others without GHD's prior written consent. This report is considered GHD's professional work product and shall remain the sole property of GHD. Any unauthorized reuse, redistribution of or reliance on the report shall be at the Client and recipient's sole risk, without liability to GHD. Client shall defend, indemnify and hold GHD harmless from any liability arising from or related to Client's unauthorized distribution of the report. No portion of this report may be used as a separate entity; it is to be read in its entirety and shall include all supporting drawings and appendices.

The recommendations made in this report are in accordance with our present understanding of the project, the current site use, ground surface elevations and conditions, and are based on the work scope approved by the Client and described in the report. The services were performed in a manner consistent with that level of care and skill ordinarily exercised by members of hydrogeological engineering professions currently practicing under similar conditions in the same locality. No other representations, and no warranties or representations of any kind, either expressed or implied, are made. Any use which a third party makes of this report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties.

All details of design and construction are rarely known at the time of completion of a geotechnical or hydrogeological study. The recommendations and comments made in the study report are based on our subsurface investigation and resulting understanding of the project, as defined at the time of the study. We should be retained to review our recommendations when the drawings and specifications are complete. Without this review, GHD will not be liable for any misunderstanding of our recommendations or their application and adaptation into the final design.


It is important to emphasize that a soil investigation is, in fact, a random sampling of a site and the comments included in this report are based on the results obtained at the test hole locations only. The subsurface conditions confirmed at the test hole locations may vary at other locations. The subsurface conditions can also be significantly modified by the construction activities on site (ex. excavation, dewatering and drainage, blasting, pile driving, etc.). These conditions can also be modified by exposure of soils or bedrock to humidity, dry periods or frost. Soil and groundwater conditions between and beyond the test locations may differ both horizontally and vertically from those encountered at the test locations and conditions may become apparent during construction which could not be detected or anticipated at the time of our assessment. Should any conditions at the site be encountered which differ from those found at the test locations, we request that we be notified immediately in order to permit a reassessment of our recommendations. If changed conditions are identified during construction, no matter how minor, the recommendations in this report shall be considered invalid until sufficient review and written assessment of said conditions by GHD is completed.

Enclosures

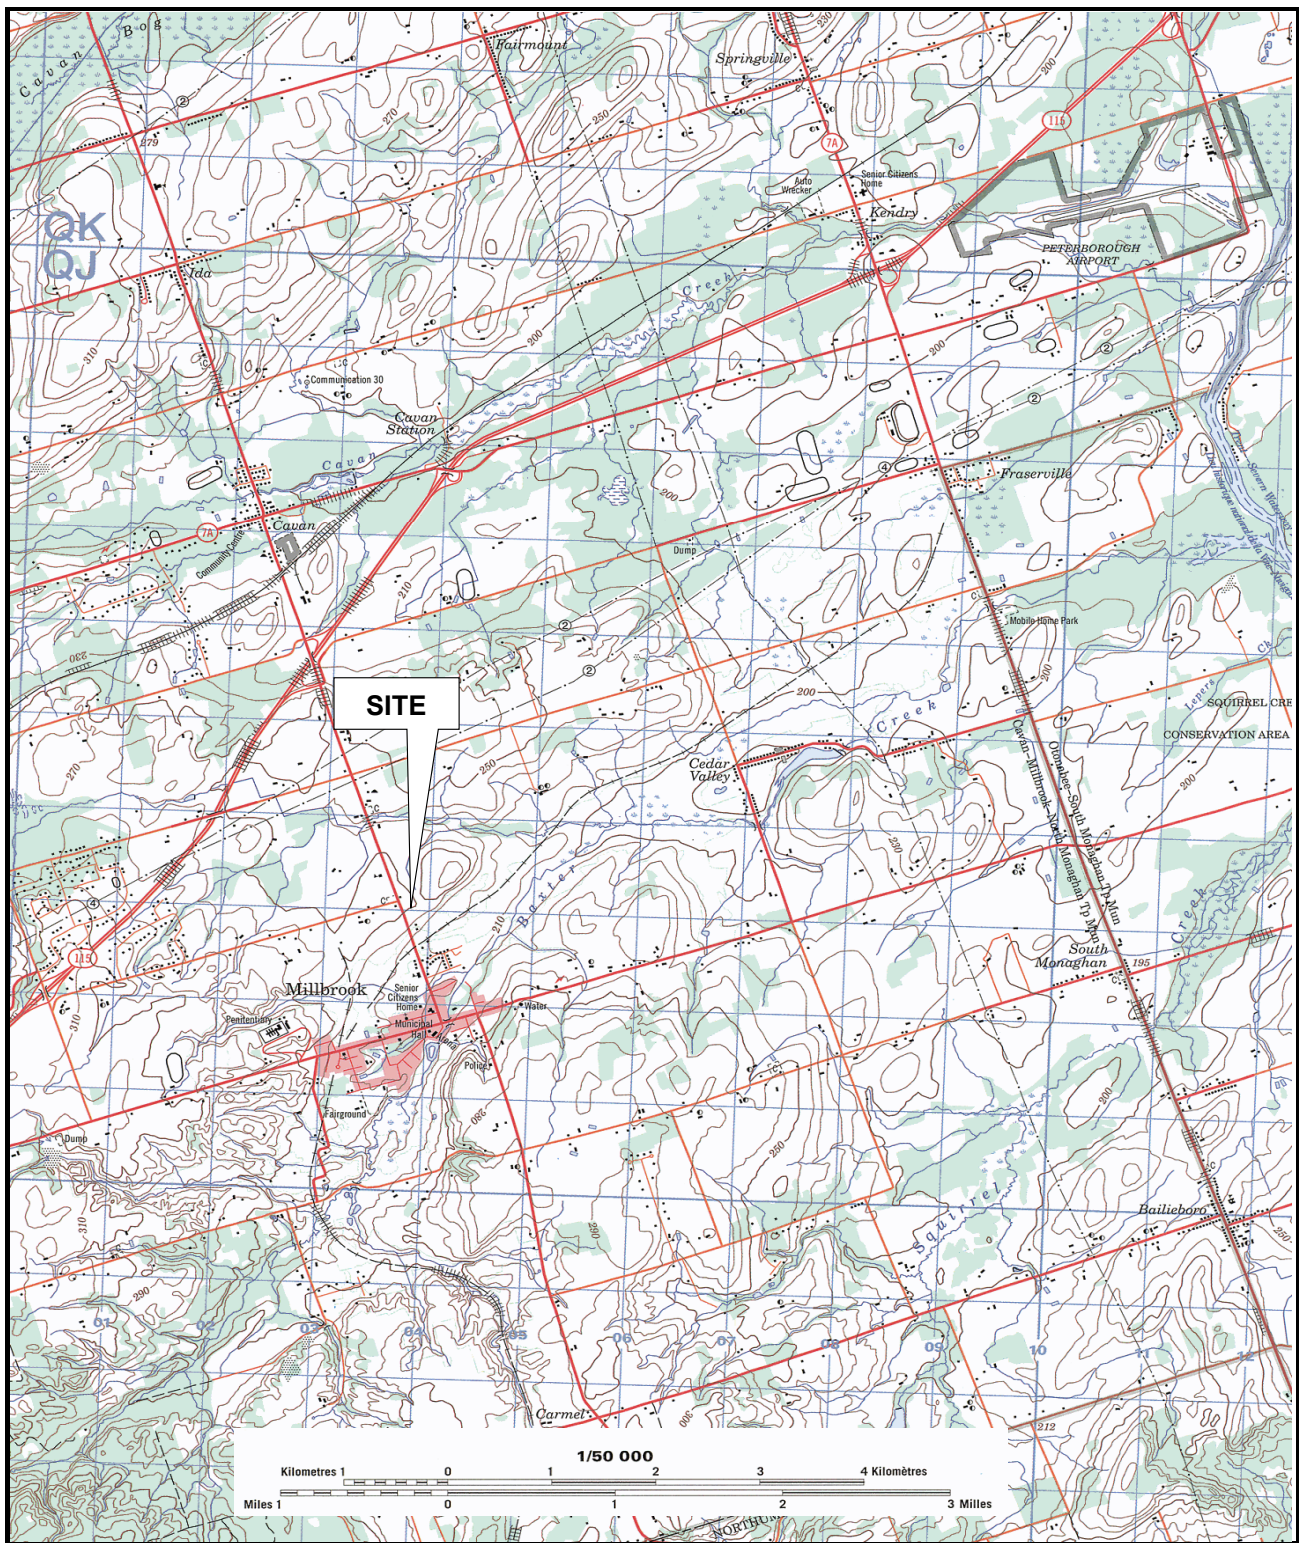


Base map produced by the Canada Centre for Mapping, Natural Resources Canada Map 31D/01. Information current as of 1988. Published 1994.

<p>Scale: Refer To Scale Bar Coordinate System NAD 1983 UTM Zone 17</p>			<p>Vargas Properties Inc. 963 County Road 10 & Part Lot 13, CON 5 Millbrook, Ontario Geotechnical Investigation</p> <p>Vicinity Plan</p>	<p>11209539-01 March, 2021</p> <p>FIGURE 1</p>
--	---	---	---	---

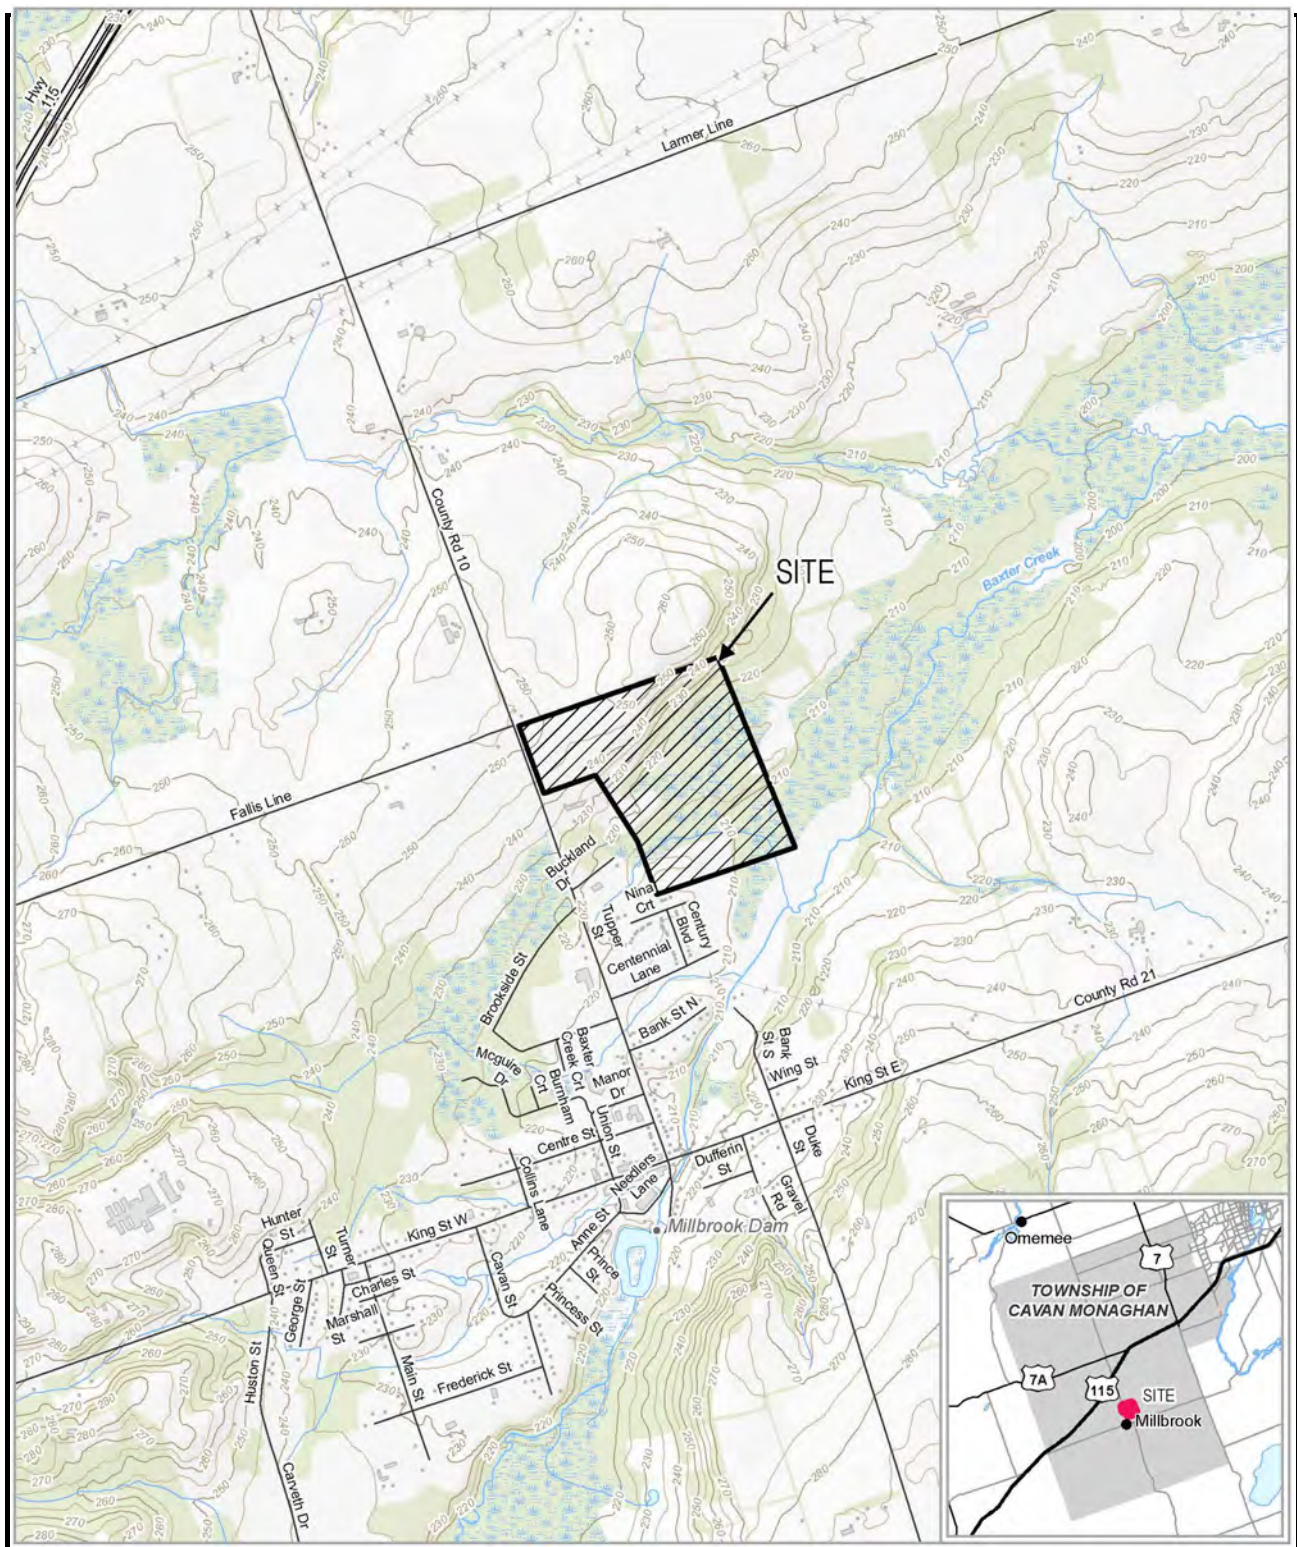

Source: NRVIS, 2018. Produced y GHD under licence from Ontario MNRF, © Queen's Printer 2020.

Scale:



Vargas Properties Inc.

963 County Road 10 & Part Lot 13, CON 5

Millbrook, Ontario

Geotechnical Investigation

11209539-01

March, 2021

Property Plan

FIGURE 2



Scale:
Refer to Scale Bar
Coordinate System:
NAD 1983 UTM Zone 17




Vargas Properties Inc.
963 County Road 10 & Part Lot 13, CON 5
Millbrook, Ontario
Geotechnical Investigation

11209539-01
March, 2021

Site Plan

FIGURE 3

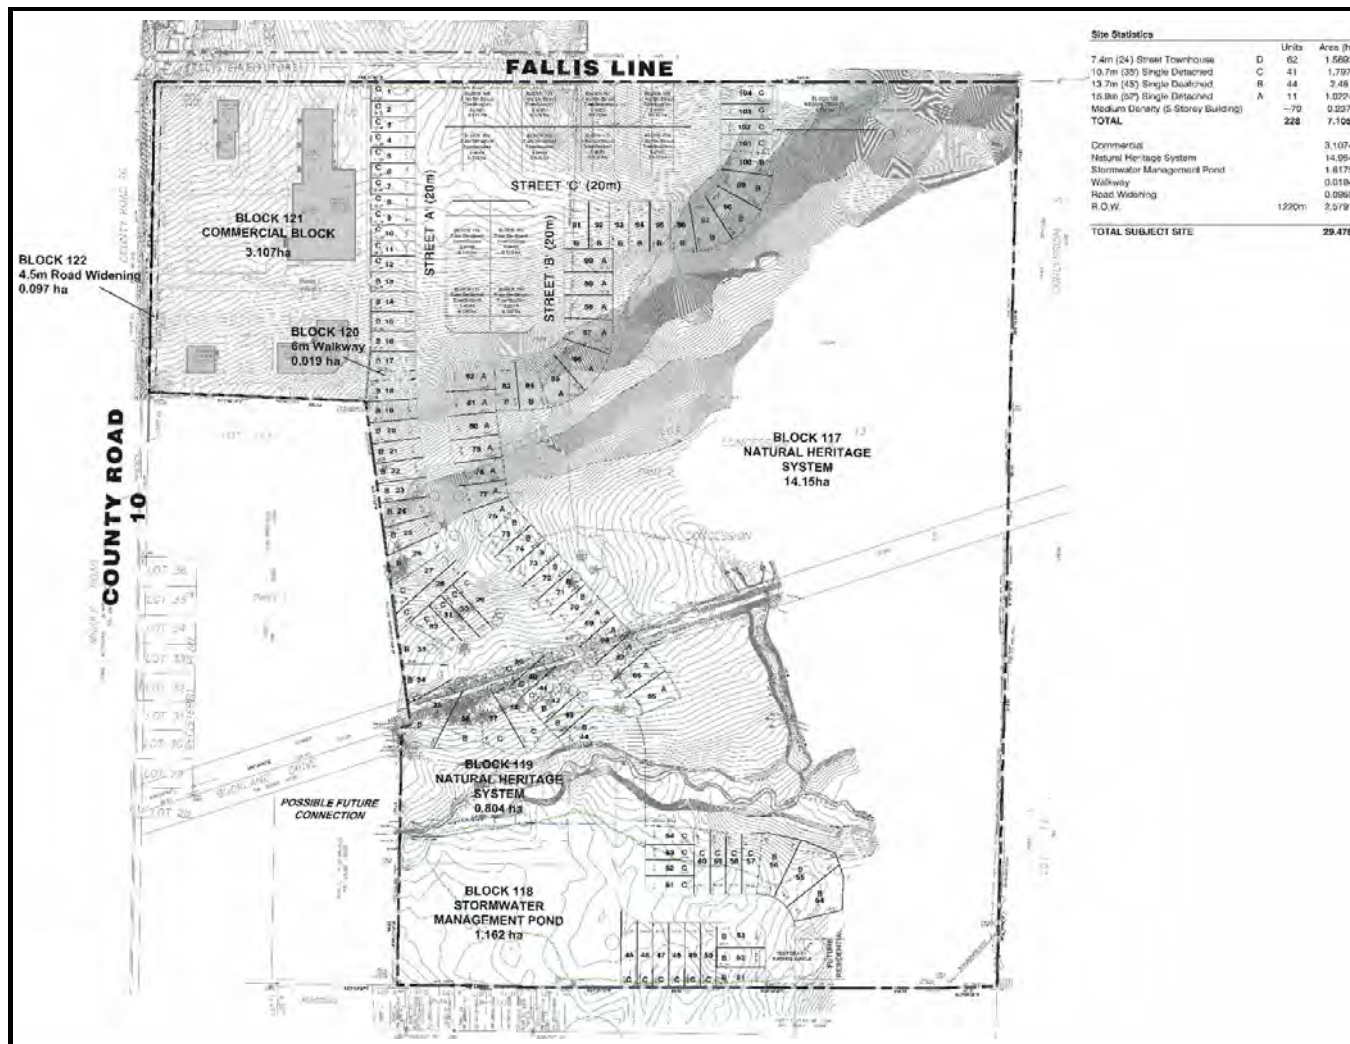

Source: Concept Draft Plan, The Bigieri Group Ltd. drawing no. CDP-01, dated February 8, 2021

Scale:

Not Determined



Vargas Properties Inc.
963 County Road 10 & Part Lot 13, CON 5
Millbrook, Ontario
Geotechnical Investigation

11209539-01
March, 2021

Concept Plan

FIGURE 4



Source: Google Earth 2018, Image taken May 6, 2018. ©2018 Google

Scale:
Refer to Scale Bar
Coordinate System:
NAD 1983 UTM Zone 17



Vargas Properties Inc.
963 County Road 10 & Part Lot 13, CON 5
Millbrook, Ontario
Geotechnical Investigation

11209539-01
June, 2020

Test Hole Plan

FIGURE 5



Source: Google Earth 2018, Image taken May 6, 2018. ©2018 Google. Surface elevations interpreted from topographic map.

Scale:
Refer to Scale Bar
Coordinate System:
NAD 1983 UTM Zone 17




Vargas Properties Inc.
963 County Road 10 & Part Lot 13, CON 5
Millbrook, Ontario
Geotechnical Investigation

11209539-01
June, 2020

Groundwater Elevation Plan

FIGURE 5

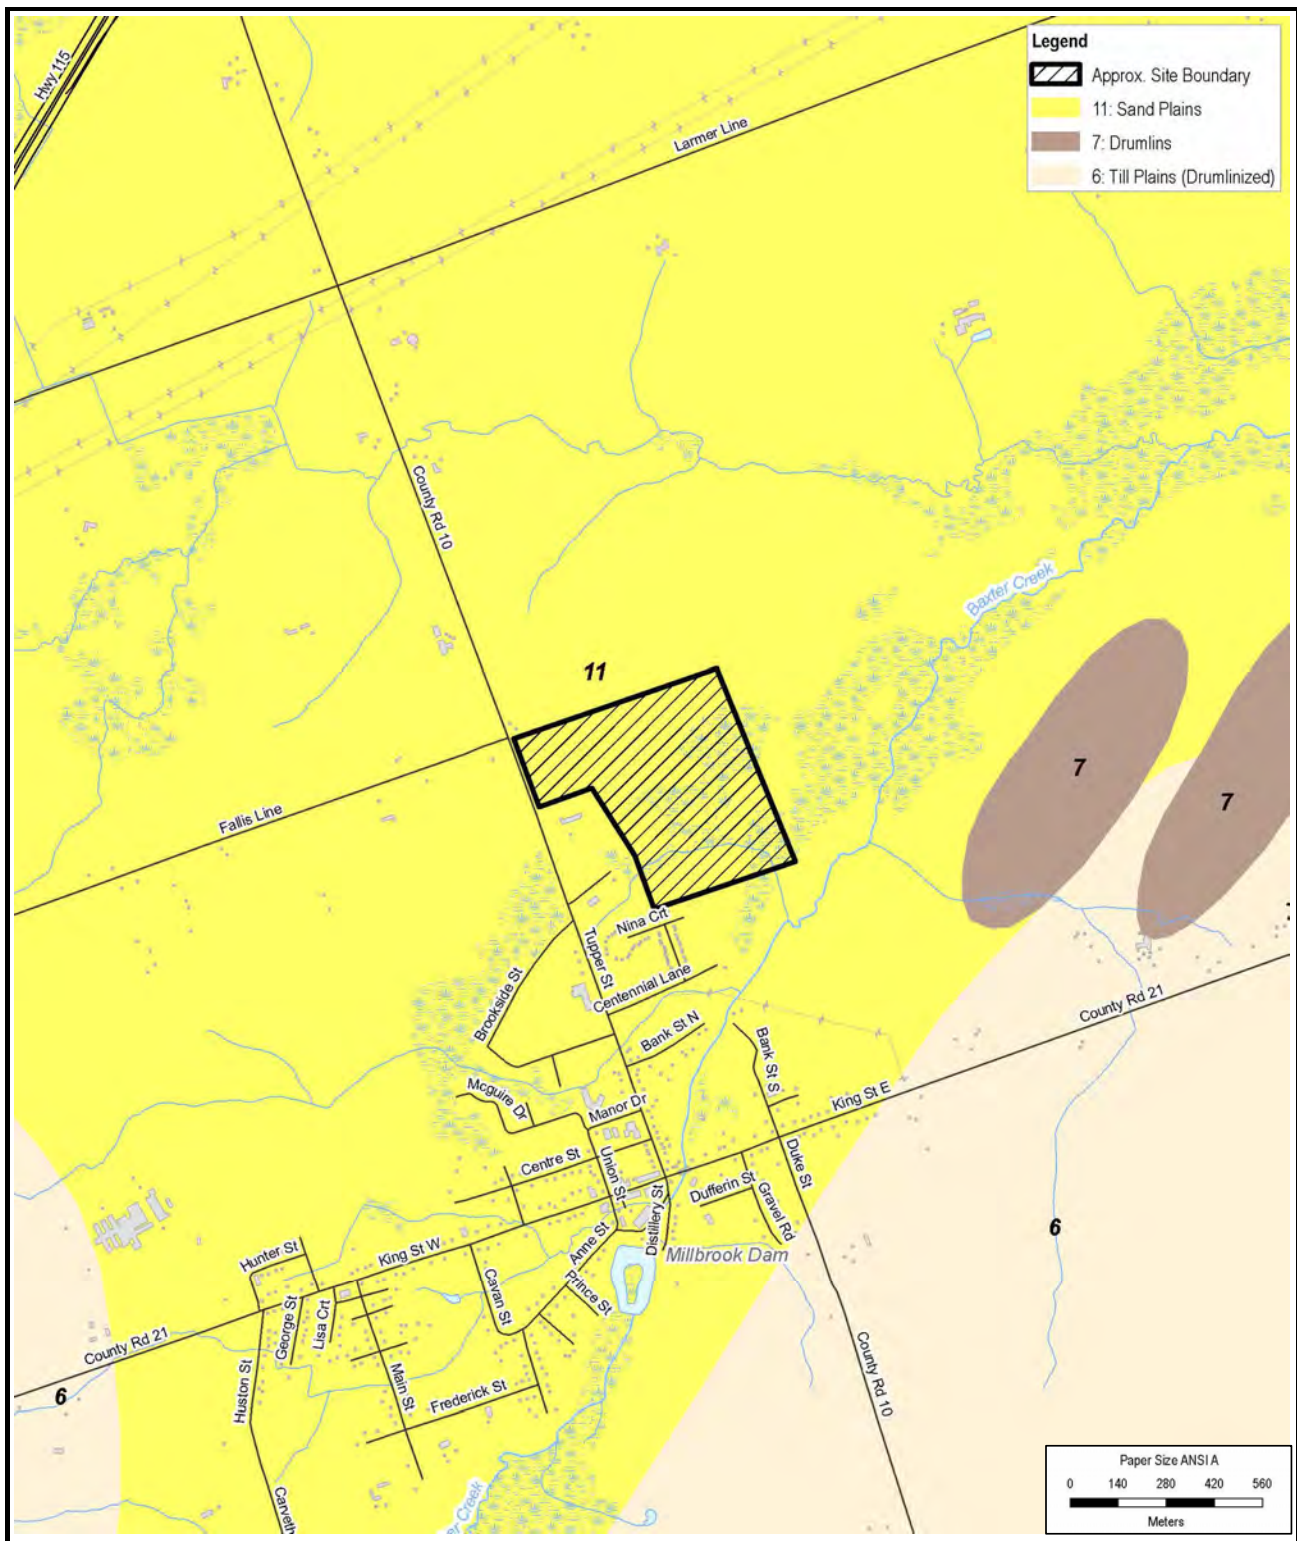

Source: NRVIS, 2018. Produced by GHD under licence from Ontario MNRF, © Queen's Printer 2020. Chapman, L.J. and Putnam, D.I. 2007. Physiography of Southern Ontario, Ontario Geological Survey

Scale:

See Scale Bar



Vargas Properties Inc.

963 County Road 10 & Part Lot 13, CON 5

Millbrook, Ontario


Geotechnical Investigation

11209539-01

March, 2021

Physiography

FIGURE 7

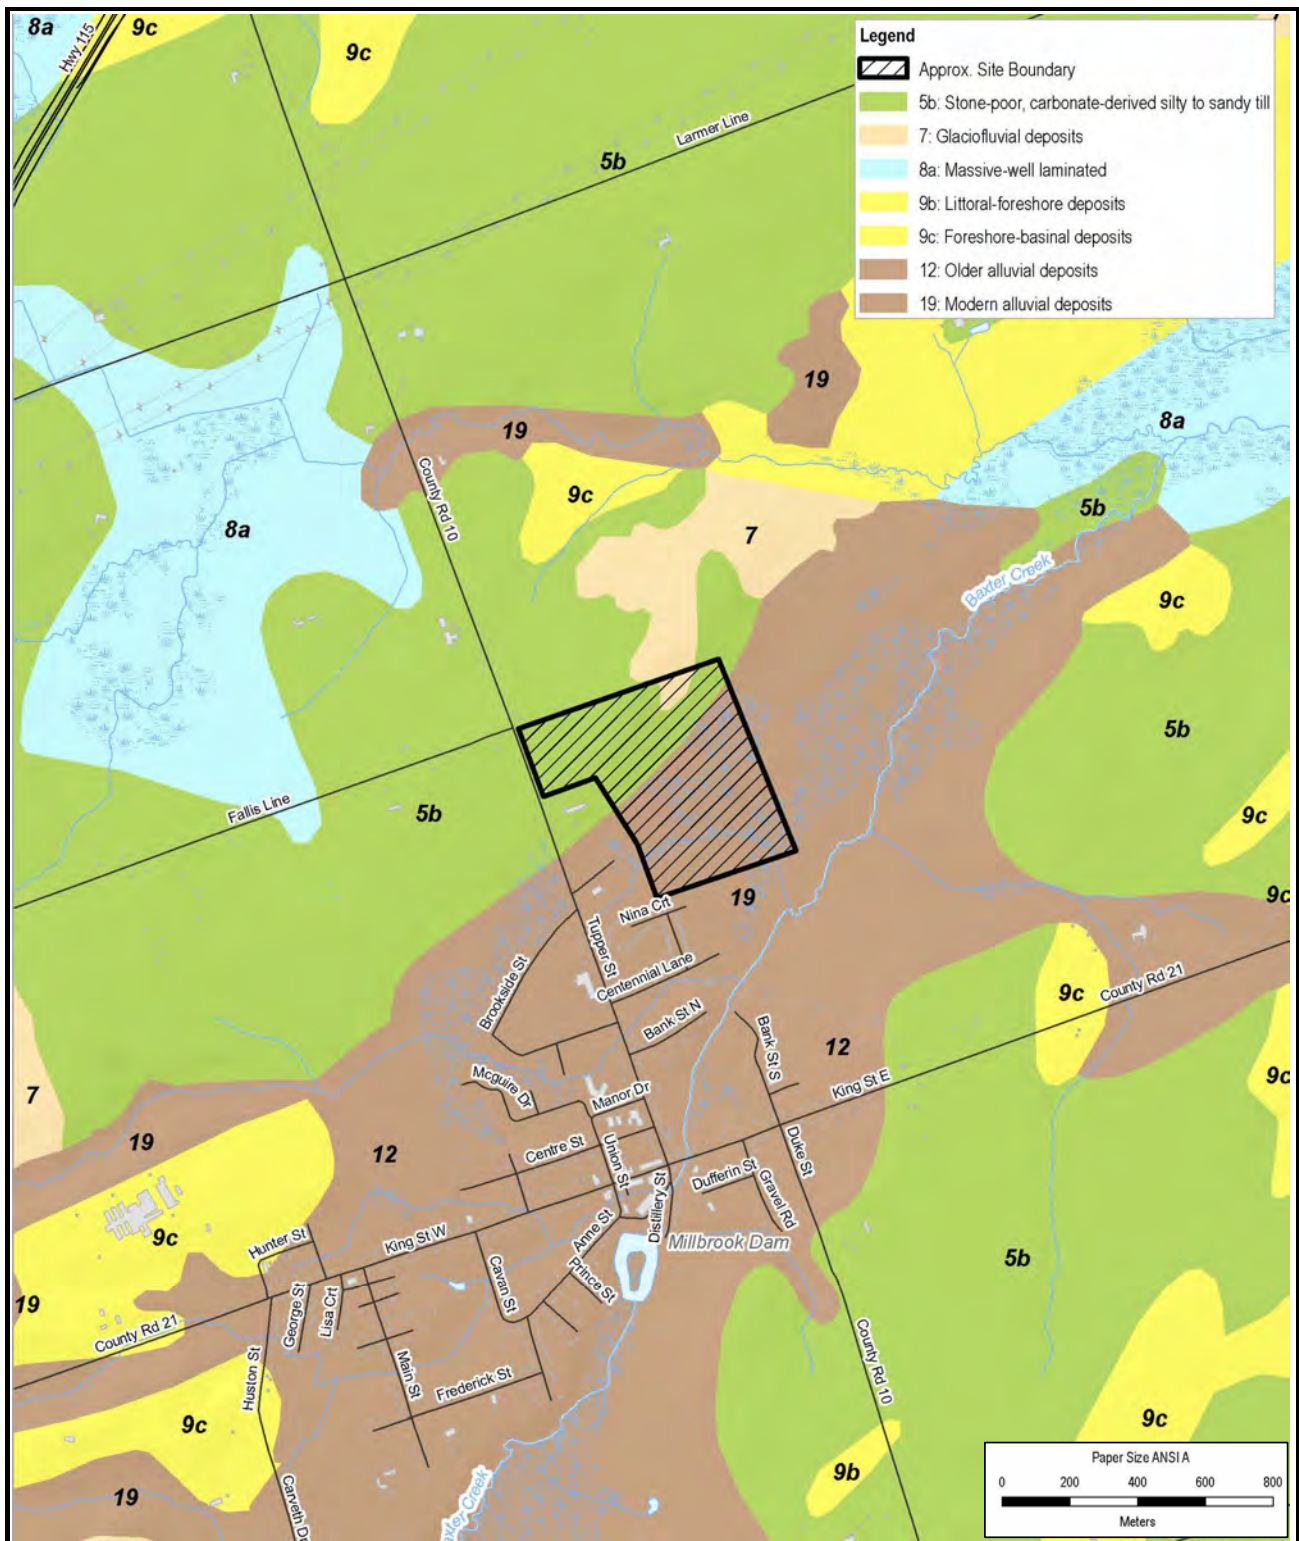

Source: NRVIS, 2018. Produced by GHD under licence from Ontario MNRF, © Queen's Printer 2020. Ontario Geological Survey 2003.

Scale:

See Scale Bar



Vargas Properties Inc.

963 County Road 10 & Part Lot 13, CON 5

Millbrook, Ontario


Geotechnical Investigation

11209539-01

March, 2021

Surficial Geology

FIGURE 8

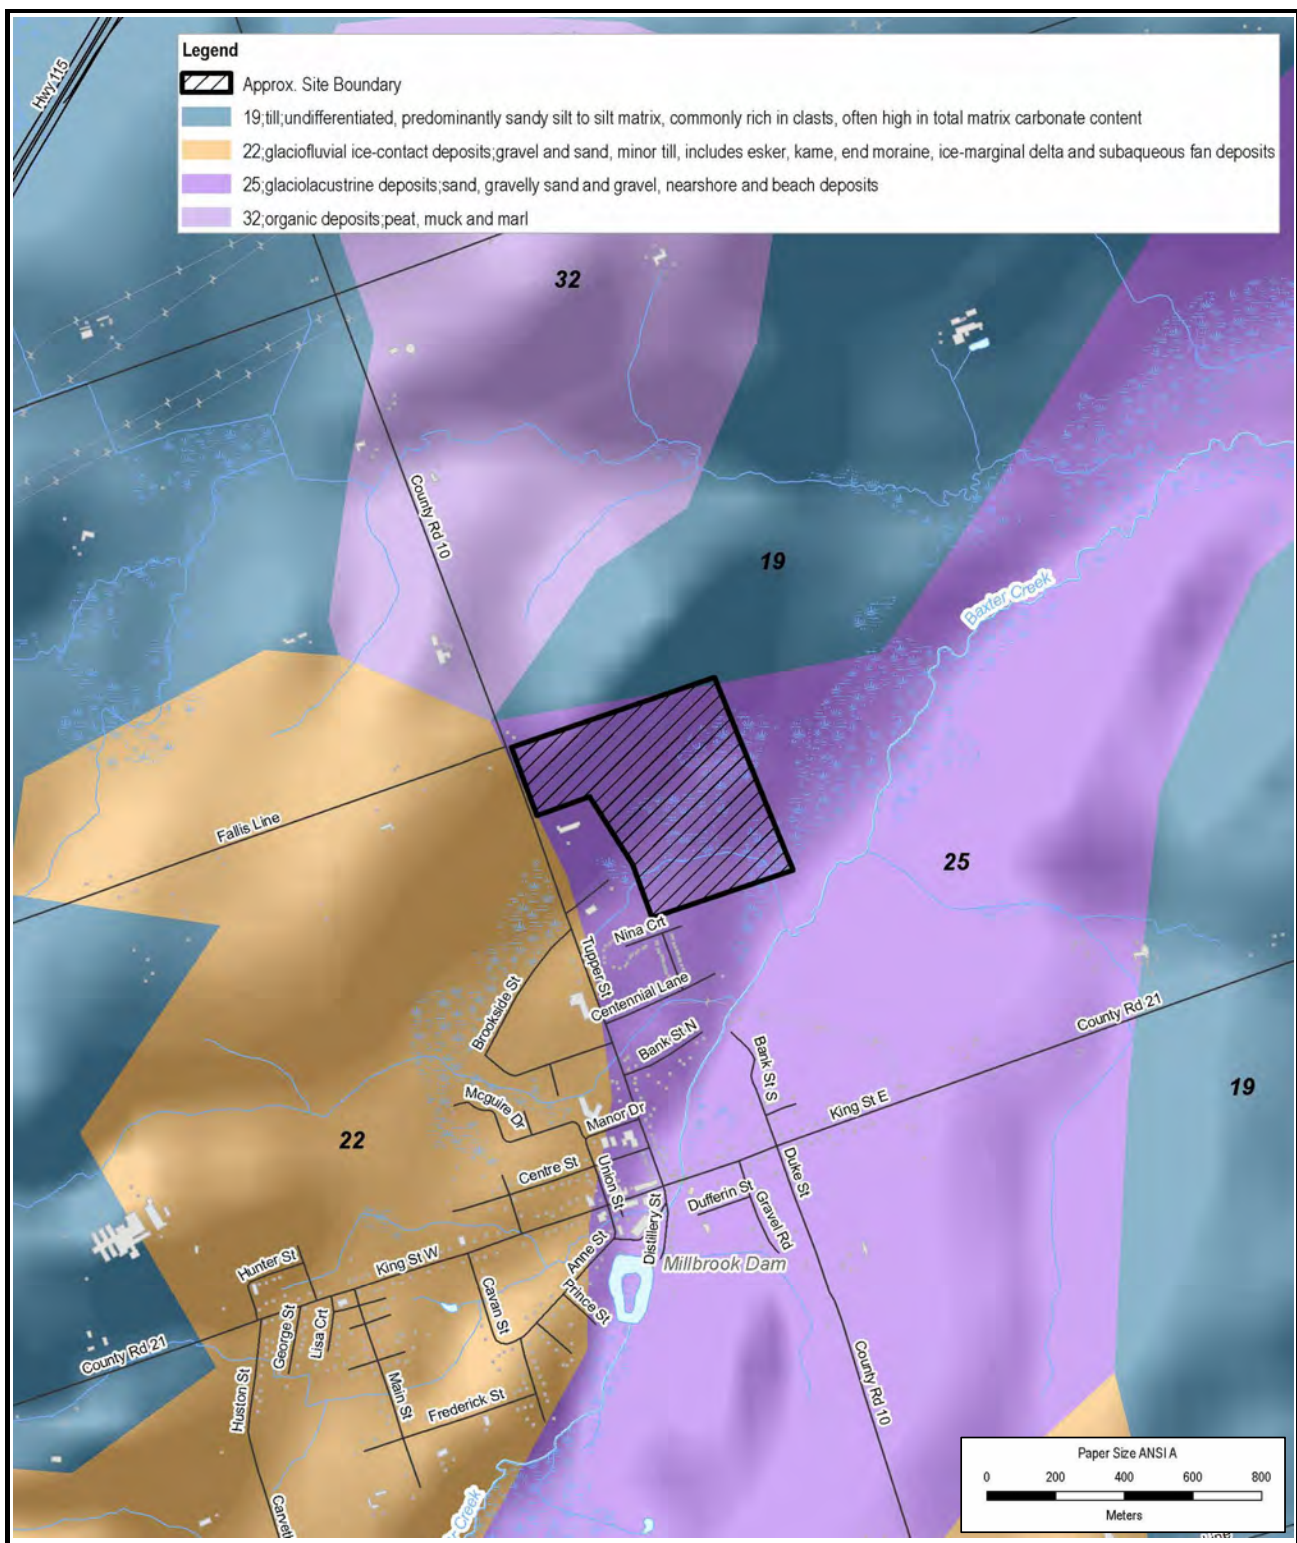

Source: NRVIS, 2018. Produced by GHD under licence from Ontario MNRF, © Queen's Printer 2020.

<p>Scale:</p> <p>See Scale Bar</p>			<p>Vargas Properties Inc. 963 County Road 10 & Part Lot 13, CON 5 Millbrook, Ontario Geotechnical Investigation</p>	<p>11209539-01 March, 2021</p>
---	---	---	---	------------------------------------

Quaternary Geology

FIGURE 9



Source: Ministry of Natural Resources and Forestry, online (www.giscoeapp.lrc.gov.on.ca) © Queen's Printer for Ontario, 2015. Source Water Protection Atlas.

Scale:
 Refer to Scale Bar
 Coordinate System:
 NAD 1983 UTM Zone 17



Vargas Properties Inc.

963 County Road 10 & Part Lot 13, CON 5

Millbrook, Ontario

Geotechnical Investigation

11209539-01

June, 2020

Source Water Protection Plan

FIGURE 10

Appendix A

Soil Exploration Data



BOREHOLE No.: BH-1
ELEVATION: 250.3 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 13 March 2020






DRILLING COMPANY: Strong Soil Search

METHOD: Solid Stem Augers and Spilt Spoons

Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo v4.dwg" dated

NOTES: Jan. 14, 2020

LEGEND

	SS	- SPLIT SPOON
	AS	- AUGER SAMPLE
	ST	- SHELBY TUBE
	CS	- CORE SAMPLE
		- WATER LEVEL

[illegible]

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS) 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW.GPJ GEOLOGIC.GDT 15/6/20



BOREHOLE No.: BH-2

ELEVATION: 248.6 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 13 March 2020

DRILLING COMPANY: Strong Soil Search

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- SS - SPLIT SPOON
 AS - AUGER SAMPLE
 ST - SHELBY TUBE
 CS - CORE SAMPLE
 W - WATER LEVEL

Depth	m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S) Water content (%) Atterberg limits (%) "N" Value (blows / 0.3 m)	Field Lab RQD CONE	COMMENTS
ft	m	0.0	GROUND SURFACE		%	%		N	10 20 30 40 50 60 70 80 90		
			TOPSOIL (300 mm)								
1	0.3		SANDY SILT - Reddish Brown Sandy Silt, Moist to Wet, Loose	SS-1A	71	27	1				
2	0.5			SS-1B		26	2	4			
3	1.0		TILL - Light Brown Clayey Silt, Trace Sand, Moist to Wet, Compact	SS-2	78	22	6	25			
4							10				
5	1.5		With Gravel, Moist				15				
6	2.0			SS-3	100	10	5	15			
7							7				
8				SS-4	72	8	8	22			
9							14				
10	3.0		Light Brown Silty Sand with Gravel, Trace Clay, Moist, Very Dense	SS-5	44	10	20	75			
11							41				
12							34				
13	4.0										
14											
15				SS-6	94	7	12	61			
16	5.0						28				
17							33				
18											
19											
20	6.0		Grey, Dense	SS-7	78		8	45			
21	6.1						17				
22	6.6		END OF BOREHOLE				28				
23	7.0										
24											
25											
26	8.0										
27											

WL - 2.3 m
 immediately after
 drilling
 First encounter of
 groundwater
 seepage at 2.4 m

Borehole Caving to
 5.3 m at
 completion on
 drilling

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS), 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW, GP, J. GEOLOGIC.GDT 15/6/20



BOREHOLE No.: BH-3

ELEVATION: 246.5 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: E. Wierdsma

DATE: 15 April 2020

DRILLING COMPANY: Landshark Drilling

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- ☒ SS - SPLIT SPOON
☒ AS - AUGER SAMPLE
☒ ST - SHELBY TUBE
☒ CS - CORE SAMPLE
 - WATER LEVEL

Depth	m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S) Water content (%) Atterberg limits (%) "N" Value (blows / 0.3 m)	Field Lab RQD CONE	COMMENTS
ft	m	0.0	GROUND SURFACE		%	%		N	10 20 30 40 50 60 70 80 90		
			TOPSOIL (300 mm)				1				
1	0.3		SANDY SILT - Brown Sandy Silt, Moist, Loose	SS-1	40	7	2	5	X		
2							3				
3	1.0	1.1	TILL - Light Brown Sandy Silt with Clay and Gravel, Moist, Compact	SS-2	100	31	4	13	X	O	
4							6				
5							7				
6	2.0			SS-3	50	12	4	18	O	X	
7							7				
8							11				
9				SS-4	100	12	6	25	O	X	
10	3.0	3.0	Dense				11				
11				SS-5	100	10	3	48	O	X	
12	3.7	3.7	Cobble (Inferred From Augers Grinding)				18				
13							30				
14	4.0						22				
15	4.6	4.6	Very Dense	SS-6	100	8	50=4"	100+	O		X
16	5.0										
17											
18											
19											
20	6.0			SS-7	100	11	26	50	O	X	
21	6.4	6.4	Wet				24				
22	6.6	6.6	END OF BOREHOLE				26				
23	7.0										
24											
25											
26	8.0										
27											

Grain Size Data
 SS-4:
 13% Gravel
 29% Sand
 58% Silt and
 Clay-sized
 Particles
 33% Between 5-75
 um

End of borehole
 open and dry upon
 completion of
 drilling

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS) 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW, GP, GEOLOGIC.GDT 15/6/20



BOREHOLE No.: BH-4

ELEVATION: 244.2 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 13 March 2020






DRILLING COMPANY: Strong Soil Search

METHOD: Solid Stem Augers and Spilt Spoons

Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo v4.dwg" dated

NOTES: Jan. 14, 2020

LEGEND

	SS	- SPLIT SPOON
	AS	- AUGER SAMPLE
	ST	- SHELBY TUBE
	CS	- CORE SAMPLE
		- WATER LEVEL

▼ - WATER LEVEL

[illegible]

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS) 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW.GPJ GEOLOGIC.GDT 15/6/20



BOREHOLE No.: BH-5
ELEVATION: 253.6 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 12 March 2020

DRILLING COMPANY: Strong Soil Search

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- SS - SPLIT SPOON
- AS - AUGER SAMPLE
- ST - SHELBY TUBE
- CS - CORE SAMPLE
- WATER LEVEL

Depth	m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S) Water content (%) Atterberg limits (%) "N" Value (blows / 0.3 m)	Field Lab RQD CONE	COMMENTS
ft	m	0.0	GROUND SURFACE		%	%		N	10 20 30 40 50 60 70 80 90		
		0.3	TOPSOIL (300 mm)				1				
1			SANDY SILT - Reddish Brown Sandy Silt, Trace Clay, Moist to Wet, Loose	SS-1	42	17	2	6	X		
2							4				
3							7				
4	1.0	0.8	TILL - Light Brown Silty Sand With Gravel, Trace Clay, Moist to Wet, Loose to Compact	SS-2	50	14	2	11	X		
5							6				
6							5				
7	2.0			SS-3	100	15	3	5	X		
8							2				
9			- Reddish Brown 75mm Sand Seam at 2.6m	SS-4	78	13	8	20			
10	3.0	3.0	Moist, Very Dense	SS-5	72	9	8				
11							16	65			
12							29				
13							36				
14	4.0										
15				SS-6	100	6	20	64			
16							30				
17	5.0						32				
18											
19											
20	6.0			SS-7	100	8	26	64			
21							30				
22		6.6	END OF BOREHOLE				38				
23	7.0										
24											
25											
26	8.0										
27											

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS) 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW, GP, GEOLOGIC.GDT 15/6/20

Borehole remained open and dry throughout drilling activities



BOREHOLE No.: BH-6

ELEVATION: 247.1 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 13 March 2020

DRILLING COMPANY: Strong Soil Search

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- ☒ SS - SPLIT SPOON
☒ AS - AUGER SAMPLE
☒ ST - SHELBY TUBE
☒ CS - CORE SAMPLE
 - WATER LEVEL

Depth	m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S) Water content (%) Atterberg limits (%) "N" Value (blows / 0.3 m)	Field Lab RQD CONE	COMMENTS
ft	m	0.0	GROUND SURFACE		%	%		N	10 20 30 40 50 60 70 80 90		
		0.3	TOPSOIL (300 mm)				3				
1	0.3		SANDY SILT - Reddish Brown Sandy Silt, Trace Clay, Moist to Wet, Loose	SS-1	67	22	4	8	X		
2	0.6						4				
3	0.9		TILL - Light Brown Silty Sand with Gravel, Trace Clay, Moist to Wet, Compact / Moist	SS-2	100	9	3	20			
4	1.0						9				
5							11				
6	2.0			SS-3	72	10	13	26			
7							14				
8				SS-4	94	7	4	25			
9							10				
10	3.0		Very Dense	SS-5	100	4	11	100+			
11							30				
12							50=4"				
13	4.0										
14											
15				SS-6	100	5	45	100+			
16	5.0						50=4"				
17											
18											
19											
20	6.0			SS-7	100	5	12	52			
21							19				
22	6.6		END OF BOREHOLE				33				
23	7.0										
24											
25											
26	8.0										
27											

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS) 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW, GP, J. GEOLOGIC.GDT 15/6/20

Borehole remained open and dry throughout drilling activities



BOREHOLE No.: BH-7

ELEVATION: 238.8 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 12 March 2020

DRILLING COMPANY: Strong Soil Search

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- [X] SS - SPLIT SPOON
 [Hatched] AS - AUGER SAMPLE
 [Diagonal Lines] ST - SHELBY TUBE
 [I] CS - CORE SAMPLE
 [Down Arrow] - WATER LEVEL

Depth		m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S)											COMMENTS		
ft	m									Water content (%) Atterberg limits (%)													
										w _p w _L "N" Value (blows / 0.3 m)											RQD CONE		
										△ Field □ Lab											- 0.79 m - 0.78 m		
GROUND SURFACE										10 20 30 40 50 60 70 80 90													
				TOPSOIL (300 mm)				1													Grain Size Data SS-1: 4% Gravel 33% Sand 63% Silt and Clay-sized Particles 48% Between 5-75 um		
1	0.3		SANDY SILT - Reddish Brown Sandy Silt, Trace Clay, Moist to Wet, Soft	SS-1	58	18	2	3	×	○													
2	0.6						3																
3	1.0						7	18		○	×												
4			TILL - Light Brown Silty Sand With Gravel, Trace Clay, Moist to Wet, Compact	SS-2	100	12	11															Shallow piezometer installed to 1.5 m. Piezometer measured dry on 05/19/2020	
5	1.5		Clayey	SS-3	100	15	2	10		×	○												
6	2.0					4																	
7						6																	
8	2.6		Trace Clay, Moist, Very Dense	SS-4A		10	6	50		○												WL - Dry 05/19/2020 and 03/19/2020	
9				SS-4B	100	4	16			○													
10	3.0						34																
11				SS-5	83	6	12	64		○				×						Borehole remained open and dry throughout drilling activities			
12																							
13	4.0																						
14																							
15				SS-6	100	8	18	100+															
16	5.0						42																
17							50=4"																
18																							
19																							
20	6.0			SS-7	100	10	28	100+		○													
21	6.3		END OF BOREHOLE							50=3"													
22																							
23	7.0																						
24																							
25																							
26	8.0																						
27																							

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS) 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW, GP, J, GEOLOGIC.GDT 15/6/20



BOREHOLE No.: BH-8

ELEVATION: 231.0 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: E. Wierdsma

DATE: 15 April 2020

DRILLING COMPANY: Landshark Drilling

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- ☒ SS - SPLIT SPOON
☒ AS - AUGER SAMPLE
☒ ST - SHELBY TUBE
☒ CS - CORE SAMPLE
 - WATER LEVEL

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS) 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW, GP, GEOLOGIC.GDT 15/6/20

Depth	m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S) Water content (%) Atterberg limits (%) "N" Value (blows / 0.3 m)	Field Lab RQD CONE	COMMENTS
ft	m				%	%		N	10 20 30 40 50 60 70 80 90		
	0.0		GROUND SURFACE								
	0.3		TOPSOIL (300 mm)				1				
1	0.3		SANDY SILT - Brown Sandy Silt, Moist, Very Loose	SS-1	25	33	1	2	X		
2							1				
3	0.8		TILL - Light Brown Sandy Silt With Clay and Gravel, Moist, Loose	SS-2	60	10	2				
4	1.2		Cobble (Inferred From Augers Grinding)				3				
5	1.5		Clayey Silt with Sand and Gravel, Mottled, Moist, Compact to Dense	SS-3	50	13	5	8	X		
6							7				
7	2.0						4				
8							20	39			
9	2.6		Grey	SS-4	60	9	19				
10	3.0		Wet				3				
11							3				
12				SS-5	60	11	7	34			
13							10				
14							24				
15	4.6		Grey Sandy Silt with Clay and Gravel, Moist, Dense	SS-6	50	9	10				
16							19	31			
17	5.0						17				
18							19				
19											
20	6.0			SS-7	50	9	14				
21							16				
22	6.7		END OF BOREHOLE				22	38			
23							10				
24	7.0										
25											
26	8.0										
27											

First encounter of groundwater seepage at 3.0 m Water up to 3.4 m upon completion

Borehole cave-in up to 4.3 m upon completion



BOREHOLE No.: BH-9
ELEVATION: 218.4 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: E. Wierdsma

DATE: 15 April 2020

DRILLING COMPANY: Landshark Drilling

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- ☒ SS - SPLIT SPOON
☒ AS - AUGER SAMPLE
☒ ST - SHELBY TUBE
☒ CS - CORE SAMPLE
 - WATER LEVEL

Depth	m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S) Water content (%) Atterberg limits (%) "N" Value (blows / 0.3 m)	Field Lab RQD CONE	COMMENTS
ft	m				%	%		N	10 20 30 40 50 60 70 80 90		
	0.0		GROUND SURFACE								
	0.2		TOPSOIL (150 mm)				1				
1			SANDY SILT - Light Brown Sandy Silt With Clay, Mottled, Wet, Loose	SS-1	60	19	1 3 3	4	X	O	
2							2				
3	1.0			SS-2	60	19	3 2 4	5	X	O	
4							2				
5							2				
6	1.7		SILTY CLAY - Brown Silty Clay, trace Sand, Mottled, Moist, Soft to Firm	SS-3	60	28	2 2 3 3	5	X	O	
7	2.0						1				
8				SS-4	100	39	1 1 2 2	3	X	O	
9							1				
10	3.0		Brown Silty Clay with Sand, Wet, Very Soft	SS-5	100	36	1 1 1 1	2	X	O	
11							1				
12							1				
13	4.0						1				
14							0				
15	4.6		Grey	SS-6	100	42	1 0 1 1	1	X	O	
16	5.0						1				
17							1				
18							1				
19							3				
20	6.0		Soft	SS-7	100	21	1 1 3 2	4	X	O	
21							2				
22											
23	7.0										
24											
25	7.6		TILL - Grey Sandy Silt, With Gravel, Trace Clay, Moist, Dense	SS-8	90	14	5 13 16 31	29	O	X	
26	8.0										
27	8.2		END OF BOREHOLE								

Water up to 2.4 m upon completion
 First encounter of groundwater seepage at 3.0 m
Grain Size Data
 SS-5:
 2% Gravel
 8% Sand
 90% Silt and Clay-sized Particles
 23% Between 5-75 um
Atterberg Limits
 LL = 40%
 PI = 22%

Borehole cave-in up to 5.8 m upon completion



BOREHOLE No.: BH-10

ELEVATION: 216.2 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: E. Wierdsma

DATE: 15 April 2020

DRILLING COMPANY: Landshark Drilling

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- ☒ SS - SPLIT SPOON
☒ AS - AUGER SAMPLE
☒ ST - SHELBY TUBE
☒ CS - CORE SAMPLE
 - WATER LEVEL

Depth	m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S) Water content (%) Atterberg limits (%) "N" Value (blows / 0.3 m)	Field Lab RQD CONE	COMMENTS
ft	m				%	%		N	10 20 30 40 50 60 70 80 90		
	0.0		GROUND SURFACE								
	0.2		TOPSOIL (150 mm)								
1			SANDY SILT - Brown Sandy Silt, Moist, Very Loose	SS-1	50	29	1	2	X		
2							1				
3			Loose				2				
4	1.0			SS-2	25	36	3	7	X		
5							4				
6			SILTY CLAY - Brown Silty Clay, trace Sand, Moist, Stiff	SS-3	75	22	2				
7	2.0						5				
8			Very Stiff				8	13	X		
9				SS-4	30	27	9				
10							8	17	X		
11	3.0		Stiff				9				
12				SS-5	100	25	4	9	X		
13							5				
14	4.0		Wet				4				
15							4				
16			Grey, Very Soft				1				
17	5.0			SS-6	100	26	1	2	X		
18							1				
19							1				
20							1				
21	6.0		Hard				6				
22				SS-7	25	22	10	34			
23							24				
24							19				
25											
26	8.0										
27			END OF BOREHOLE								

Grain Size Data

SS-3:
 0% Gravel
 9% Sand
 91% Silt and Clay-sized Particles
 33% Between 5-75 um

Water up to 3.5 m upon completion

First encounter of groundwater seepage at 4.0 m

Borehole cave-in up to 4.6 m upon completion



BOREHOLE No.: BH-11

ELEVATION: 214.2 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: E. Wierdsma

DATE: 16 April 2020

DRILLING COMPANY: Landshark Drilling

METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- [X] SS - SPLIT SPOON
 [I] AS - AUGER SAMPLE
 [Z] ST - SHELBY TUBE
 [I] CS - CORE SAMPLE
 [V] - WATER LEVEL

Depth	m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S) Water content (%) Atterberg limits (%) "N" Value (blows / 0.3 m)	Field Lab RQD CONE	COMMENTS
ft	m	0.0	GROUND SURFACE		%	%		N	10 20 30 40 50 60 70 80 90		
			TOPSOIL (300 mm)				0				
1	0.3		SILTY SAND - Brown Silty Sand, Moist, Very Loose	SS-1	60	25	1	3	X	○	
2	0.5		SILTY CLAY - Light Brown Silty Clay, Trace Sand, Moist, Soft				1				
3	1.0			SS-2	75	25	1	4	X	○	
4							3				
5	1.5		Cobble (Inferred From Augers Grinding), Stiff				6				
6	1.8		Wet	SS-3	90	21	6	14	X	○	First encounter of groundwater seepage at 1.8 m
7	2.0						6				
8	2.3		Firm				8				
9				SS-4	100	23	4	8	X	○	Water up to 2.4 m upon completion
10	3.0		Stiff				4				
11				SS-5	100	27	2	13	X	○	
12	3.5		SILTY SAND - Light Brown Silty Sand, Wet, Compact				2				
13							11				
14	4.0						12				Borehole cave-in up to 4.0 m upon completion
15				SS-6A		19	3		○		Grain Size Data
16	4.9		SILTY CLAY - Light Brown Silty Clay, trace Sand, Moist, Stiff	SS-6B	100	20	2	10	○		SS-6A:
17	5.0						8				0% Gravel
18							5				91% Sand
19											9% Silt and Clay-sized Particles
20	6.0		Grey				6				
21	6.1			SS-7	50	19	6	16	X	○	
22	6.7		END OF BOREHOLE				10				
23	7.0						9				
24											
25											
26	8.0										
27											

BOREHOLE LOG GEOTECH (MULTIPLE DRILLERS), 11209539-01-DWG-20-06-01, VARGAS BOREHOLE LOGS, JM, EW, GP, GEOLOGIC.GDT 15/6/20



BOREHOLE No.: BH-13
ELEVATION: 213.8 m

BOREHOLE REPORT

Page: 1 of 1

CLIENT: Vargas Properties






PROJECT: Proposed Residential and Commercial Development

LOGGED BY: E. Wierdsma DATE: 16 April 2020

DRILLING COMPANY: Landshark Drilling METHOD: Solid Stem Augers and Spilt Spoons

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

LEGEND

- | | | |
|---|----|----------------|
|  | SS | - SPLIT SPOON |
|  | AS | - AUGER SAMPLE |
|  | ST | - SHELBY TUBE |
|  | CS | - CORE SAMPLE |
|  | | - WATER LEVEL |

Depth		m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Recovery	Moisture Content	Blows per 6 in. / 15 cm	Penetration Index	Shear test (Cu) Sensitivity (S)	w _p , w _L	Water content (%) Atterberg limits (%)	RQD CONE	COMMENTS
ft	m	0.0		GROUND SURFACE		%	%	N	10 20 30 40 50 60 70 80 90	X "N" Value (blows / 0.3 m)	O Water content (%), Δ Field Lab			
			[Pattern]	TOPSOIL (300 mm)				1						
1	0.3		[Pattern]	SANDY SILT - Brown Sandy Silt With Clay, Moist, Loose	SS-1	60	23	2	3	x o				
2			[Pattern]	Mottled				2						
3	0.8		[Pattern]					1						
4	1.0		[Pattern]		SS-2	90	24	3	9	x o				
5			[Pattern]					6						
6	1.5		[Pattern]	SILT CLAY - Light Brown Silty Clay, Trace Sand, Moist, Stiff	SS-3	100	26	2						
7	2.0		[Pattern]					4						
8			[Pattern]		SS-4A		27	3						
9	2.7		[Pattern]	SILT SAND - Light Brown Silty Sand, Trace Clay, Wet, Compact	SS-4B	100	18	3	8					
10	3.0		[Pattern]					5						
11			[Pattern]		SS-5	90	21	6						
12			[Pattern]					8						
13	4.0		[Pattern]					11	21	x x				
14			[Pattern]					10						
15	4.6		[Pattern]	SAND & GRAVEL - Brown Sand and Gravel, Wet, Compact	SS-6	100	18	7						
16	5.0		[Pattern]					2						
17			[Pattern]					8		*	* o			
18			[Pattern]					6						
19			[Pattern]											
20	6.0		[Pattern]											
21	6.1		[Pattern]	SILT CLAY - Grey Silty Clay, Moist, Stiff	SS-7	75	21	3	9	x o				
22	6.7		[Pattern]	END OF BOREHOLE				3						
23	7.0							6						
24														
25														
26	8.0													
27														

WL - 2.4 m
5/22/2020

First encounter of groundwater seepage at 2.7 m

50mm diameter monitoring well installed to 6.1m



TEST PIT No.: TP-1

ELEVATION: 247.8 m

TEST PIT REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 6 March 2020

LEGEND

☐ GS - GRAB SAMPLE
☒ - WATER LEVEL

EXCAVATION COMPANY: Balterre Contracting Limited METHOD: Track Excavator

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

Depth		m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Moisture Content	Shear test (Cu) △ Field Sensitivity (S) □ Lab ○ Water content (%) H _p H _l Atterberg limits (%)											COMMENTS
ft	m						10	20	30	40	50	60	70	80	90			
		0.0		GROUND SURFACE		%												
		0.2		TOPSOIL (150 mm)														
1		0.3		SANDY SILT - Reddish Brown Sandy Silt, Loose, Moist Occasional Cobbles	AS-1	28			○								No seepage observed during the excavation of the test pit	
	0.5	0.6		TILL - Light Brown Silty Sand and Gravel, Compact, Moist	AS-2	5	○											
2		0.9		Boulders														
3	1.0																	
4																		
5	1.5																	
6		1.8		Light Brown Clayey Silt, Trace Gravel, Cobbles and Boulders, Dense, Moist	AS-3	19			○									
7	2.0																	
8	2.5																	
9																		
10	3.0																	
11																		
	3.5	3.5		END OF TEST PIT	AS-4	22			○									
12																		
13	4.0																	

No seepage observed during the excavation of the test pit



TEST PIT No.: TP-2

ELEVATION: 243.0 m

TEST PIT REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 6 March 2020

LEGEND

☐ GS - GRAB SAMPLE
☒ - WATER LEVEL

EXCAVATION COMPANY: Balterre Contracting Limited METHOD: Track Excavator

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

Depth		m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Moisture Content	Shear test (Cu)		Sensitivity (S)		Water content (%)		Atterberg limits (%)		COMMENTS	
ft	m						w _p	w _L	△	□	○	□	□	□		
		0.0		GROUND SURFACE		%	10	20	30	40	50	60	70	80	90	
				TOPSOIL (200 mm)												
1		0.2		TILL - Light Brown Silty Sand and Gravel, Cobbles, Compact, Moist	AS-1	2	○									No seepage observed during the excavation of the test pit
2	0.5															
		0.8		Boulders	AS-2	9	○									
3	1.0															
4																
5	1.5															
6																
7	2.0															
8					AS-3	10	○									
9	2.5															
10	3.0															
11		3.4		Very Dense	AS-4	8	○									
	3.5	3.5		END OF TEST PIT												
12																
13	4.0															



TEST PIT No.: TP-3

ELEVATION: 223.2 m

TEST PIT REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern




DATE: 6 March 2020

LEGEND

☐ GS - GRAB SAMPLE
☒ - WATER LEVEL

EXCAVATION COMPANY: Balterre Contracting Limited METHOD: Track Excavator

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

Depth		m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Moisture Content	Shear test (Cu) △ Field Sensitivity (S) □ Lab ○ Water content (%) H _p H _l Atterberg limits (%)											COMMENTS
ft	m						10	20	30	40	50	60	70	80	90			
		0.0		GROUND SURFACE		%												
		0.2		TOPSOIL (150 mm)														
1		0.3		SANDY SILT - Reddish Brown Sandy Silt, Loose, Moist to Wet	AS-1	23		○										
	0.5			TILL - Light Brown Silty Sand, Compact, Moist														
2																		
					AS-2	23		○										
3		1.0																
4																		
5	1.5																	
6																		
					AS-3	22		○										
7	2.0																	
8																		
9																		
10	3.0				AS-4	23		○										
					AS-5	20		○										
11	3.4			END OF TEST PIT														
	3.5																	
12																		
13	4.0																	

 Groundwater seepage
 Observed at 2.1 m



TEST PIT No.: TP-4

ELEVATION: 216.0 m

TEST PIT REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern




DATE: 6 March 2020

LEGEND

☐ GS - GRAB SAMPLE
☒ - WATER LEVEL

EXCAVATION COMPANY: Balterre Contracting Limited METHOD: Track Excavator

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

Depth		m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Moisture Content	Shear test (Cu) <div>△ Field</div> <div>□ Lab</div> <div>○ Water content (%)</div> <div>⎓ Atterberg limits (%)</div>											COMMENTS
ft	m						10 20 30 40 50 60 70 80 90											
		0.0		GROUND SURFACE		%												
				TOPSOIL (150 mm)														No seepage observed during the excavation of the test pit
1		0.3		SANDY SILT - Reddish Brown Sandy Silt, Loose, Moist	AS-1	28				○								
		0.4		TILL - Light Brown Silty Sand and Gravel, Compact, Moist														
2	0.5				AS-2	37					○							
3	1.0																	
4																		
5	1.5				AS-3	26					○							
6																		
7	2.0																	
8	2.5																	
9																		
10	3.0																	
11	3.4	3.4		END OF TEST PIT	AS-4	27					○							
12	3.5																	
13	4.0																	



TEST PIT No.: TP-5

ELEVATION: 215.2 m

TEST PIT REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern




DATE: 6 March 2020

LEGEND

☐ GS - GRAB SAMPLE
☒ - WATER LEVEL

EXCAVATION COMPANY: Balterre Contracting Limited METHOD: Track Excavator

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

Depth		m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Moisture Content	Shear test (Cu) <div>△ Field</div> <div>□ Lab</div> <div>○ Water content (%)</div> <div>▬ Atterberg limits (%)</div>											COMMENTS
ft	m						10 20 30 40 50 60 70 80 90											
		0.0		GROUND SURFACE		%												
				TOPSOIL (150 mm)														No seepage observed during the excavation of the test pit
1	0.3			SANDY SILT - Reddish Brown Sandy Silt, Loose, Moist	AS-1	33												
	0.5																	
2																		
3	1.0				AS-2	28												
4																		
5	1.5				AS-3	20												
6																		
7	2.0																	
8	2.5																	
9	2.7			TILL - Light Brown Silty Sand and Gravel, Compact, Moist														
10	3.0	3.0		END OF TEST PIT	AS-4	16												
11	3.5																	
12																		
13	4.0																	



TEST PIT No.: TP-6

ELEVATION: 212.7 m

TEST PIT REPORT

Page: 1 of 1

CLIENT: Vargas Properties

PROJECT: Proposed Residential and Commercial Development

LOGGED BY: Jamie McEachern

DATE: 6 March 2020

LEGEND

☐ GS - GRAB SAMPLE
☒ - WATER LEVEL

EXCAVATION COMPANY: Balterre Contracting Limited METHOD: Track Excavator

NOTES: Ground surface elevation interpolated from Topographic plan prepared by IBW Surveyors, File Name "P-0400 Topo_v4.dwg" dated Jan. 14, 2020

Depth		m Below Existing Grade	Stratigraphy	DESCRIPTION OF SOIL AND BEDROCK	Type and Number	Moisture Content	Shear test (Cu) <div>△ Field</div> <div>□ Lab</div> <div>○ Water content (%)</div> <div>⎓ Atterberg limits (%)</div>											COMMENTS	
ft	m						10 20 30 40 50 60 70 80 90												
		0.0	GROUND SURFACE				%												
		0.2	TOPSOIL (150 mm)																No seepage observed during the excavation of the test pit
1		0.5	SANDY SILT - Reddish Brown Sandy Silt, Loose, Moist			AS-1	18	○											
2		0.5	TILL - Light Brown Silty Sand and Gravel, Compact, Moist																
3		1.0				AS-2	9	○											
4		1.5																	
5		2.0																	
6		2.5																	
7		3.0				AS-3	7	○											
8		3.0																	
9		3.0				AS-4	8	○											
10		3.0	END OF TEST PIT																
11		3.5																	
12		4.0																	
13		4.0																	




**Particle-Size Analysis of Soils (Geotechnical)
(USCS) (ASTM D422)**

Client: Vargas Properties **Lab no.:** SS-20-25

Project/Site: Fallis Line and CR10, Millbrook **Project no.:** 11209539-01

Borehole no.: BH-3 **Sample no.:** SS-4

Depth: 2.3 m - 2.9 m **Enclosure:** A-20

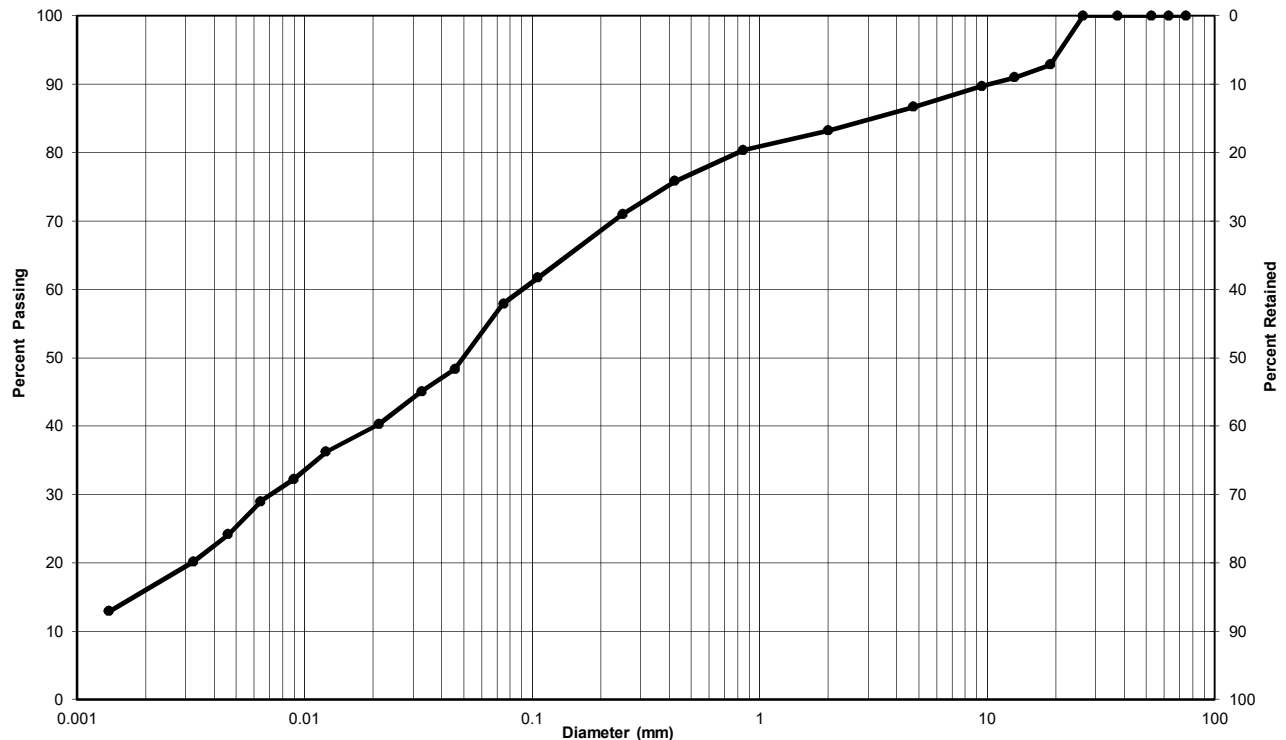

Clay & Silt	Sand			Gravel	
	Fine	Medium	Coarse	Fine	Coarse
Unified Soil Classification System					

Soil Description	Gravel	Sand	Clay & Silt
	13	29	58

Remarks:

Performed by: Josh Sullivan **Date:** April 29, 2020

Verified by: Joe Sullivan **Date:** May 7, 2020




**Particle-Size Analysis of Soils (Geotechnical)
(USCS) (ASTM D422)**

Client: Vargas Properties **Lab no.:** SS-20-25

Project/Site: Fallis Line and CR10, Millbrook **Project no.:** 11209539-01

Borehole no.: BH-7 **Sample no.:** SS-1

Depth: 0.0 m - 0.6 m **Enclosure:** A-21

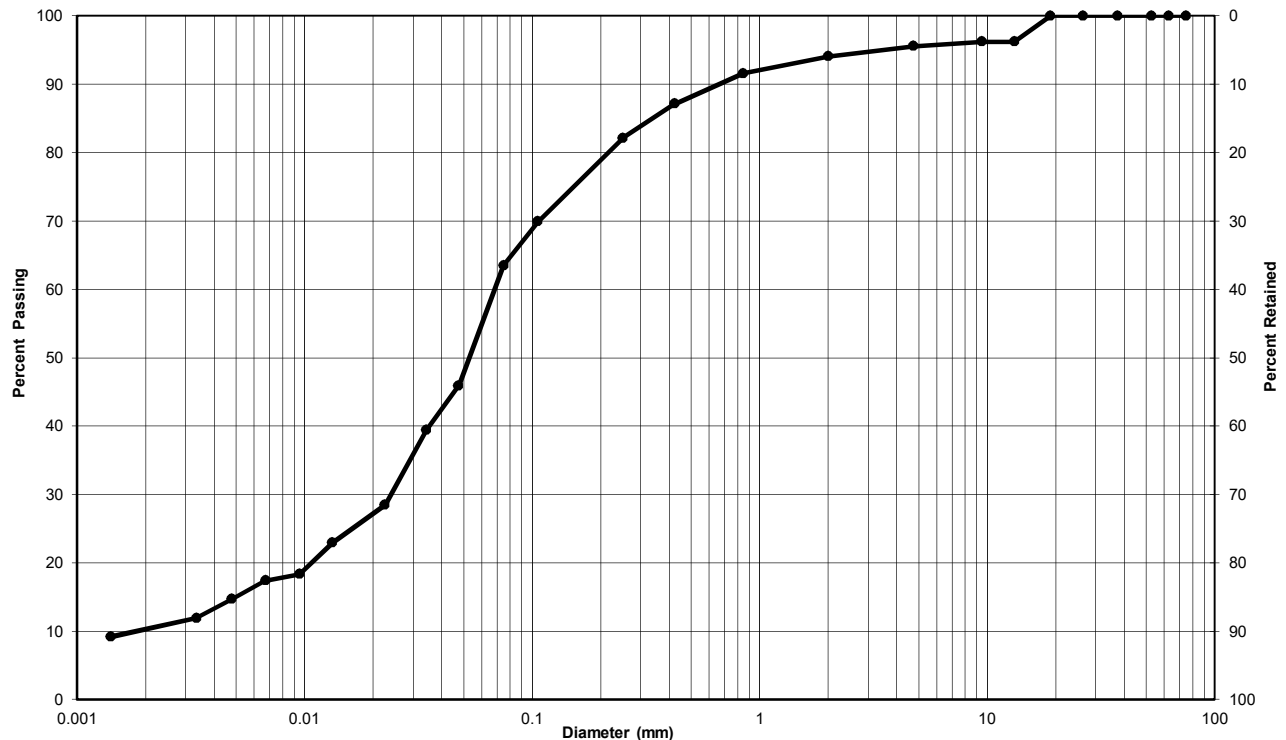

Clay & Silt	Sand			Gravel	
	Fine	Medium	Coarse	Fine	Coarse
Unified Soil Classification System					

Soil Description	Gravel	Sand	Clay & Silt
	4	33	63

Remarks:

Performed by: Josh Sullivan **Date:** April 29, 2020

Verified by: Joe Sullivan **Date:** May 7, 2020




**Particle-Size Analysis of Soils (Geotechnical)
(USCS) (ASTM D422)**

Client: Vargas Properties Lab no.: SS-20-25

Project/Site: Fallis Line and CR10, Millbrook Project no.: 11209539-01

Borehole no.: BH-9 Sample no.: SS-5

Depth: 3.1 m - 3.7 m Enclosure: A-22

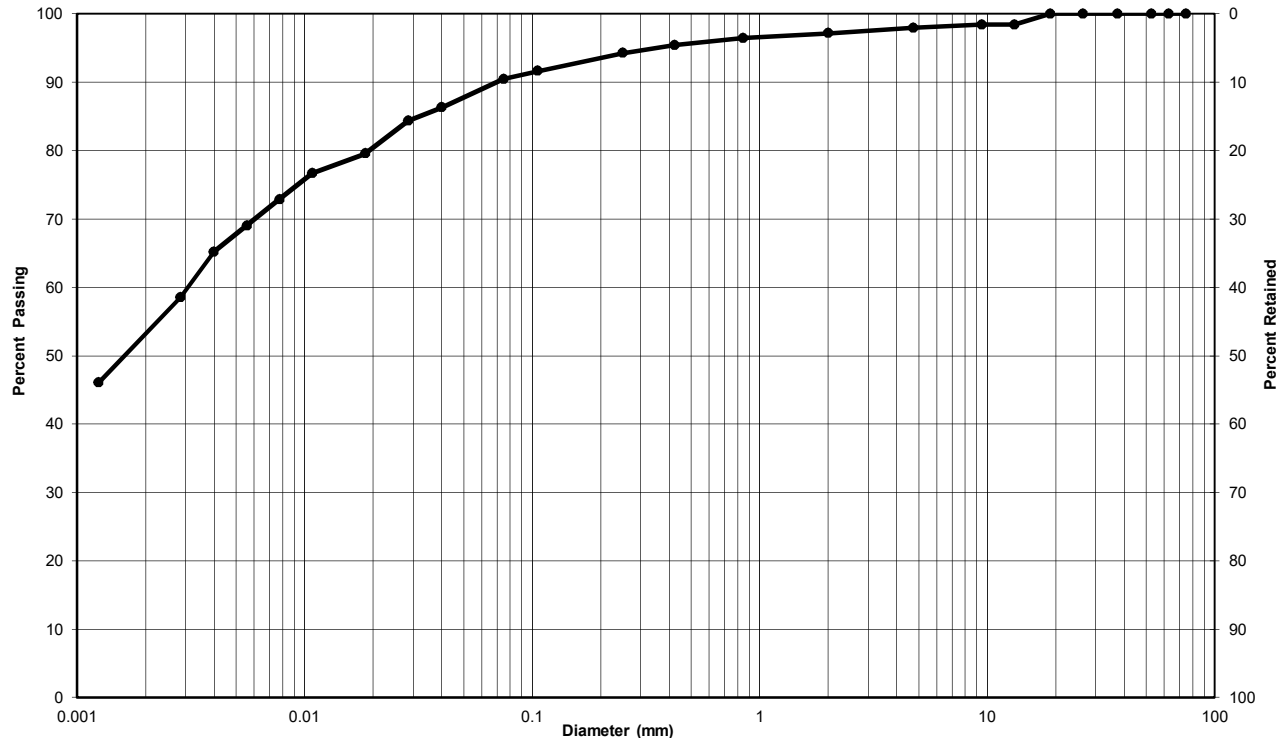

Clay & Silt	Sand			Gravel	
	Fine	Medium	Coarse	Fine	Coarse
Unified Soil Classification System					

Soil Description	Gravel	Sand	Clay & Silt
	2	8	90

Remarks:

Performed by: Josh Sullivan Date: April 29, 2020

Verified by: Joe Sullivan Date: May 7, 2020



Plasticity Index and Liquid Limit Testing LS-703&704

PLASTICITY CHART

Project Name: Fallis Line and CR10, Millbrook


Project No.: 11209539-01

Client: Vargas Properties

Depth: 3.0m - 3.7 m

Ref No.: SS-20-25

Enclosure: A-23

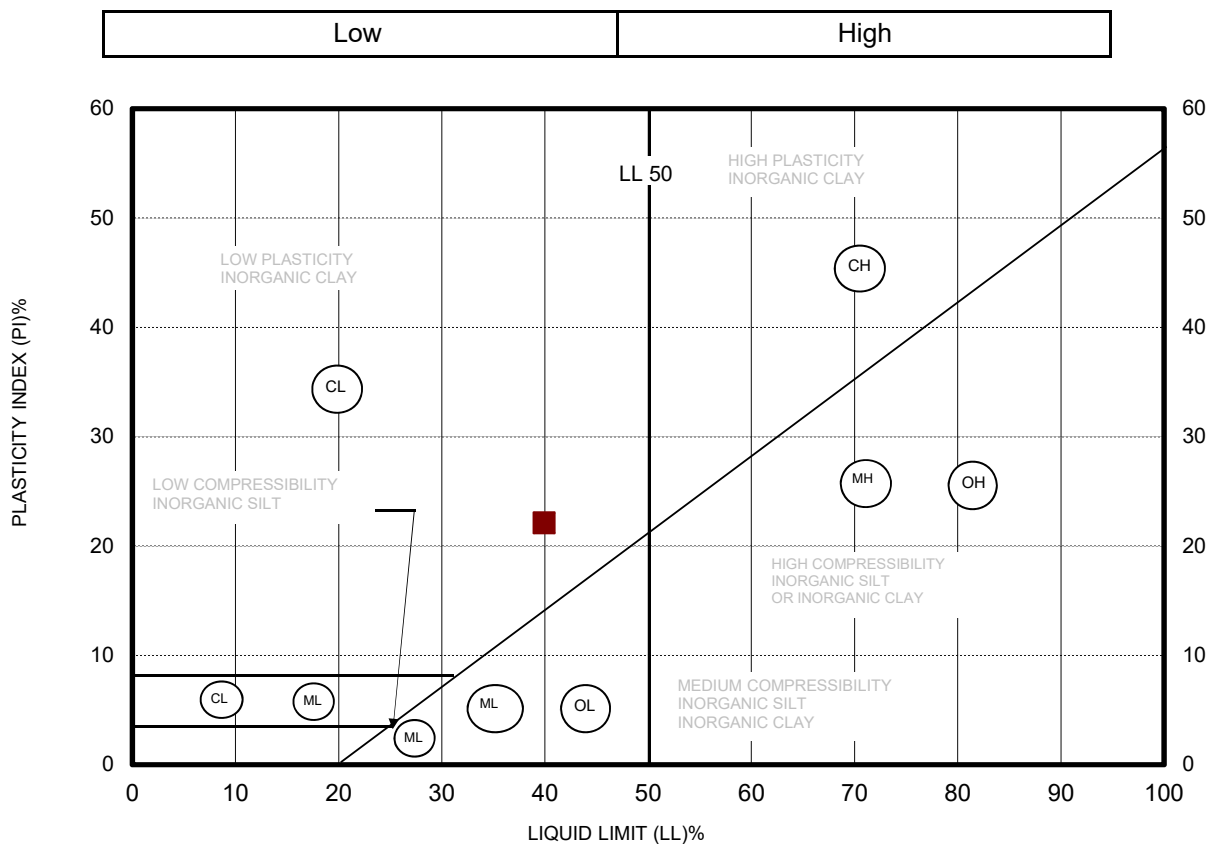

Symbol	Borehole	Sample	Depth	Sample Results	Value
■	BH-9	SS-5	3.0m - 3.7 m	Plasticity Index (%)	22
				Liquid Limit (%)	40

Performed By: Josh Sullivan

Date: May 7, 2020

Verified By: Joe Sullivan

Date: May 7, 2020




**Particle-Size Analysis of Soils (Geotechnical)
(USCS) (ASTM D422)**

Client: Vargas Properties Lab no.: SS-20-25

Project/Site: Fallis Line and CR10, Millbrook Project no.: 11209539-01

Borehole no.: BH-10 Sample no.: SS-3

Depth: 1.5 m - 2.1 m Enclosure: A-24

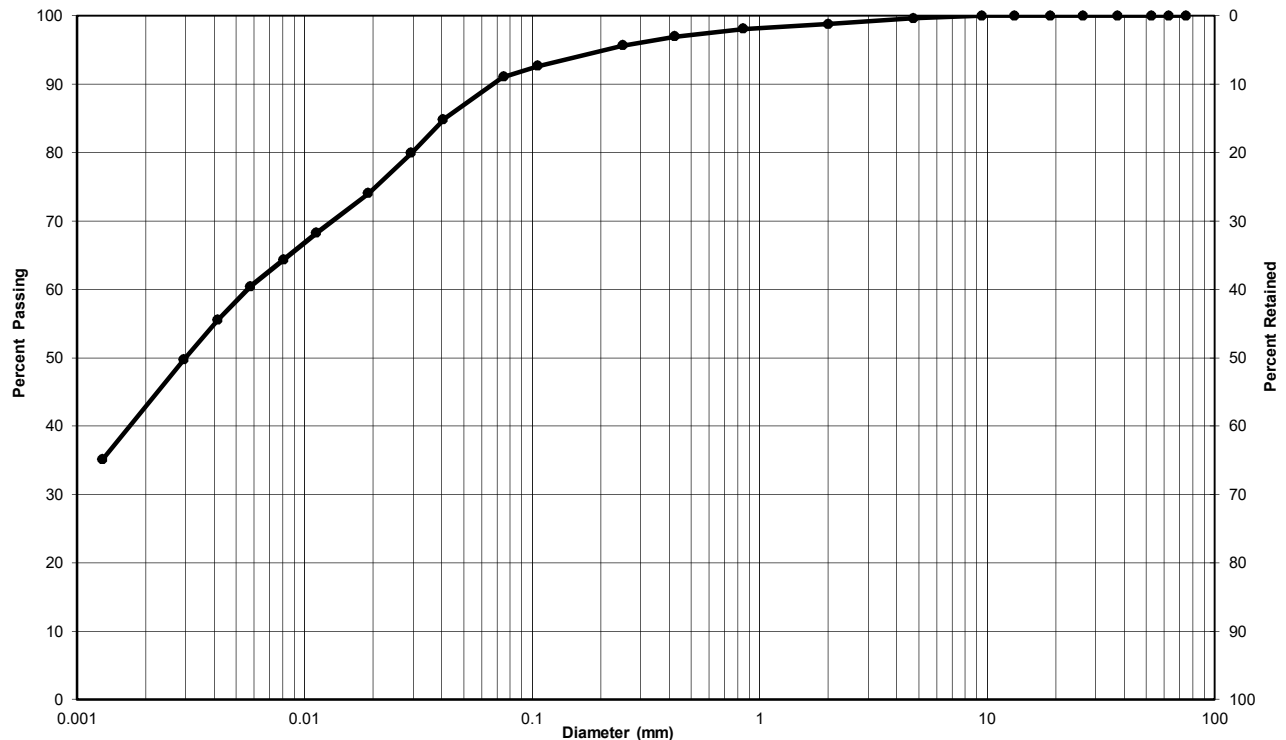

Clay & Silt	Sand			Gravel	
	Fine	Medium	Coarse	Fine	Coarse
Unified Soil Classification System					

Soil Description	Gravel	Sand	Clay & Silt
	0	9	91

Remarks:

Performed by: Josh Sullivan Date: April 29, 2020

Verified by: Joe Sullivan Date: May 7, 2020




**Particle-Size Analysis of Soils (Geotechnical)
(USCS) (ASTM D422)**

Client: Vargas Properties **Lab no.:** SS-20-25

Project/Site: Fallis Line and CR10, Millbrook **Project no.:** 11209539-01

Borehole no.: BH-11 **Sample no.:** SS-6a

Depth: 4.6 m - 4.9m **Enclosure:** A-25

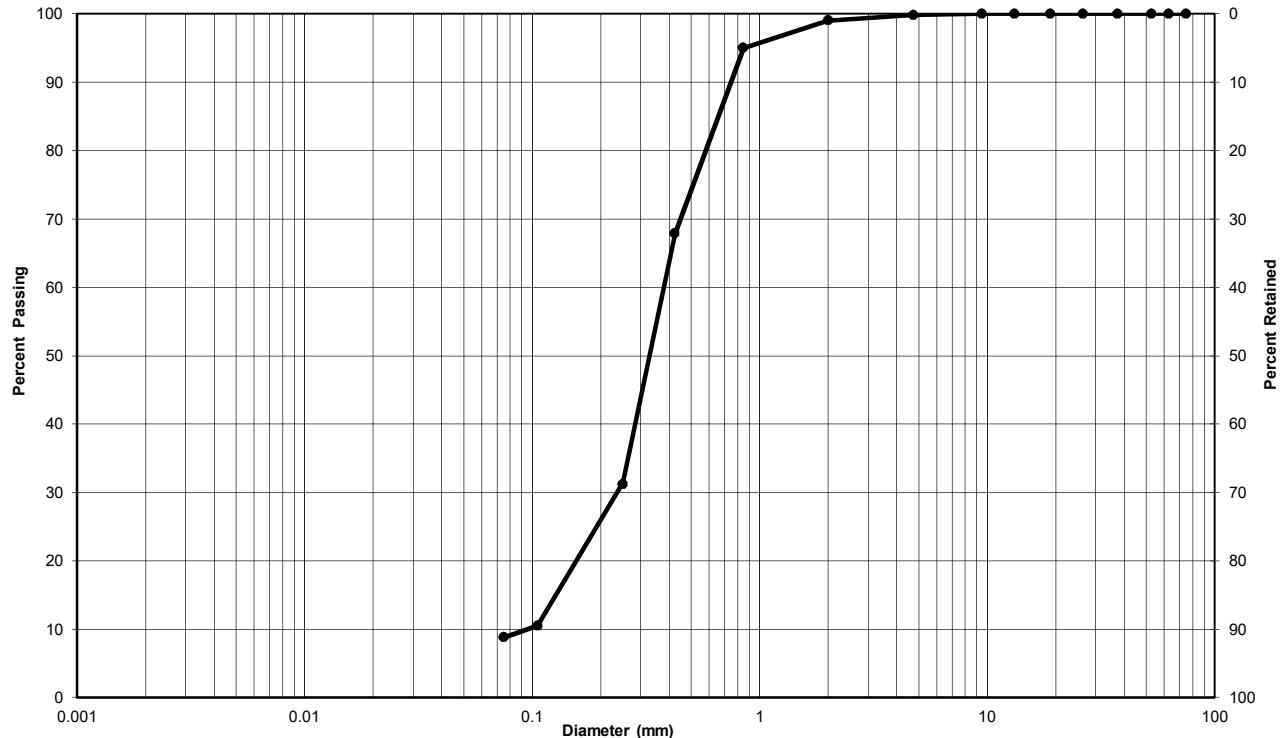

Clay & Silt	Sand			Gravel	
	Fine	Medium	Coarse	Fine	Coarse
Unified Soil Classification System					

Soil Description	Gravel	Sand	Clay & Silt
	0	91	9

Remarks:

Performed by: Josh Sullivan **Date:** April 27, 2020

Verified by: Joe Sullivan **Date:** May 7, 2020




**Particle-Size Analysis of Soils (Geotechnical)
(USCS) (ASTM D422)**

Client: Vargas Properties Lab no.: SS-20-25

Project/Site: Fallis Line and CR10, Millbrook Project no.: 11209539-01

Borehole no.: BH-12 Sample no.: SS-6
Depth: 4.6 m - 5.2 m Enclosure: A-26

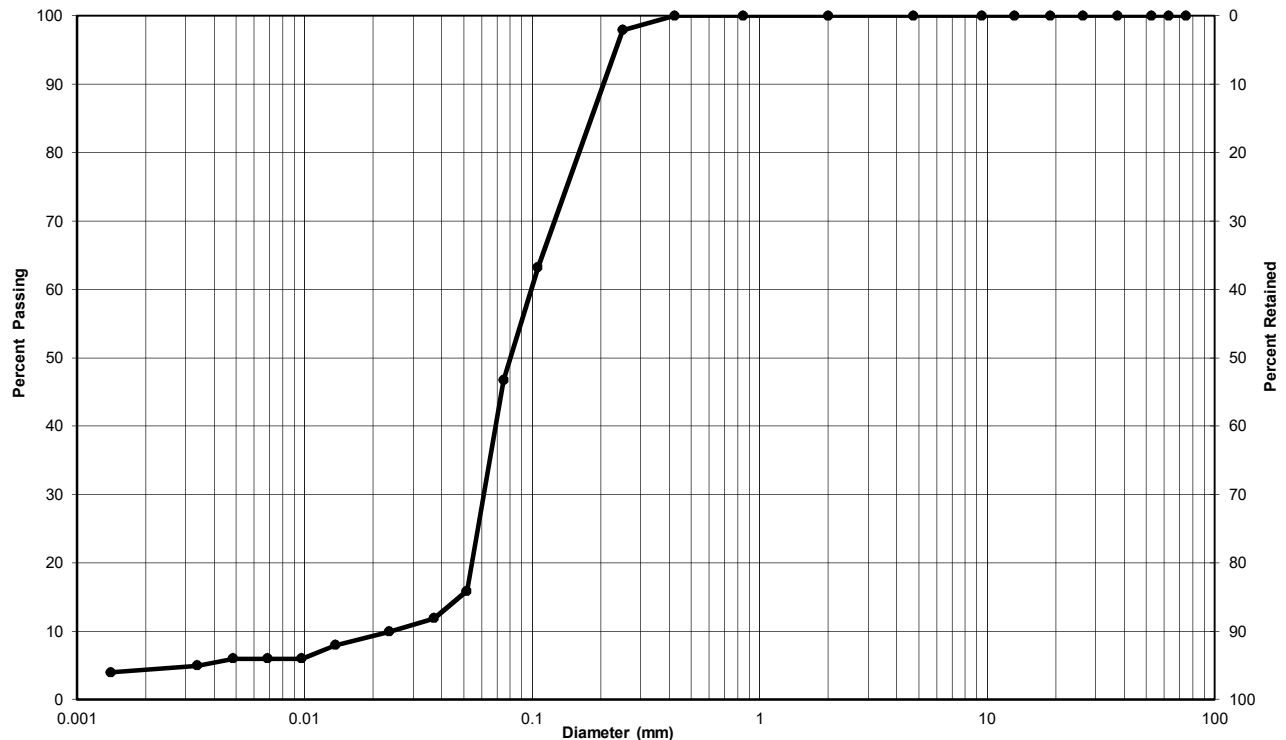

Clay & Silt	Sand			Gravel	
	Fine	Medium	Coarse	Fine	Coarse
Unified Soil Classification System					

Soil Description	Gravel	Sand	Clay & Silt
	0	53	47


Remarks:

Performed by: Josh Sullivan Date: April 29, 2020

Verified by: Joe Sullivan Date: May 7, 2020

Appendix B

MECP Well Records and Well Survey

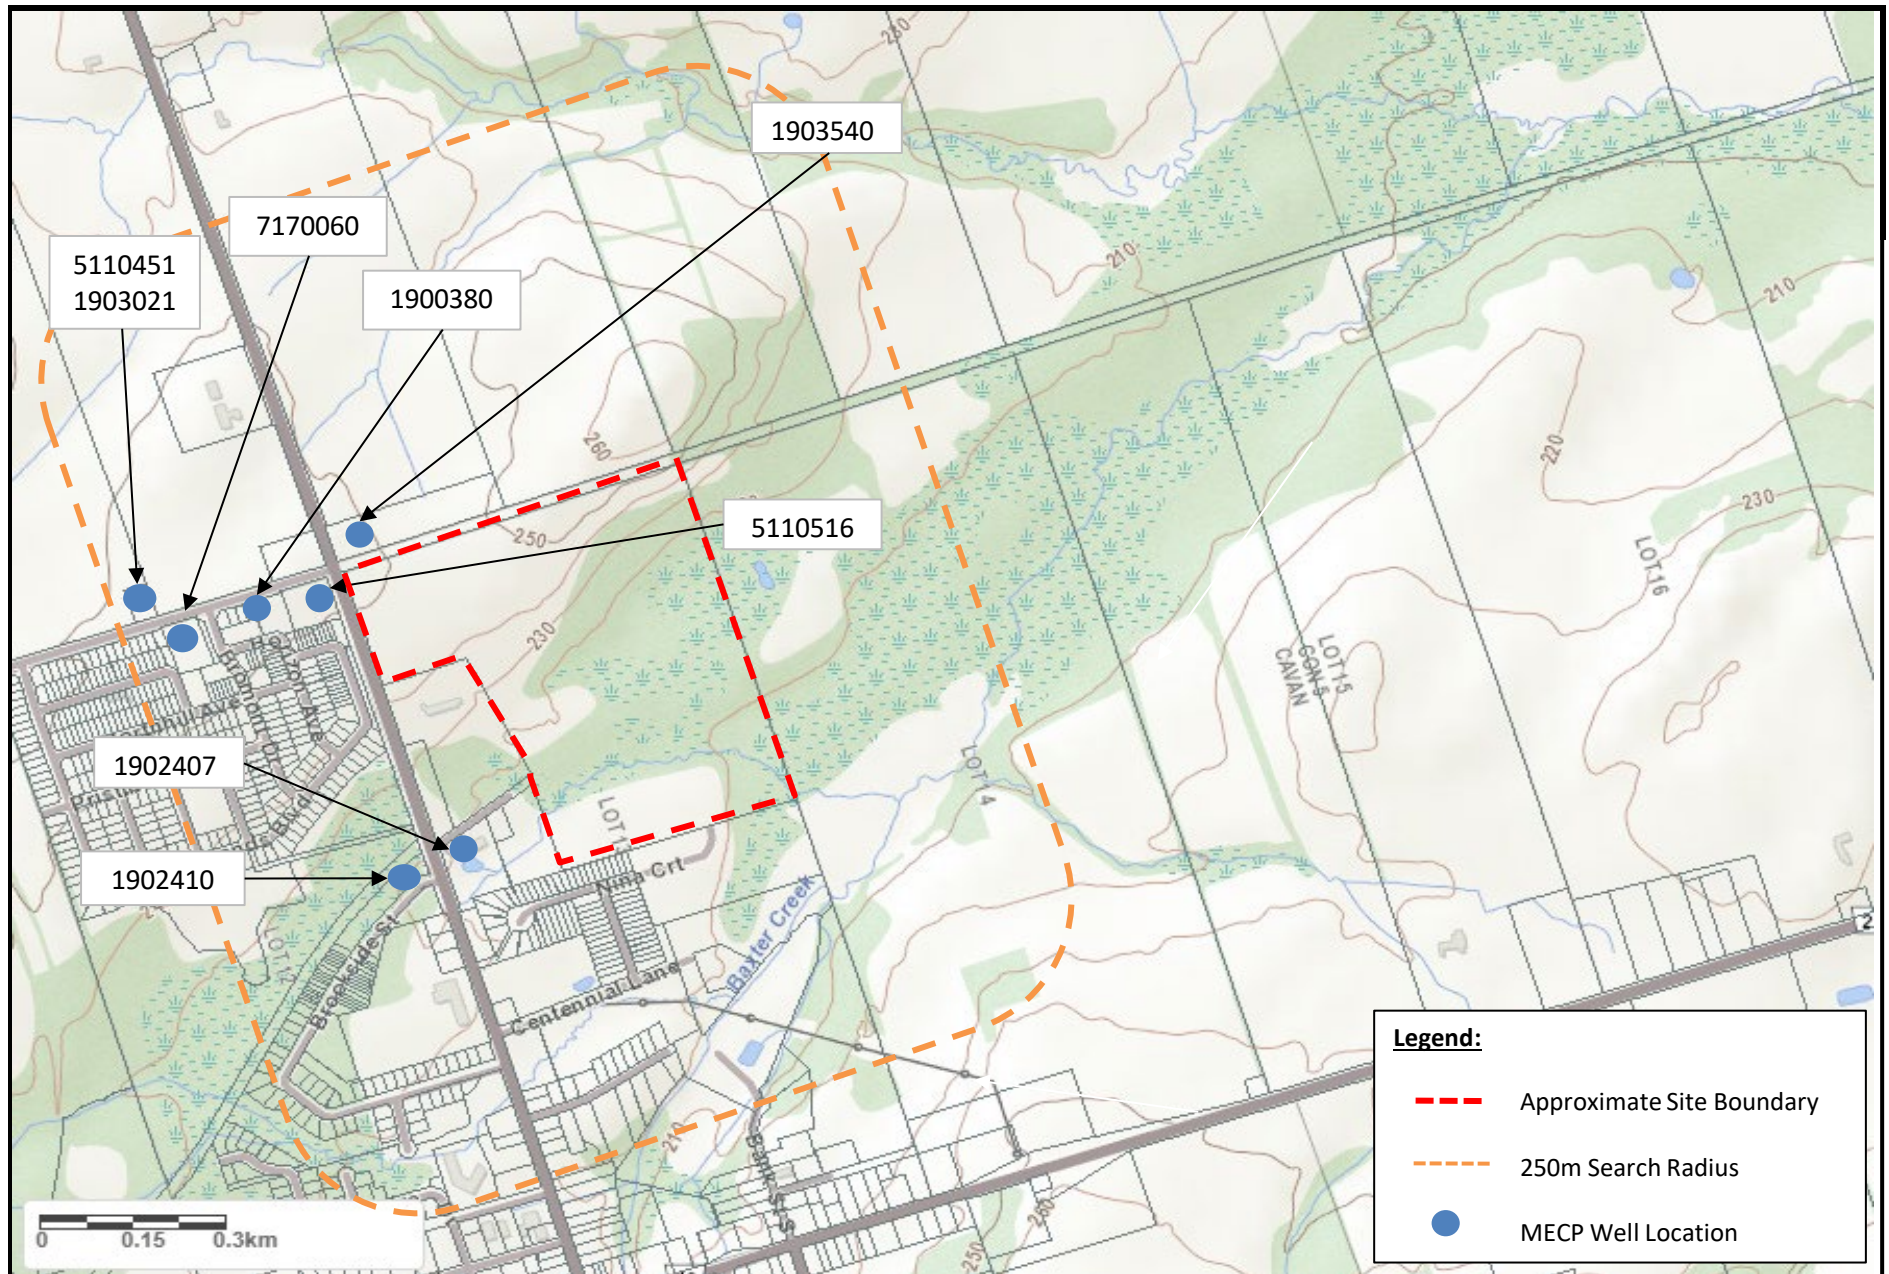

Source: MECP Water Well Record Mapping, accessed online (<https://www.ontario.ca/environment-and-energy/map-well-records>)

<p>Scale: Refer to Scale Bar Coordinate System: NAD 1983 UTM Zone 17</p>			<p>Vargas Development Proposed Residential Development Fallis Line, Millbrook, ON</p>	<p>11209539-01 June, 2020</p>
---	---	--	---	-----------------------------------

Well Location Plan

FIGURE B.1

APPENDIX B.2: WELL SUMMARY - OVERBURDEN BEDROCK

Well Record Summary

Vargas Development

Millbrook, ON

Well No.	Well Use	Water Found		Static Level		Pump Rate		Well Depth		Comments
		Feet	Metres	Feet	Metres	lgpm	L/min	Feet	Metres	
1900380	Domestic	53.0	16.2	39.0	11.9	22.0	100.1	54.0	16.5	Topsoil to 2', till to 20', clay with stones to 53', gravel to 54'
1902407	Domestic	121.0	36.9	0.0	0.0	16.0	72.8	121.0	36.9	Topsoil to 2', clay and stones to 110', clay with gravel and shale rock to 121'
1902410	Domestic	106.0	32.3	0.0	0.0	15.0	68.3	106.0	32.3	Topsoil to 2', clay to 100', gravel to 106'
5110451	Domestic	209	63.7	82	25.0	4.0	18.2	209	63.7	Clay and stones to 16', sand and gravel to 98', sand to 123', clay and gravel to 129', sand to 146', sand with gravel and clay to 208', shale to 209'
5110516	Domestic	115	35.1	49	14.9	6.0	27.3	119	36.3	Topsoil to 1', clay with stones to 37', gravel to 44', clay to 102', gravel and sand to 115', sand and gravel to 119'
717060	Domestic	208.0	63.4	175.0	53.3	10.0	45.5	208.0	63.4	Clay with stones to 15', sand and gravel to 38', clay to 110', clayey silt to 168', clay to 195', silty sand to 203', sand to 208'

Number of wells = 6

	Water Found		Static Level		Pump Rate		Well Depth	
	Feet	Metres	Feet	Metres	lgpm	L/min	Feet	Metres
AVERAGE	135.3	41.2	57.5	17.5	12.2	55.4	136.2	41.5
MAXIMUM	209.0	63.7	175.0	53.3	22.0	100.1	209.0	63.7
MINIMUM	53.0	16.2	0.0	0.0	4.0	18.2	54.0	16.5

APPENDIX B.3: WELL SUMMARY - DRILLED BEDROCK

Well Record Summary
Vargas Development
Millbrook, ON

Well No.	Well Use	Water Found		Static Level		Pump Rate		Well Depth		Depth to Bedrock		Comments
		Feet	Metres	Feet	Metres	lgpm	L/min	Feet	Metres	Feet	Metres	
1903021	Domestic	216.0	65.8	66.0	20.1	3.0	13.7	237.0	72.2	215.0	65.5	Clay with stones to 130', clay with sand layers to 135', clay with stones to 215', limestone to 237'
1903540	Domestic	225.0	68.6	70.0	21.3	2.0	9.1	230.0	70.1	225.0	68.6	Topsoil to 1', clay and stones to 135', sand and clay to 144', sand and gravel to 155', sand and clay to 225', limestone to 230'

Number of wells = 2

	Water Found		Static Level		Pump Rate		Well Depth		Depth to Bedrock	
	Feet	Metres	Feet	Metres	lgpm	L/min	Feet	Metres	Feet	Metres
AVERAGE	220.5	67.2	68.0	20.7	2.5	11.4	233.5	71.2	220.0	67.1
MAXIMUM	225.0	68.6	70.0	21.3	3.0	13.7	237.0	72.2	225.0	68.6
MINIMUM	216.0	65.8	66.0	20.1	2.0	9.1	230.0	70.1	215.0	65.5



Source: Compiled from Google Earth. Aerial photo dated November 27, 2019

Scale:
Refer to Scale Bar
Coordinate System:
NAD 1983 UTM Zone 17



Geotechnical Investigation
Vargas Development
Proposed Residential Development
Fallis Line, Millbrook, ON

11209539-01
March, 2020

Well Survey Locations

Appendix B.3

APPENDIX B.4: WATER WELL INFORMATION SURVEY

PROJECT: 11209539-01, March 18 and 19, 2020

LOCATION: Fallis Line, Millbrook, ON

Address	Well ID for Map	Easting (m)	Northing (m)	Well Type	Top of Well (m)	Water Level (m)	Depth (m)	Quality	Quantity	Comments
893 Fallis Line	L-1	703391	4892952	Drilled	0.51	18.45	60.5	Methane gas and cloudy	No known issues	Municipally serviced as of 2018. Former well on property.
1 Buckland Drive	L-2	703925	4892576	--	--	--	--	--	--	Municipally serviced for past 30 years. On a well prior to that.
23 Buckland Drive	L-3	704025	4892662	Drilled	0.01	0.68		No known issues	'No known issues	Municipally serviced since 1986. Former well on property. Water sample collected (W-1).
917 County Road 10	L-4	703867	4892831	Dug	Unknown	Unknown	Unknown	No known issues	No known issues	Current Water Supply- no issues, plenty of water. Water sample collected from tap (W-2).
Onsite (North of Fallis Line)	L-5	7037730	4893143	Dug	0.015	5.15	Unknown	No known issues	No known issues	Current Water Supply- no issues, plenty of water. Water sample collected from tap (W-3).

UTM 11 7z 703510E
9R 4892781N
Elev. 9R 0825
Basin 24



RECEIVED
FEB 22 1954 19
GEOLOGICAL BRANCH
DEPARTMENT OF MINES

No. 380

The Well Drillers Act
Department of Mines, Province of Ontario

Water Well Record

Durham Village, Town or City Cavan
RR # 3 Millbrook

Date Completed 9 Dec 53 Cost of Well (excluding pump)

Pipe and Casing Record

Pumping Test

Casing diameter(s) 6 1/2
Length(s) of casing(s) 54
Type of screen none
Length of screen
Distance from top of screen to ground level
Is well a gravel-wall type?
Date Dec 9
Static level 40
Pumping level 44
Pumping rate 220 GPM
Duration of test 2 hrs
Distance from cylinder or bowls to ground level

Water Record

Kind (fresh or mineral)	Depth(s) to Water Horizon(s)	Kind of Water	No. of Feet Water Rises
fresh	53-54	Clear	14'
Quality (hard, soft, contains iron, sulphur, etc.) soft			
Appearance (clear, cloudy, coloured) clear			
For what purpose(s) is the water to be used? Farm stock			
How far is well from possible source of contamination? none			
What is the source of contamination?			
Enclose a copy of any mineral analysis that has been made of water.			


Well Log

Overburden and Bedrock Record

	From	To
	0 ft.	20 ft.
Top Soil		
Brown Soil	2	20
Blue clay + stones	20	53
Gravel	53	54

Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

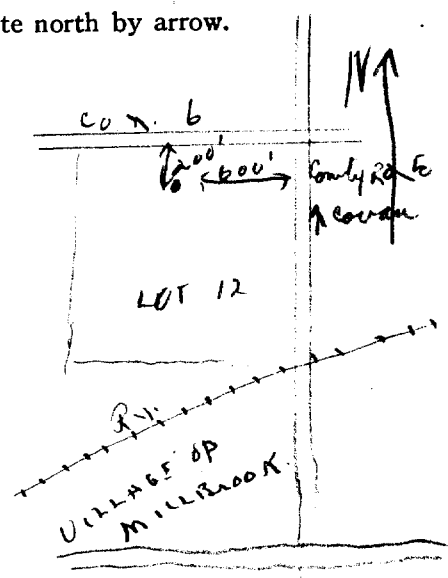

Situation: Is well on upland, in valley, or on hillside? upland
Drilling Firm. J. H. Sanderson
Address. 131 Maria St. Peterborough
Name of Driller. J. H. Sanderson
Date. Feb 15 / 54
Licence Number. 209
Signature of Licensee. J. H. Sanderson

UTM 17 Z 703098 E
9 R 4892378 N
Elev. 9 R 0720
Basin 24



RECEIVED
DEC 29 1954
GEOLOGICAL BRANCH
DEPARTMENT of MINES

19 No 2407

The Water-well Drillers Act, 1954
Department of Mines

Water-Well Record MILLBROOK

County or Territorial District Durham Township, Village, ~~Town or City~~ Millbrook
Village, ~~Town or City~~ MILLBROOK
Address Millbrook
Date completed 1954 (day) (month) (year)

Pipe and Casing Record

Pumping Test

Casing diameter(s) <u>6"</u>	Static level <u>flowing</u>
Length(s) <u>121'</u>	Pumping rate <u>1000 gals per hr.</u>
Type of screen	Pumping level <u>60'</u>
Length of screen	Duration of test <u>1 hr.</u>


Well Log

Water Record

Overburden and Bedrock Record	From ft.	To ft.	Depth (s) at which water (s) found	No. of feet water rises	Kind of water (fresh, salty, or sulphur)
<u>Top soil</u>	<u>0</u>	<u>2'</u>	<u>121'</u>	<u>flows</u>	<u>fresh.</u>
<u>Blue clay + some stones</u>	<u>2'</u>	<u>110'</u>			
<u>clay, gravel + shale rock</u>	<u>110'</u>	<u>121'</u>			

For what purpose(s) is the water to be used? Domestic
Is water clear or cloudy? clear
Is well on upland, in valley, or on hillside? upland
Drilling firm H. N. Faulkner
Address 687 Water St. Peterboro
Name of Driller H. G. Lang
Address Sturgeon St. Ormiston
Licence Number 456

I certify that the foregoing statements of fact are true.
Date Dec. 19 H. G. Lang
Signature of Licensee

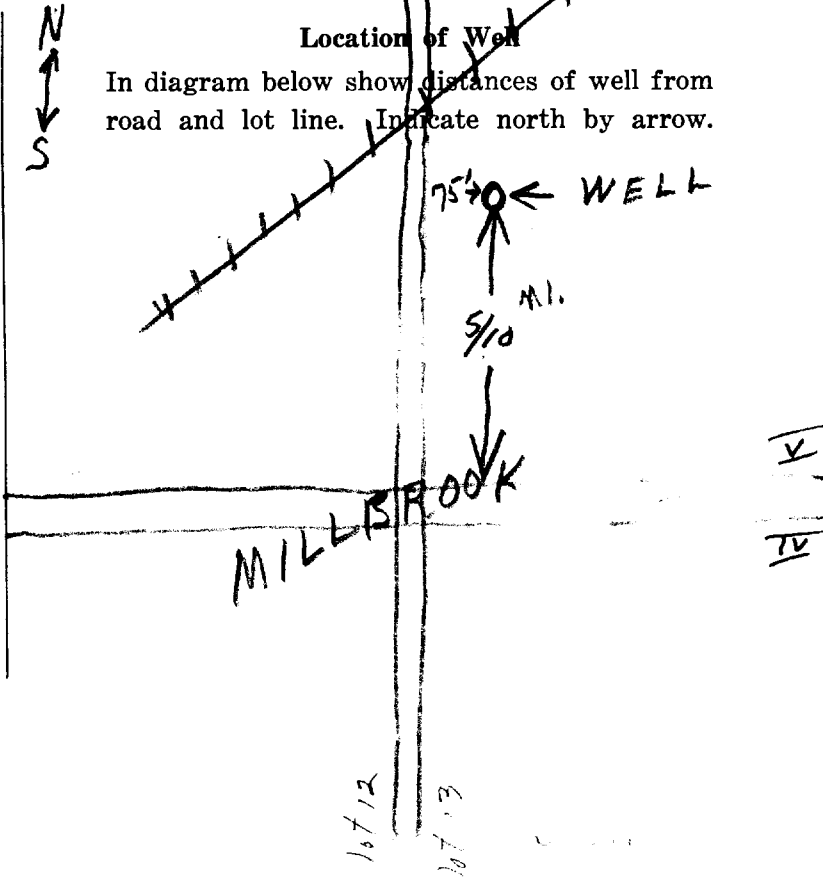



The Ontario Water Resources Commission Act

WATER WELL RECORD

31 D / 1 W

Water management in Ontario

1. PRINT ONLY IN SPACES PROVIDED

2. CHECK ☒ CORRECT BOX WHERE APPLICABLE

11

1903021

MUNICIP.

19002

CON.

CEN

105

COUNTY OR DISTRICT

TOWNSHIP, BOROUGH, CITY, VILLAGE

CON. BLOCK, TRACT, SURVEY, ETC.

LOT

DATE COMPLETED

DAY 17 MO. Sept YR. 70

92780

4

ELEVATION

0835

RC

5

BASIN CODE

24

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
Brown	clay	stones	hard	0	22
Blue	clay	stones	hard	22	130
Blue	clay	sand layers	soft	130	135
Blue	clay	stones	hard	135	215
Grey	limestone		hard	215	237

31

32

41

WATER RECORD

WATER FOUND AT - FEET	KIND OF WATER			
10-13	1 <input checked="" type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	14	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
15-18	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	19	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
20-23	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	24	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
25-28	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	29	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		
30-33	1 <input type="checkbox"/> FRESH	3 <input type="checkbox"/> SULPHUR	34	
	2 <input type="checkbox"/> SALTY	4 <input type="checkbox"/> MINERAL		

51 CASING & OPEN HOLE RECORD

INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET	
			FROM	TO
10-11	1 <input checked="" type="checkbox"/> STEEL	12 .185	0	216
	2 <input type="checkbox"/> GALVANIZED			
	3 <input type="checkbox"/> CONCRETE			
	4 <input type="checkbox"/> OPEN HOLE			
17-18	1 <input type="checkbox"/> STEEL	19		20-23
	2 <input type="checkbox"/> GALVANIZED			
	3 <input type="checkbox"/> CONCRETE			
	4 <input type="checkbox"/> OPEN HOLE			
24-25	1 <input type="checkbox"/> STEEL	26		27-30
	2 <input type="checkbox"/> GALVANIZED			
	3 <input type="checkbox"/> CONCRETE			
	4 <input type="checkbox"/> OPEN HOLE			

SCREEN

SIZE(S) OF OPENING (SLOT NO.)

MATERIAL AND TYPE

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET

FEET


FEET

FEET

FEET

LOCATION OF WELL

IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE. INDICATE NORTH BY ARROW.

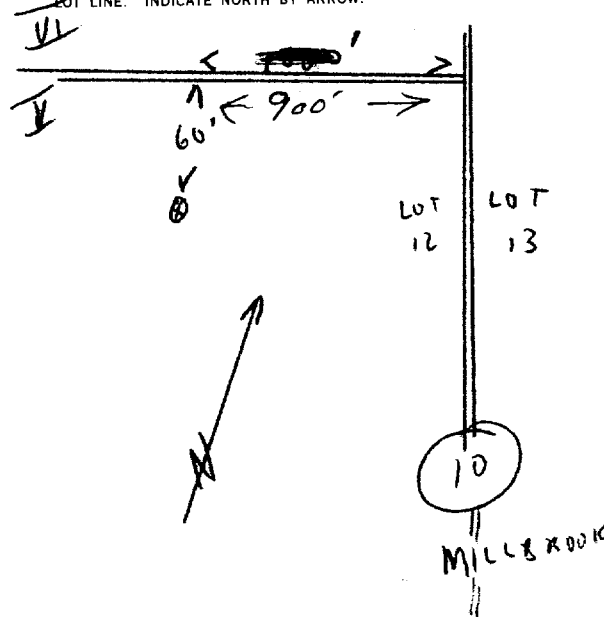

DRILLERS REMARKS:

PUMPING TEST METHOD	PUMPING RATE	DURATION OF PUMPING	PUMPING	RECOVERY
1 <input type="checkbox"/> PUMP	2 <input checked="" type="checkbox"/> BAILEY	000.3 GPM.	01 HOURS	00 MINS.
19-21	22-24	15 MINUTES	30 MINUTES	45 MINUTES
066 FEET	230 FEET	100 FEET	150 FEET	200 FEET
IF FLOWING, GIVE RATE	38-41	PUMP INTAKE SET AT	42	WATER AT END OF TEST
RECOMMENDED PUMP TYPE	RECOMMENDED PUMP SETTING	43-45	RECOMMENDED PUMPING RATE	46-49
<input type="checkbox"/> SHALLOW	<input checked="" type="checkbox"/> DEEP	220 FEET	000.3 GPM.	
50-53	000.0 GPM./FT. SPECIFIC CAPACITY			

FINAL STATUS OF WELL	WATER USE	METHOD OF DRILLING
1 <input checked="" type="checkbox"/> WATER SUPPLY	1 <input checked="" type="checkbox"/> DOMESTIC	1 <input checked="" type="checkbox"/> CABLE TOOL
2 <input type="checkbox"/> OBSERVATION WELL	2 <input type="checkbox"/> STOCK	2 <input type="checkbox"/> ROTARY (CONVENTIONAL)
3 <input type="checkbox"/> TEST HOLE	3 <input type="checkbox"/> IRRIGATION	3 <input type="checkbox"/> ROTARY (REVERSE)
4 <input type="checkbox"/> RECHARGE WELL	4 <input type="checkbox"/> INDUSTRIAL	4 <input type="checkbox"/> ROTARY (AIR)
	<input type="checkbox"/> OTHER	5 <input type="checkbox"/> AIR PERCUSSION
5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY	5 <input type="checkbox"/> COMMERCIAL	6 <input type="checkbox"/> BORING
6 <input type="checkbox"/> ABANDONED, POOR QUALITY	6 <input type="checkbox"/> MUNICIPAL	7 <input type="checkbox"/> DIAMOND
7 <input type="checkbox"/> UNFINISHED	7 <input type="checkbox"/> PUBLIC SUPPLY	8 <input type="checkbox"/> JETTING
	8 <input type="checkbox"/> COOLING OR AIR CONDITIONING	9 <input type="checkbox"/> DRIVING
	9 <input type="checkbox"/> NOT USED	

CONTRACTOR	NAME OF WELL CONTRACTOR	LICENCE NUMBER
	W. Anderson	4713
	Address	
	W. Anderson	
	NAME OF DRILLER OR BORER	LICENCE NUMBER
	W. Anderson	
	SIGNATURE OF CONTRACTOR	SUBMISSION DATE
	W. Anderson	DAY 18 MO. 9 YR. 70

OFFICE USE ONLY	DATA SOURCE	CONTRACTOR	DATE RECEIVED
	1	4713	040271
	DATE OF INSPECTION	INSPECTOR	
	APR. 14/71	SC/J.B.	
	REMARKS:	P/J.B.	

OWRC COPY



WATER WELL RECORD

310/1E

Water management in Ontario 1. PRINT ONLY IN SPACES PROVIDED

2. CHECK ☒ CORRECT BOX WHERE APPLICABLE

COUNTY OR DISTRICT Durham	TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE Cavan	CON., BLOCK, TRACT, SURVEY, ETC. 6	LOT 013
DATE COMPLETED DAY 13 MO 7 YR 72		DATE RECEIVED DAY 13 MO 7 YR 72	
MUNICIPALITY R.R. #3 Millbrook		CONTRACTOR 4814	
ELEVATION 92900		BASIN CODE 5 24	

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
	top soil			0'	1'
brown	clay & stones & boulders			1'	45'
				45'	135'
grey	clay & stones			135'	144'
fine sand & grey clay				144'	155'
fine sand & gravel & grey clay				155'	170'
gravel fine sand & grey clay				170'	225'
fine sand, grey clay & gravel				225'	230'
grey	limestone rock				

31	0001 02	0045 00512	0135 00512	0144 0805	0155 081105	0170 1119805	1
32	0225 080511	0230 0215					

WATER RECORD			
WATER FOUND AT - FEET	KIND OF WATER		
225' 230'	1 FRESH 3 SULPHUR		
0225	2 SALTY 4 MINERAL		
15-18	1 FRESH 3 SULPHUR		
	2 SALTY 4 MINERAL		
20-23	1 FRESH 3 SULPHUR		
	2 SALTY 4 MINERAL		
25-28	1 FRESH 3 SULPHUR		
	2 SALTY 4 MINERAL		
30-33	1 FRESH 3 SULPHUR		
	2 SALTY 4 MINERAL		

CASING & OPEN HOLE RECORD			
INSIDE DIAM. INCHES	MATERIAL	WALL THICKNESS INCHES	DEPTH - FEET
6 1/2	STEEL	12	0' 225'
6 1/2	GALVANIZED	12	225' 230'
6 1/2	CONCRETE	12	
6 1/2	OPEN HOLE	12	
06	STEEL	19	0230
	GALVANIZED	26	
	CONCRETE	26	
	OPEN HOLE	26	

SCREEN	
SIZE(S) OF OPENING (SLOT NO.)	DIAMETER
	INCHES
	FEET
MATERIAL AND TYPE	
DEPTH TO TOP OF SCREEN	
FEET	

PLUGGING & SEALING RECORD		
DEPTH SET AT - FEET	MATERIAL AND TYPE	(CEMENT GROUT, LEAD PACKER, ETC.)
FROM TO		
10-13	14-17	
18-21	22-25	
26-29	30-33	

PUMPING TEST METHOD		PUMPING RATE	DURATION OF PUMPING
1 PUMP	2 BAILER	0002 GPM	08 HOURS 00 MINS.
STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING	
070'	225'	15 MINUTES	30 MINUTES
		45 MINUTES	60 MINUTES
		75 MINUTES	90 MINUTES
		105 MINUTES	120 MINUTES
		135 MINUTES	150 MINUTES
		165 MINUTES	180 MINUTES
		210 MINUTES	240 MINUTES
		225 MINUTES	255 MINUTES
		230 MINUTES	270 MINUTES
		235 MINUTES	285 MINUTES
		240 MINUTES	300 MINUTES
		245 MINUTES	315 MINUTES
		250 MINUTES	330 MINUTES
		255 MINUTES	345 MINUTES
		260 MINUTES	360 MINUTES
		265 MINUTES	375 MINUTES
		270 MINUTES	390 MINUTES
		275 MINUTES	405 MINUTES
		280 MINUTES	420 MINUTES
		285 MINUTES	435 MINUTES
		290 MINUTES	450 MINUTES
		295 MINUTES	465 MINUTES
		300 MINUTES	480 MINUTES
		305 MINUTES	495 MINUTES
		310 MINUTES	510 MINUTES
		315 MINUTES	525 MINUTES
		320 MINUTES	540 MINUTES
		325 MINUTES	555 MINUTES
		330 MINUTES	570 MINUTES
		335 MINUTES	585 MINUTES
		340 MINUTES	600 MINUTES
		345 MINUTES	615 MINUTES
		350 MINUTES	630 MINUTES
		355 MINUTES	645 MINUTES
		360 MINUTES	660 MINUTES
		365 MINUTES	675 MINUTES
		370 MINUTES	690 MINUTES
		375 MINUTES	705 MINUTES
		380 MINUTES	720 MINUTES
		385 MINUTES	735 MINUTES
		390 MINUTES	750 MINUTES
		395 MINUTES	765 MINUTES
		400 MINUTES	780 MINUTES
		405 MINUTES	795 MINUTES
		410 MINUTES	810 MINUTES
		415 MINUTES	825 MINUTES
		420 MINUTES	840 MINUTES
		425 MINUTES	855 MINUTES
		430 MINUTES	870 MINUTES
		435 MINUTES	885 MINUTES
		440 MINUTES	900 MINUTES
		445 MINUTES	915 MINUTES
		450 MINUTES	930 MINUTES
		455 MINUTES	945 MINUTES
		460 MINUTES	960 MINUTES
		465 MINUTES	975 MINUTES
		470 MINUTES	990 MINUTES
		475 MINUTES	1005 MINUTES
		480 MINUTES	1020 MINUTES
		485 MINUTES	1035 MINUTES
		490 MINUTES	1050 MINUTES
		495 MINUTES	1065 MINUTES
		500 MINUTES	1080 MINUTES
		505 MINUTES	1095 MINUTES
		510 MINUTES	1110 MINUTES
		515 MINUTES	1125 MINUTES
		520 MINUTES	1140 MINUTES
		525 MINUTES	1155 MINUTES
		530 MINUTES	1170 MINUTES
		535 MINUTES	1185 MINUTES
		540 MINUTES	1200 MINUTES
		545 MINUTES	1215 MINUTES
		550 MINUTES	1230 MINUTES
		555 MINUTES	1245 MINUTES
		560 MINUTES	1260 MINUTES
		565 MINUTES	1275 MINUTES
		570 MINUTES	1290 MINUTES
		575 MINUTES	1305 MINUTES
		580 MINUTES	1320 MINUTES
		585 MINUTES	1335 MINUTES
		590 MINUTES	1350 MINUTES
		595 MINUTES	1365 MINUTES
		600 MINUTES	1380 MINUTES
		605 MINUTES	1395 MINUTES
		610 MINUTES	1410 MINUTES
		615 MINUTES	1425 MINUTES
		620 MINUTES	1440 MINUTES
		625 MINUTES	1455 MINUTES
		630 MINUTES	1470 MINUTES
		635 MINUTES	1485 MINUTES
		640 MINUTES	1500 MINUTES
		645 MINUTES	1515 MINUTES
		650 MINUTES	1530 MINUTES
		655 MINUTES	1545 MINUTES
		660 MINUTES	1560 MINUTES
		665 MINUTES	1575 MINUTES
		670 MINUTES	1590 MINUTES
		675 MINUTES	1605 MINUTES
		680 MINUTES	1620 MINUTES
		685 MINUTES	1635 MINUTES
		690 MINUTES	1650 MINUTES
		695 MINUTES	1665 MINUTES
		700 MINUTES	1680 MINUTES
		705 MINUTES	1695 MINUTES
		710 MINUTES	1710 MINUTES
		715 MINUTES	1725 MINUTES
		720 MINUTES	1740 MINUTES
		725 MINUTES	1755 MINUTES
		730 MINUTES	1770 MINUTES
		735 MINUTES	1785 MINUTES
		740 MINUTES	1800 MINUTES
		745 MINUTES	1815 MINUTES
		750 MINUTES	1830 MINUTES
		755 MINUTES	1845 MINUTES
		760 MINUTES	1860 MINUTES
		765 MINUTES	1875 MINUTES
		770 MINUTES	1890 MINUTES
		775 MINUTES	1905 MINUTES
		780 MINUTES	1920 MINUTES
		785 MINUTES	1935 MINUTES
		790 MINUTES	1950 MINUTES
		795 MINUTES	1965 MINUTES
		800 MINUTES	1980 MINUTES
		805 MINUTES	1995 MINUTES
		810 MINUTES	2010 MINUTES
		815 MINUTES	2025 MINUTES
		820 MINUTES	2040 MINUTES
		825 MINUTES	2055 MINUTES
		830 MINUTES	2070 MINUTES
		835 MINUTES	2085 MINUTES
		840 MINUTES	2100 MINUTES
		845 MINUTES	2115 MINUTES
		850 MINUTES	2130 MINUTES
		855 MINUTES	2145 MINUTES
		860 MINUTES	2160 MINUTES
		865 MINUTES	2175 MINUTES
		870 MINUTES	2190 MINUTES
		875 MINUTES	2205 MINUTES
		880 MINUTES	2220 MINUTES
		885 MINUTES	2235 MINUTES
		890 MINUTES	2250 MINUTES
		895 MINUTES	2265 MINUTES
		900 MINUTES	2280 MINUTES
		905 MINUTES	2295 MINUTES
		910 MINUTES	2310 MINUTES
		915 MINUTES	2325 MINUTES
		920 MINUTES	2340 MINUTES
		925 MINUTES	2355 MINUTES
		930 MINUTES	2370 MINUTES
		935 MINUTES	2385 MINUTES
		940 MINUTES	2400 MINUTES
		945 MINUTES	2415 MINUTES
		950 MINUTES	2430 MINUTES
		955 MINUTES	2445 MINUTES
		960 MINUTES	2460 MINUTES
		965 MINUTES	2475 MINUTES
		970 MINUTES	2490 MINUTES
		975 MINUTES	2505 MINUTES
		980 MINUTES	2520 MINUTES
		985 MINUTES	2535 MINUTES
		990 MINUTES	2550 MINUTES
		995 MINUTES	2565 MINUTES
		1000 MINUTES	2580 MINUTES
		1005 MINUTES	2595 MINUTES
		1010 MINUTES	2610 MINUTES
		1015 MINUTES	2625 MINUTES
		1020 MINUTES	2640 MINUTES
		1025 MINUTES	2655 MINUTES
		1030 MINUTES	2670 MINUTES
		1035 MINUTES	2685 MINUTES
		1040 MINUTES	2700 MINUTES
		1045 MINUTES	2715 MINUTES
		1050 MINUTES	2730 MINUTES
		1055 MINUTES	2745 MINUTES
		1060 MINUTES	2760 MINUTES
		1065 MINUTES	2775 MINUTES
		1070 MINUTES	2790 MINUTES
		1075 MINUTES	2805 MINUTES
		1080 MINUTES	2820 MINUTES
		1085 MINUTES	2835 MINUTES
		1090 MINUTES	2850 MINUTES
		1095 MINUTES	2865 MINUTES
		1100 MINUTES	2880 MINUTES
		1105 MINUTES	2895 MINUTES
		1110 MINUTES	2910 MINUTES
		1115 MINUTES	2925 MINUTES
		1120 MINUTES	2940 MINUTES
		1125 MINUTES	2955 MINUTES
		1130 MINUTES	2970 MINUTES
		1135 MINUTES	2985 MINUTES
		1140 MINUTES	3000 MINUTES
		1145 MINUTES	3015 MINUTES
		1150 MINUTES	3030 MINUTES
		1155 MINUTES	3045 MINUTES
		1160 MINUTES	3060 MINUTES
		1165 MINUTES	3075 MINUTES
		1170 MINUTES	3090 MINUTES
		1175 MINUTES	3105 MINUTES
		1180 MINUTES	3120 MINUTES
		1185 MINUTES	3135 MINUTES
		1190 MINUTES	3150 MINUTES
		1195 MINUTES	3165 MINUTES
		1200 MINUTES	3180 MINUTES
		1205 MINUTES	3195 MINUTES
		1210 MINUTES	3210 MINUTES
		1215 MINUTES	3225 MINUTES
		1220 MINUTES	3240 MINUTES
		1225 MINUTES	3255 MINUTES
		1230 MINUTES	3270 MINUTES
		1235 MINUTES	3285 MINUTES
		1240 MINUTES	3300 MINUTES
		1245 MINUTES	3315 MINUTES
		1250 MINUTES	3330 MINUTES
		1255 MINUTES	3345 MINUTES
		1260 MINUTES	3360 MINUTES
		1265 MINUTES	3375 MINUTES
		1270 MINUTES	3390 MINUTES
		1275 MINUTES	3405 MINUTES
		1280 MINUTES	3420 MINUTES
		1285 MINUTES	3435 MINUTES
		1290 MINUTES	3450 MINUTES
		1295 MINUTES	3465 MINUTES
		1300 MINUTES	3480 MINUTES
		1305 MINUTES	3495 MINUTES
		1310 MINUTES	3510 MINUTES
		1315 MINUTES	3525 MINUTES
		1320 MINUTES	3540 MINUTES
		1325 MINUTES	3555 MINUTES
		1330 MINUTES	3570 MINUTES
		1335 MINUTES	3585 MINUTES
		1340 MINUTES	3600 MINUTES
		1345 MINUTES	3615 MINUTES
		1350 MINUTES	3630 MINUTES
		1355 MINUTES	3645 MINUTES
		1360 MINUTES	3660 MINUTES
		1365 MINUTES	3675 MINUTES
		1370 MINUTES	3690 MINUTES
		1375 MINUTES	3705 MINUTES
		1380 MINUTES	3720 MINUTES
		1385 MINUTES	3735 MINUTES
		1390 MINUTES	3750 MINUTES
		1395 MINUTES	3765 MINUTES
		1400 MINUTES	3780 MINUTES
		1405 MINUTES	3795 MINUTES
		1410 MINUTES	3810 MINUTES
		1415 MINUTES	3825 MINUTES
		1420 MINUTES	3840 MINUTES
		1425 MINUTES	3855 MINUTES
		1430 MINUTES	3870 MINUTES
		1435 MINUTES	3885 MINUTES
		1440 MINUTES	3900 MINUTES
		1445 MINUTES	3915 MINUTES
		1450 MINUTES	3930 MINUTES
		1455 MINUTES	3945 MINUTES
		1460 MINUTES	3960 MINUTES
		1465 MINUTES	3975 MINUTES
		1470 MINUTES	3990 MINUTES
		1475 MINUTES	4005 MINUTES
		1480 MINUTES	4020 MINUTES
		1485 MINUTES	4035 MINUTES
		1490 MINUTES	4050 MINUTES
		1495 MINUTES	4065 MINUTES
		1500 MINUTES	4080 MINUTES
		1505 MINUTES	4095 MINUTES
		1510 MINUTES	4110 MINUTES
		1515 MINUTES	4125 MINUTES
		1520 MINUTES	4140 MINUTES
		1525 MINUTES	4155 MINUTES
		1530 MINUTES	4170 MINUTES
		1535 MINUTES	4185 MINUTES
		1540 MINUTES	4200 MINUTES
		1545 MINUTES	4215 MINUTES
		1550 MINUTES	4230 MINUTES
		1555 MINUTES	4245 MINUTES
		1560 MINUTES	4260 MINUTES
		1565 MINUTES	4275 MINUTES
		1570 MINUTES	4290 MINUTES
		1575 MINUTES	4305 MINUTES
		1580 MINUTES	4320 MINUTES
		1585 MINUTES	4335 MINUTES
		1590 MINUTES	4350 MINUTES
		1595 MINUTES	4365 MINUTES
		1600 MINUTES	4380 MINUTES
		1605 MINUTES	4395 MINUTES
		1610 MINUTES	4410 MINUTES
		1615 MINUTES	4425 MINUTES
		1620 MINUTES	4440 MINUTES
		1625 MINUTES	4455 MINUTES
		1630 MINUTES	4470 MINUTES
		1635 MINUTES	4485 MINUTES
		1640 MINUTES	4500 MINUTES
		1645 MINUTES	4515 MINUTES
		1650 MINUTES	4530 MINUTES
		1655 MINUTES	4545 MINUTES



Ontario

Ministry
of the
Environment

The Ontario Water Resources Act

WATER WELL RECORD

5110516

MUNICIP

51024

CON

Can

05

1. PRINT ONLY IN SPACES PROVIDED

2. CHECK ☒ CORRECT BOX WHERE APPLICABLE

11

COUNTY OR DISTRICT	TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE	CON. BLOCK, TRACT, SURVEY, ETC.	DATE COMPLETED
		CON 5	DAY 03 MO 06 YR 81
#3, Millbrook, Ontario			
92800	4	0825	5
24			

LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

GENERAL COLOUR	MOST COMMON MATERIAL	OTHER MATERIALS	GENERAL DESCRIPTION	DEPTH - FEET	
				FROM	TO
			TOP SOIL	0	1
WHITE	CLAY	STONES		1	37
BROWN	GRAVEL		COARSE	37	44
WHITE	CLAY			44	102
BROWN	GRAVEL	SAND	FINE	102	115
BROWN	SAND	GRAVEL	FINE	115	119

31	0001	02	0037	10512	0044	631	0102	105	0119	62908
32										

WATER RECORD	
WATER FOUND AT - FEET	KIND OF WATER
10-13	1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR
15-18	2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
20-23	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR
25-28	2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL
30-33	1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR
	2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL

CASING & OPEN HOLE RECORD	
INSIDE DIAM. INCHES	MATERIAL
10-11	1 <input checked="" type="checkbox"/> STEEL
12-13	2 <input type="checkbox"/> GALVANIZED
14-15	3 <input type="checkbox"/> CONCRETE
16-17	4 <input type="checkbox"/> OPEN HOLE
18-19	1 <input type="checkbox"/> STEEL
20-21	2 <input type="checkbox"/> GALVANIZED
22-23	3 <input type="checkbox"/> CONCRETE
24-25	4 <input type="checkbox"/> OPEN HOLE
26-27	1 <input type="checkbox"/> STEEL
28-29	2 <input type="checkbox"/> GALVANIZED
30-31	3 <input type="checkbox"/> CONCRETE
32-33	4 <input type="checkbox"/> OPEN HOLE

SCREEN	SIZE OF OPENING (SLOT NO.)	DIAMETER	LENGTH
	014	06000	08
	Slot #14		8+2"
	MATERIAL AND TYPE	DEPTH OF SCREEN	
	Stainless Steel	110'10"	

PLUGGING & SEALING RECORD	
DEPTH SET AT - FEET	MATERIAL AND TYPE
10-13	14-17
18-21	22-25
26-29	30-33

PUMPING TEST METHOD		PUMPING RATE	DURATION OF PUMPING
1 <input type="checkbox"/> PUMP	2 <input checked="" type="checkbox"/> BAILER	0006	04
STATIC LEVEL	WATER LEVEL END OF PUMPING	WATER LEVELS DURING	1 <input type="checkbox"/> PUMPING
19-21	22-24	15 MINUTES	2 <input type="checkbox"/> RECOVERY
049 FEET	113 FEET	26-28	29-31
IF FLOWING, GIVE RATE	PUMP INTAKE SET AT	32-34	35-37
	GPM	FEET	FEET
RECOMMENDED PUMP TYPE	RECOMMENDED PUMP SETTING	RECOMMENDED PUMPING RATE	
<input type="checkbox"/> SHALLOW	<input checked="" type="checkbox"/> DEEP		

FINAL STATUS OF WELL	
1 <input checked="" type="checkbox"/> WATER SUPPLY	5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY
2 <input type="checkbox"/> OBSERVATION WELL	6 <input type="checkbox"/> ABANDONED, POOR QUALITY
3 <input type="checkbox"/> TEST HOLE	7 <input type="checkbox"/> UNFINISHED
4 <input type="checkbox"/> RECHARGE WELL	
WATER USE	
1 <input checked="" type="checkbox"/> DOMESTIC	5 <input type="checkbox"/> COMMERCIAL
2 <input type="checkbox"/> STOCK	6 <input type="checkbox"/> MUNICIPAL
3 <input type="checkbox"/> IRRIGATION	7 <input type="checkbox"/> PUBLIC SUPPLY
4 <input type="checkbox"/> INDUSTRIAL	8 <input type="checkbox"/> COOLING OR AIR CONDITIONING
<input type="checkbox"/> OTHER	9 <input type="checkbox"/> NOT USED
METHOD OF DRILLING	
1 <input checked="" type="checkbox"/> CABLE TOOL	6 <input type="checkbox"/> BORING
2 <input type="checkbox"/> ROTARY (CONVENTIONAL)	7 <input type="checkbox"/> DIAMOND
3 <input type="checkbox"/> ROTARY (REVERSE)	8 <input type="checkbox"/> JETTING
4 <input type="checkbox"/> ROTARY (AIR)	9 <input type="checkbox"/> DRIVING
5 <input type="checkbox"/> AIR PERCUSSION	

LOCATION OF WELL	
IN DIAGRAM BELOW SHOW DISTANCES OF WELL FROM ROAD AND LOT LINE. INDICATE NORTH BY ARROW.	
DRILLER'S REMARKS	
2. 211 000	

CONTRACTOR	NAME OF WELL CONTRACTOR	LICENCE NUMBER
	ROBERT RUTH WELLDRIILLING LTD.	4635
	ADDRESS	
	R. R. #2, CAVAN, Ont.	705-799-5343
	NAME OF DRILLER OR BORER	LICENCE NUMBER
	same	
	SIGNATURE OF CONTRACTOR	SUBMISSION DATE
	Robert Ruth	DAY 30 MO 9 YR 81

OFFICE USE ONLY	DATA SOURCE	CONTRACTOR	DATE RECEIVED
	1	4635	09 07 82
	DATE OF INSPECTION	INSPECTOR	
	REMARKS		

CSS.ES

Address of Well Location (Street Number/Name) 893 Fallis Line		Township Caven	Lot pt. 12	Concession 5
County/District/Municipality Peterborough		City/Town/Village Millbrook	Province Ontario	Postal Code L0A 1G0
UTM Coordinates NAD 83	Zone 17	Easting 703452	Northings 4892976	Municipal Plan and Sublot Number

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	To
Brown	Clay	Stones	Hard	0	15
Brown	Sand	Gravel	Loose	15	38
Grey	Clay	Hard	Dense	38	110
Grey	Silt	Clay	Soft	110	168
Grey	Clay		Hard	168	195
Grey	Sand	Silt	Fine	195	203
Grey	Sand		Fine - Sharp	203	208

Annular Space			
Depth Set at (m/ft) From	To	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
0	20	Wyoben	

Method of Construction	Well Use
<input type="checkbox"/> Cable Tool <input checked="" type="checkbox"/> Rotary (Conventional) <input type="checkbox"/> Rotary (Reverse) <input type="checkbox"/> Boring <input type="checkbox"/> Air percussion <input type="checkbox"/> Other, specify _____	<input type="checkbox"/> Public <input checked="" type="checkbox"/> Domestic <input type="checkbox"/> Livestock <input type="checkbox"/> Industrial <input type="checkbox"/> Other, specify _____

Construction Record - Casing				Status of Well
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft) From	To
6 1/4	Steel	219	0	203

Construction Record - Screen				Status of Well
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft) From	To
5 1/2	S. Steel	8	203	208

Water Details		Hole Diameter	
Water found at Depth (m/ft)	Kind of Water: <input checked="" type="checkbox"/> Fresh <input type="checkbox"/> Untested	Depth (m/ft) From	To
208	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	0	20

Business Name of Well Contractor Roger Boadway Ent. Ltd.		Well Contractor's Licence No. 114113
Business Address (Street Number/Name) P.O. Box 397, Sutton West		Municipality York
Province ON	Postal Code L0E1R0	Business E-mail Address boadwaywells@bellnet.ca
Bus. Telephone No. (inc. area code) 9057225362		
Name of Well Technician (Last Name, First Name) Boadway Grant		
Well Technician's Licence No. 0029	Signature of Technician and/or Contractor [Signature]	Date Submitted 2011/10/04

Results of Well Yield Testing			
After test of well yield, water was: <input checked="" type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____		Draw Down	
If pumping discontinued, give reason:		Time (min)	Water Level (m/ft)
Pump intake set at (m/ft) 175		1	1
Pumping rate (l/min / GPM) 10		2	2
Duration of pumping 1 hrs + _____ min		3	3
Final water level end of pumping (m/ft) 175		4	4
If flowing give rate (l/min / GPM)		5	5
Recommended pump depth (m/ft) 175		10	10
Recommended pump rate (l/min / GPM) 8		15	15
Well production (l/min / GPM) 10		20	20
Disinfected? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		25	25
		30	30
		40	40
		50	50
		60	60


Map of Well Location

Please provide a map below following instructions on the back.

Well owner's information package delivered <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Date Package Delivered Y Y Y Y M M D D 2011 07 12	Ministry Use Only Audit No. z128143 OCT 14 2011
---	---	--

Appendix C

Hydraulic Conductivity Data

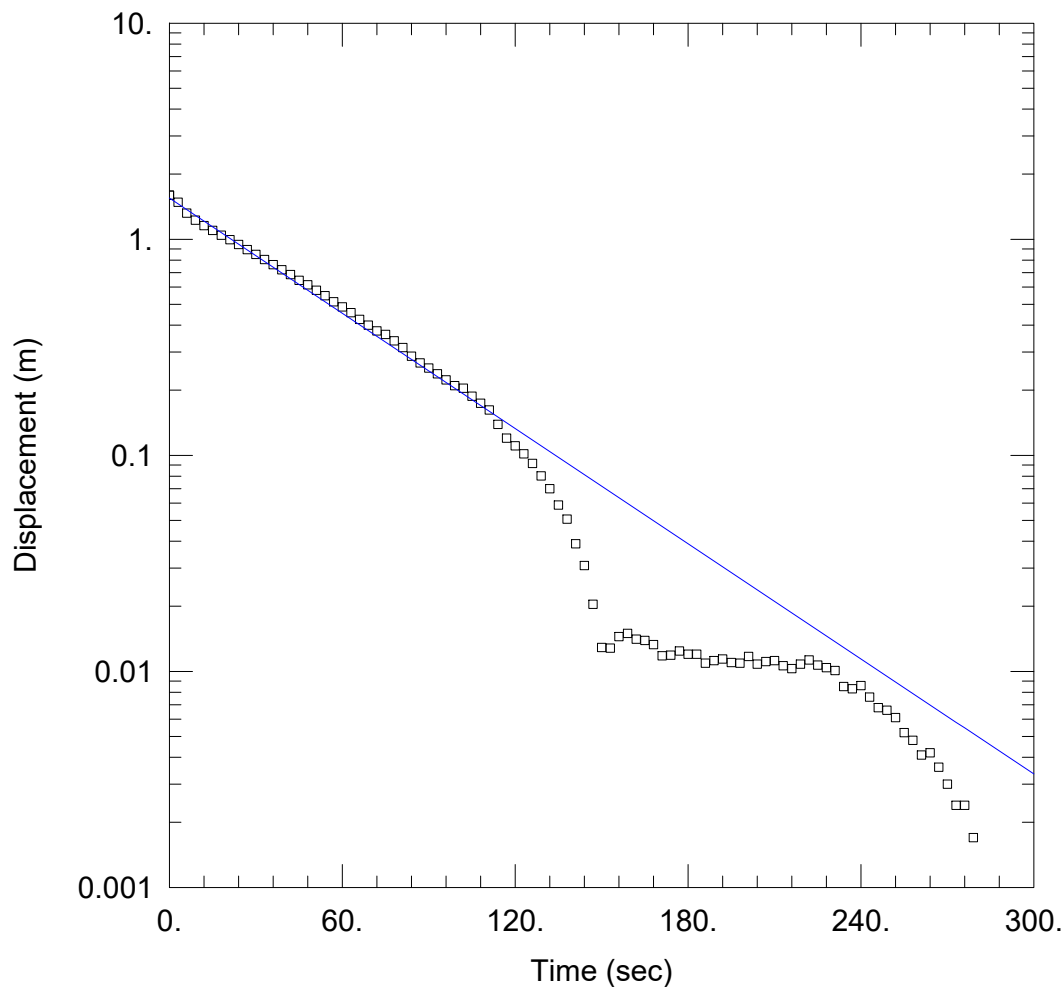

BH-4 FALLING HEAD TEST

Data Set: G:\...\BH-4 Falling Head Test 1.aqt

Date: 06/09/20

Time: 10:41:39

PROJECT INFORMATION

Company: GHD

Client: Vargas Developments

Project: 11209539-01

Location: Millbrook, ON

Test Well: BH-4

Test Date: March 18, 2020

AQUIFER DATA

Saturated Thickness: 1.6 m

Anisotropy Ratio (K_z/K_r): 1.

WELL DATA (New Well)

Initial Displacement: 1.599 m

Static Water Column Height: 0. m

Total Well Penetration Depth: 1.6 m

Screen Length: 1.52 m

Casing Radius: 0.0254 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Unconfined

Solution Method: Bouwer-Rice

$K = 0.001377$ cm/sec

$y_0 = 1.549$ m

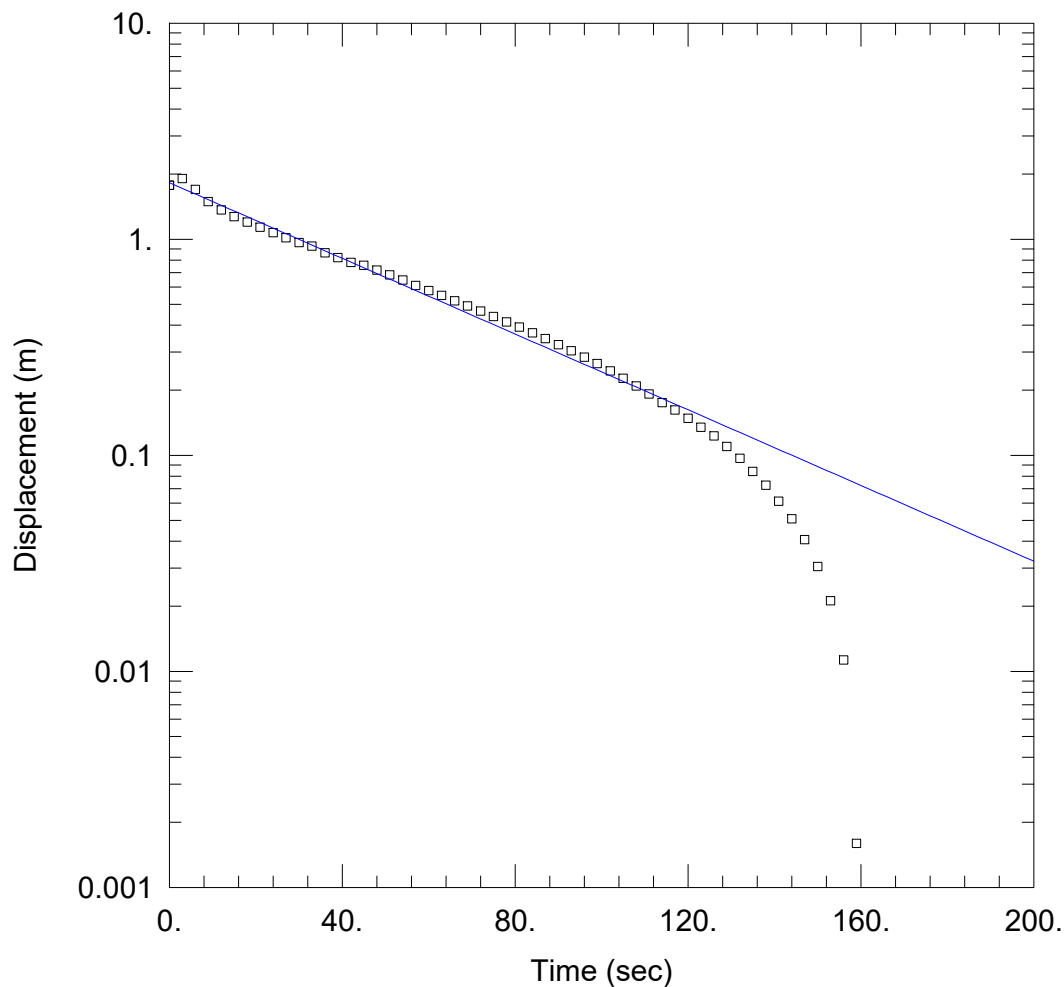

BH-4 FALLING HEAD TEST 2

Data Set: G:\...\BH-4 Falling Head Test 2.aqt

Date: 06/09/20

Time: 10:43:23

PROJECT INFORMATION

Company: GHD

Client: Vargas Developments

Project: 11209539-01

Location: Millbrook, ON

Test Well: BH-4

Test Date: March 18, 2020

AQUIFER DATA

Saturated Thickness: 1.8 m

Anisotropy Ratio (K_z/K_r): 1.

WELL DATA (BH-4)

Initial Displacement: 1.777 m

Total Well Penetration Depth: 1.8 m

Casing Radius: 0.0254 m

Static Water Column Height: 0. m

Screen Length: 1.52 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Unconfined

$K = 0.00139$ cm/sec

Solution Method: Bouwer-Rice

$y_0 = 1.827$ m

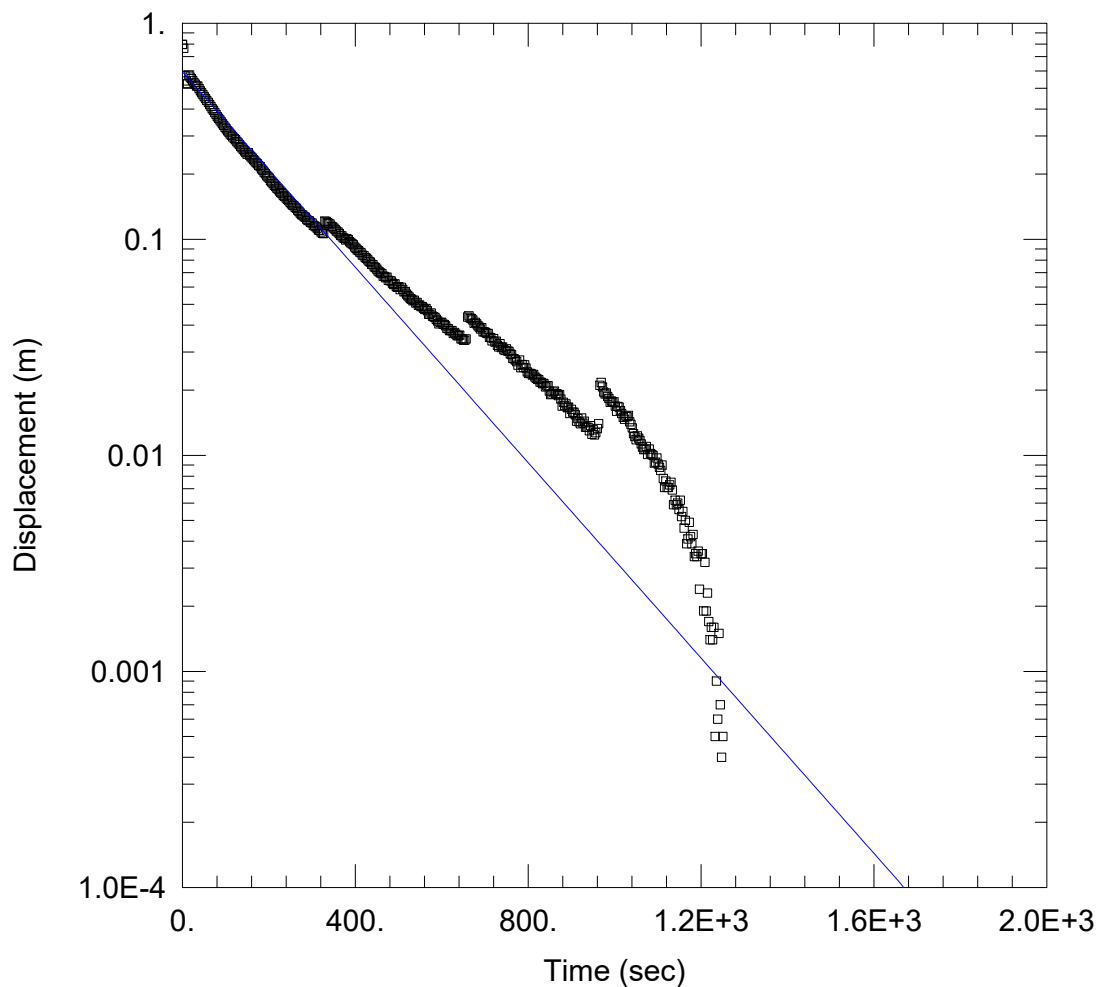

BH-7 FALLING HEAD TEST 1

Data Set: G:\...\BH-7 Falling Head Test 1.aqt

Date: 06/09/20

Time: 10:47:49

PROJECT INFORMATION

Company: GHD

Client: Vargas Developments

Project: 11209539-01

Location: Millbrook, ON

Test Well: BH-7

Test Date: March 18, 2020

AQUIFER DATA

Saturated Thickness: 5.96 m

Anisotropy Ratio (K_z/K_r): 1.

WELL DATA (BH-7)

Initial Displacement: 0.7969 m

Total Well Penetration Depth: 5.96 m

Casing Radius: 0.0254 m

Static Water Column Height: 5.96 m

Screen Length: 1.52 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Unconfined

$K = 0.0004394$ cm/sec

Solution Method: Bouwer-Rice

$y_0 = 0.5946$ m

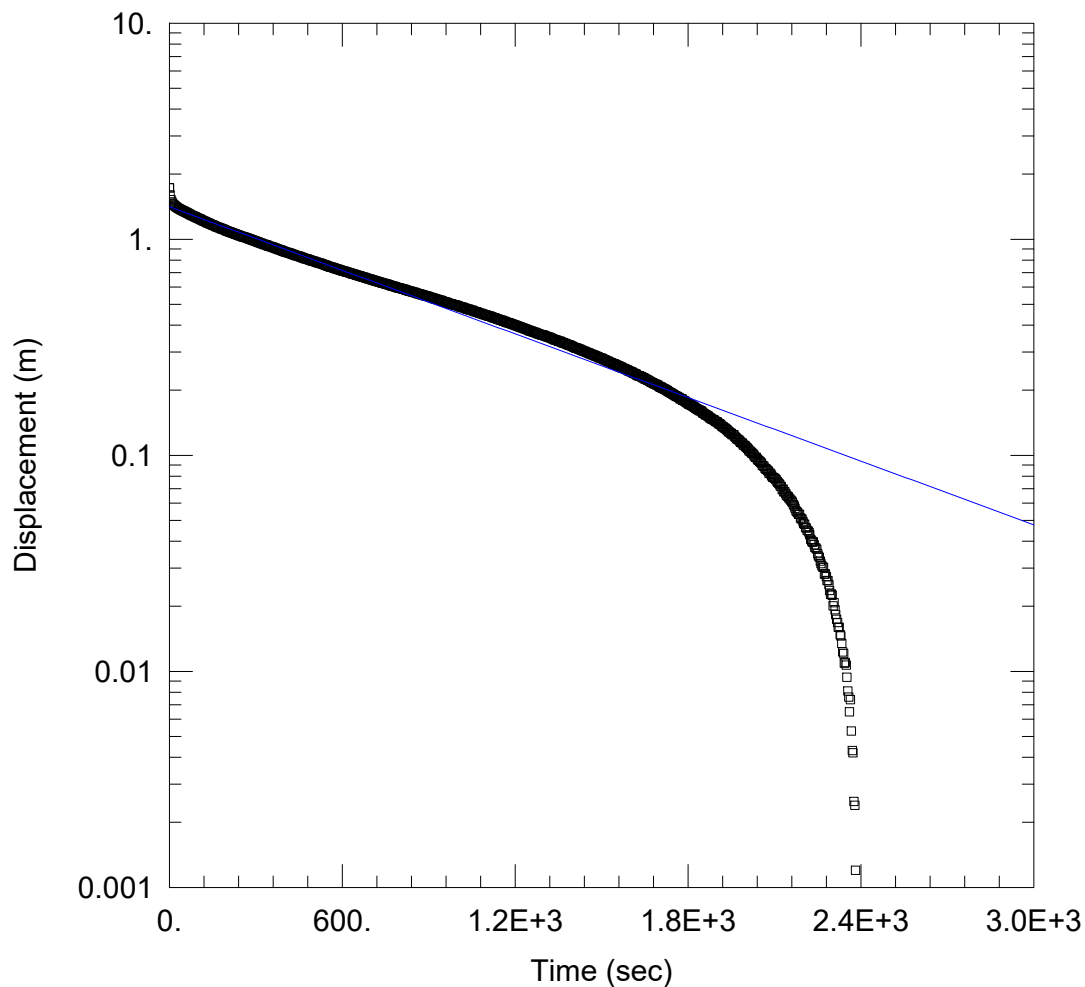

BH-7 FALLING HEAD TEST 2

Data Set: G:\...\BH-7 Falling Head Test 2.aqt

Date: 06/09/20

Time: 10:50:55

PROJECT INFORMATION

Company: GHD

Client: Vargas Developments

Project: 11209539-01

Location: Millbrook, ON

Test Well: BH-7

Test Date: March 18, 2020

AQUIFER DATA

Saturated Thickness: 5.96 m

Anisotropy Ratio (K_z/K_r): 1.

WELL DATA (BH-7)

Initial Displacement: 1.731 m

Total Well Penetration Depth: 5.96 m

Casing Radius: 0.0254 m

Static Water Column Height: 5.96 m

Screen Length: 1.52 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Unconfined

$K = 9.538E-5$ cm/sec

Solution Method: Bouwer-Rice

$y_0 = 1.414$ m

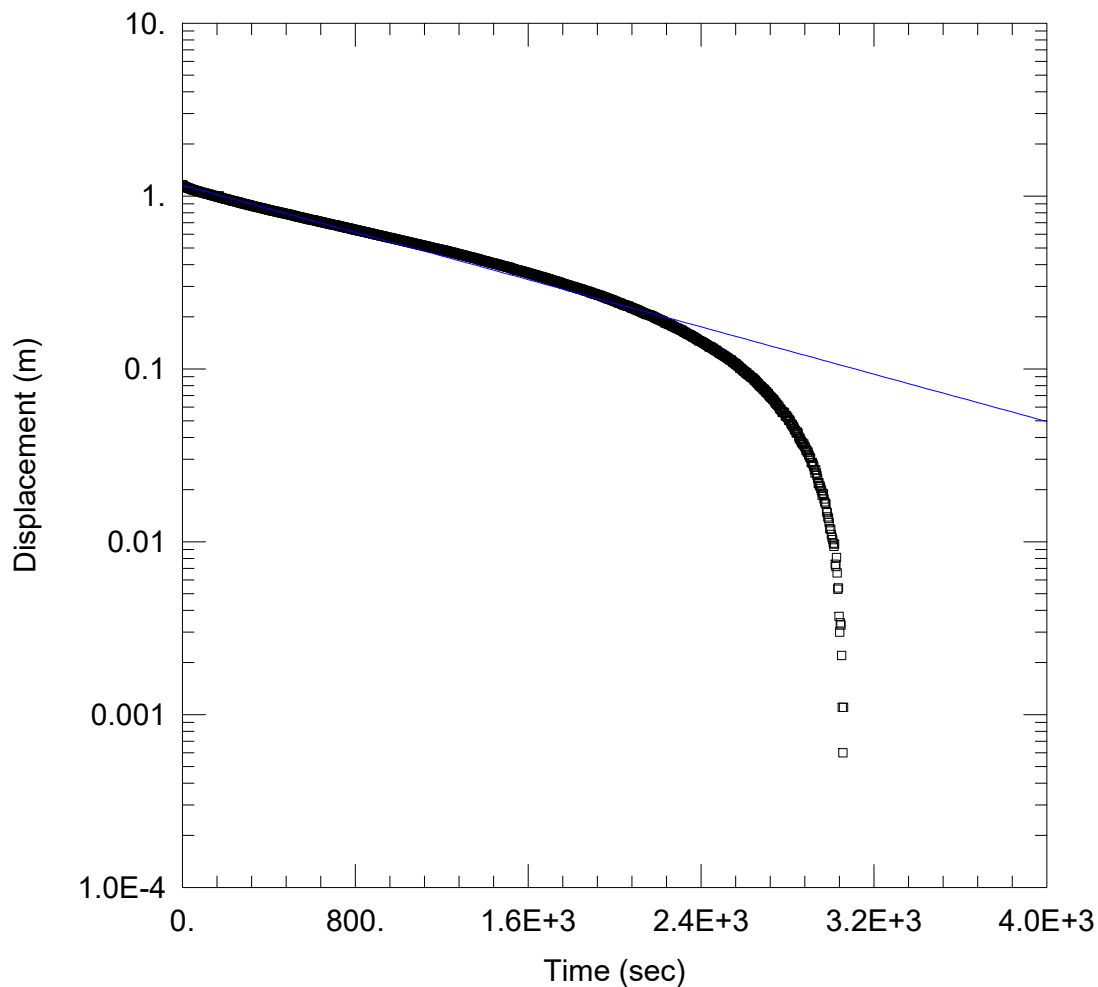

BH-7 FALLING HEAD TEST 3

Data Set: G:\...\BH-7 Falling Head Test 3.aqt

Date: 06/09/20

Time: 10:53:08

PROJECT INFORMATION

Company: GHD

Client: Vargas Developments

Project: 11209539-01

Location: Millbrook, ON

Test Well: BH-7

Test Date: March 18, 2020

AQUIFER DATA

Saturated Thickness: 5.96 m

Anisotropy Ratio (K_z/K_r): 1.

WELL DATA (BH-7)

Initial Displacement: 1.164 m

Total Well Penetration Depth: 5.96 m

Casing Radius: 0.0254 m

Static Water Column Height: 5.96 m

Screen Length: 1.52 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Unconfined

$K = 6.647E-5$ cm/sec

Solution Method: Bouwer-Rice

$y_0 = 1.157$ m

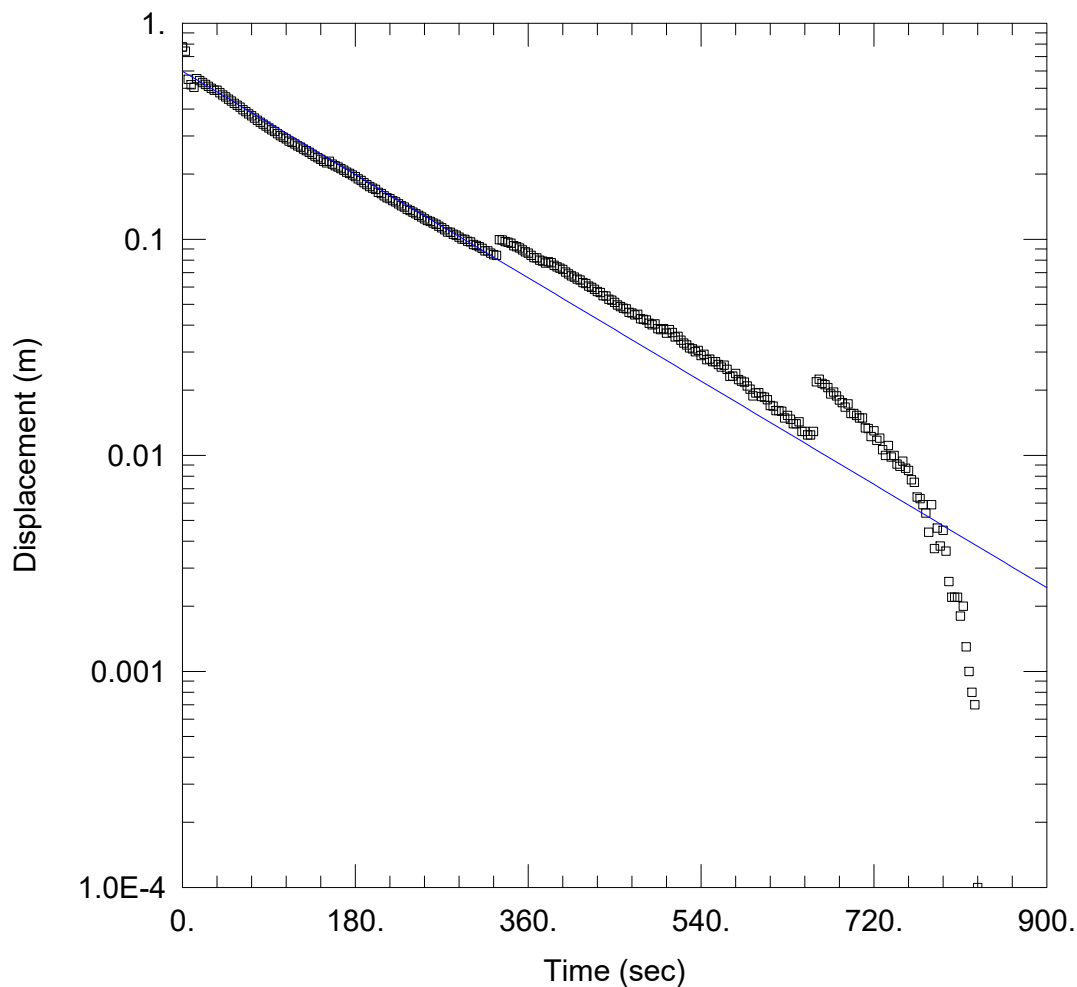

BH-13 FALLING HEAD TEST

Data Set: G:\...\BH-13 Falling Head Test.aqt

Date: 06/15/20

Time: 08:21:00

PROJECT INFORMATION

Company: GHD

Client: Vargas Developments

Project: 11209539-01

Location: Millbrook, ON

Test Well: BH-13

Test Date: April 24, 2020

AQUIFER DATA

Saturated Thickness: 3.97 m

Anisotropy Ratio (K_z/K_r): 1.

WELL DATA (BH-13)

Initial Displacement: 0.7752 m

Total Well Penetration Depth: 3.97 m

Casing Radius: 0.0254 m

Static Water Column Height: 3.97 m

Screen Length: 1.52 m

Well Radius: 0.0254 m


SOLUTION

Aquifer Model: Unconfined

$K = 0.000485$ cm/sec

Solution Method: Bouwer-Rice

$y_0 = 0.5991$ m

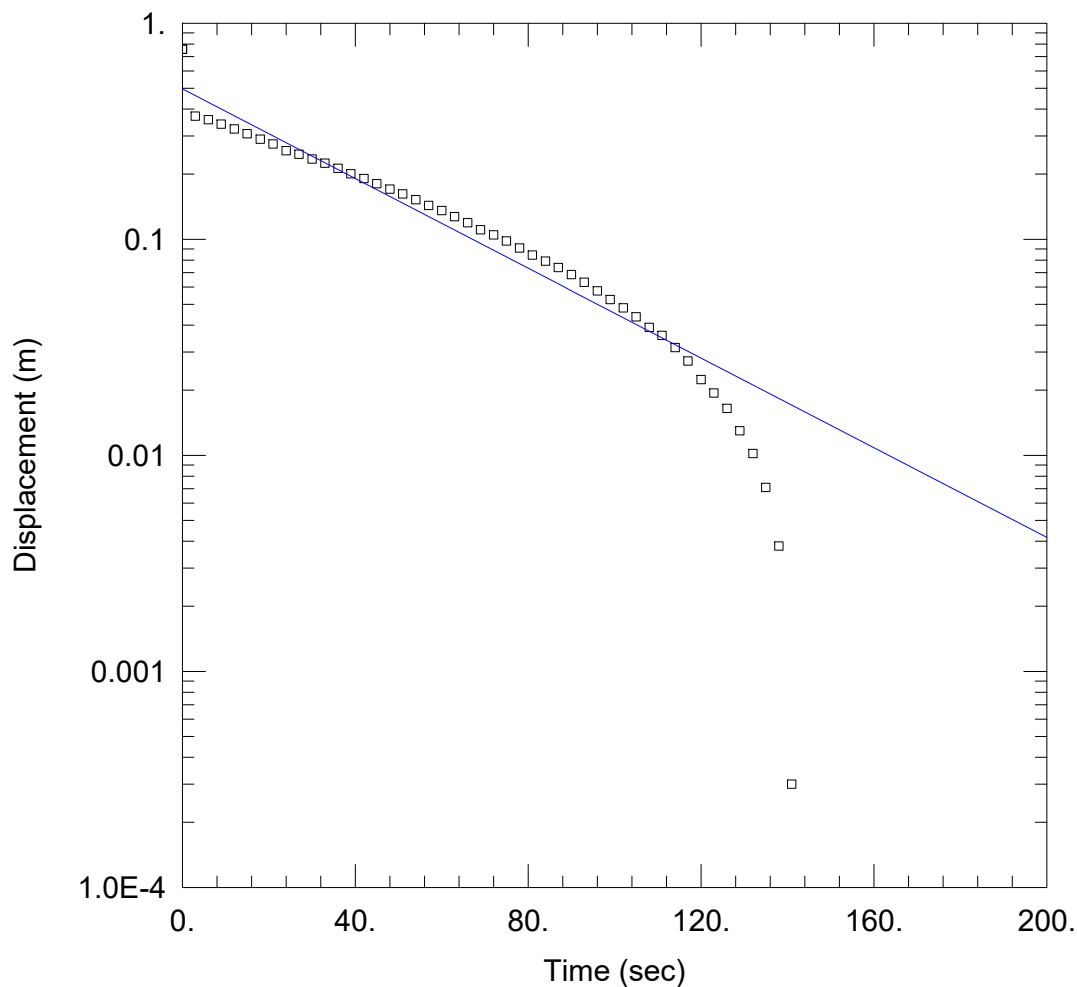

BH-13 RISING HEAD TEST

Data Set: G:\...\BH-13 Rising Head Test.aqt

Date: 06/15/20

Time: 08:22:26

PROJECT INFORMATION

Company: GHD

Client: Vargas Developments

Project: 11209539-01

Location: Millbrook, ON

Test Well: BH-13

Test Date: April 24, 2020

AQUIFER DATA

Saturated Thickness: 3.97 m

Anisotropy Ratio (K_z/K_r): 1.

WELL DATA (BH-13)

Initial Displacement: 0.7569 m

Total Well Penetration Depth: 3.97 m

Casing Radius: 0.0254 m

Static Water Column Height: 3.97 m

Screen Length: 1.52 m

Well Radius: 0.0254 m

SOLUTION

Aquifer Model: Unconfined

$K = 0.001895$ cm/sec

Solution Method: Bouwer-Rice

$y_0 = 0.4959$ m

Project No. 11209539-01
Date: March 6, 2020
Equipment: ETC Pask Permeameter

Date: March 6, 2020

Equipment: ETC Pask Permeameter

TP-2

0.6 m

1.2 m

0.15 m

0.6 m

0.3 m

0.6 m

Quasi Steady Flow Rate ® (cm/min)	7	1.2	N/A	N/A	0.25	N/A
Field-saturated Hydraulic Conductivity (Ksf) (m/sec)	3.70E-05	6.40E-06	N/A	N/A	1.30E-06	N/A

6.40E-06

Appendix D

Analytical Data

C.O.C.: G88320

REPORT No. B20-07670

Report To:

GHD Limited

455 Phillip Street,
Waterloo Ontario N2L 3X2 Canada

Attention: Jamie McEachern

Caduceon Environmental Laboratories

110 West Beaver Creek Rd Unit 14
Richmond Hill ON L4B 1J9

Tel: 289-475-5442

Fax: 289-562-1963

DATE RECEIVED: 23-Mar-20

JOB/PROJECT NO.: Vargas/11209539-01

DATE REPORTED: 25-Mar-20

P.O. NUMBER: 73519407

SAMPLE MATRIX: Groundwater

WATERWORKS NO.

			Client I.D.	W - 1	W - 2	W - 3	
			Sample I.D.	B20-07670-1	B20-07670-2	B20-07670-3	
			Date Collected	19-Mar-20	19-Mar-20	19-Mar-20	
Parameter	Units	R.L.	Reference Method	Date/Site Analyzed			
pH @25°C	pH Units		SM 4500H	24-Mar-20/O	7.81	7.98	8.00
Conductivity @25°C	µmho/cm	1	SM 2510B	24-Mar-20/O	168	749	548
Alkalinity(CaCO ₃) to pH4.5	mg/L	5	SM 2320B	24-Mar-20/O	73	230	246
Hardness (as CaCO ₃)	mg/L	1	SM 3120	24-Mar-20/O	79	335	309
Chloride	mg/L	0.5	SM4110C	24-Mar-20/O	5.0	71.7	11.7
Fluoride	mg/L	0.1	SM4110C	24-Mar-20/O	< 0.1	< 0.1	< 0.1
Nitrite (N)	mg/L	0.1	SM4110C	24-Mar-20/O	< 0.1	< 0.1	< 0.1
Nitrate (N)	mg/L	0.1	SM4110C	24-Mar-20/O	0.1	5.1	3.0
Sulphate	mg/L	1	SM4110C	24-Mar-20/O	< 1	24	4
Colour	TCU	2	SM 2120C	25-Mar-20/O	4	< 2	2
Turbidity	NTU	0.1	SM 2130	25-Mar-20/O	274	30.1	0.8
Ammonia + Ammonium (N)	mg/L	0.01	SM4500-NH ₃ -H	25-Mar-20/K	0.31	< 0.01	< 0.01
o-Phosphate (P)	mg/L	0.002	PE4500-S	25-Mar-20/K	0.008	0.006	0.029
Potassium	mg/L	0.1	SM 3120	24-Mar-20/O	4.3	1.1	0.9
Sodium	mg/L	0.2	SM 3120	24-Mar-20/O	2.8	35.9	6.7
Calcium	mg/L	0.02	SM 3120	24-Mar-20/O	28.8	104	113
Magnesium	mg/L	0.02	SM 3120	24-Mar-20/O	1.65	18.2	6.41
Iron	mg/L	0.005	SM 3120	24-Mar-20/O	< 0.005	< 0.005	< 0.005
Copper	mg/L	0.002	SM 3120	24-Mar-20/O	< 0.002	0.002	< 0.002
Manganese	mg/L	0.001	SM 3120	24-Mar-20/O	0.245	0.001	< 0.001
Zinc	mg/L	0.005	SM 3120	24-Mar-20/O	0.028	0.009	< 0.005
Anion Sum	meq/L		Calc.	25-Mar-20/O	1.61	7.49	5.53
Cation Sum	meq/L		Calc.	25-Mar-20/O	1.81	8.28	6.48
% Difference	%		Calc.	25-Mar-20/O	6.07	4.98	7.88



Christine Burke
Lab Manager

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

C.O.C.: G88320

REPORT No. B20-07670

Report To:

GHD Limited

455 Phillip Street,
Waterloo Ontario N2L 3X2 Canada

Attention: Jamie McEachern

Caduceon Environmental Laboratories

110 West Beaver Creek Rd Unit 14
Richmond Hill ON L4B 1J9

Tel: 289-475-5442

Fax: 289-562-1963

DATE RECEIVED: 23-Mar-20

JOB/PROJECT NO.: Vargas/11209539-01

DATE REPORTED: 25-Mar-20

P.O. NUMBER: 73519407

SAMPLE MATRIX: Groundwater

WATERWORKS NO.

			Client I.D.	W - 1	W - 2	W - 3	
			Sample I.D.	B20-07670-1	B20-07670-2	B20-07670-3	
			Date Collected	19-Mar-20	19-Mar-20	19-Mar-20	
Parameter	Units	R.L.	Reference Method	Date/Site Analyzed			
Ion Ratio	AS/CS		Calc.	25-Mar-20/O	0.886	0.905	0.854
Sodium Adsorption Ratio	-		Calc.	25-Mar-20/O	0.137	0.854	0.165
TDS(ion sum calc.)	mg/L	1	Calc.	25-Mar-20/O	87	416	303
Conductivity (calc.)	µmho/cm		Calc.	25-Mar-20/O	172	771	567
TDS(calc.)/EC(actual)	-		Calc.	25-Mar-20/O	0.518	0.555	0.553
EC(calc.)/EC(actual)	-		Calc.	25-Mar-20/O	1.02	1.03	1.03
Langelier Index(25°C)	S.I.		Calc.	25-Mar-20/O	-0.231	0.897	1.00



Christine Burke
Lab Manager

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

C.O.C.: G93831

REPORT No. B20-11183

Report To:

GHD Limited

455 Phillip Street,
Waterloo Ontario N2L 3X2 Canada

Attention: Wesley Moore

Caduceon Environmental Laboratories

110 West Beaver Creek Rd Unit 14
Richmond Hill ON L4B 1J9

Tel: 289-475-5442

Fax: 289-562-1963

DATE RECEIVED: 29-Apr-20

JOB/PROJECT NO.: Vargas Dev Millbrook/11209539-01

DATE REPORTED: 05-May-20

P.O. NUMBER: 73519407

SAMPLE MATRIX: Groundwater

WATERWORKS NO.

			Client I.D.	BH-7	BH-13		
			Sample I.D.	B20-11183-1	B20-11183-2		
			Date Collected	24-Apr-20	24-Apr-20		
Parameter	Units	R.L.	Reference Method	Date/Site Analyzed			
pH @25°C	pH Units		SM 4500H	30-Apr-20/O	8.02	7.81	
Conductivity @25°C	µmho/cm	1	SM 2510B	30-Apr-20/O	433	435	
Alkalinity(CaCO ₃) to pH4.5	mg/L	5	SM 2320B	30-Apr-20/O	209	216	
Hardness (as CaCO ₃)	mg/L	1	SM 3120	30-Apr-20/O	265	261	
Chloride	mg/L	0.5	SM4110C	04-May-20/O	4.2	4.1	
Fluoride	mg/L	0.1	SM4110C	04-May-20/O	< 0.1	< 0.1	
Nitrite (N)	mg/L	0.1	SM4110C	04-May-20/O	< 0.1	< 0.1	
Nitrate (N)	mg/L	0.1	SM4110C	04-May-20/O	< 0.1	< 0.1	
Sulphate	mg/L	1	SM4110C	04-May-20/O	7	7	
Colour	TCU	2	SM 2120C	01-May-20/O	< 2	5	
Turbidity	NTU	0.1	SM 2130	30-Apr-20/O	17.8	1180	
Ammonia + Ammonium (N)	mg/L	0.01	SM4500-NH ₃ -H	30-Apr-20/K	0.03	0.05	
o-Phosphate (P)	mg/L	0.002	PE4500-S	30-Apr-20/K	< 0.002	0.040	
Potassium	mg/L	0.1	SM 3120	30-Apr-20/O	1.4	1.3	
Sodium	mg/L	0.2	SM 3120	30-Apr-20/O	4.1	4.0	
Calcium	mg/L	0.02	SM 3120	30-Apr-20/O	93.2	91.5	
Magnesium	mg/L	0.02	SM 3120	30-Apr-20/O	7.84	7.73	
Iron	mg/L	0.005	SM 3120	30-Apr-20/O	0.187	0.082	
Copper	mg/L	0.002	SM 3120	30-Apr-20/O	< 0.002	< 0.002	
Manganese	mg/L	0.001	SM 3120	30-Apr-20/O	0.030	0.026	
Zinc	mg/L	0.005	SM 3120	30-Apr-20/O	< 0.005	< 0.005	
Anion Sum	meq/L		Calc.	05-May-20/O	4.43	4.58	
Cation Sum	meq/L		Calc.	05-May-20/O	5.52	5.42	
% Difference	%		Calc.	05-May-20/O	10.9	8.36	

Christine Burke
Lab Manager

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

C.O.C.: G93831

REPORT No. B20-11183

Report To:

GHD Limited

455 Phillip Street,
Waterloo Ontario N2L 3X2 Canada

Attention: Wesley Moore

Caduceon Environmental Laboratories

110 West Beaver Creek Rd Unit 14
Richmond Hill ON L4B 1J9

Tel: 289-475-5442

Fax: 289-562-1963

DATE RECEIVED: 29-Apr-20

DATE REPORTED: 05-May-20

SAMPLE MATRIX: Groundwater

JOB/PROJECT NO.: Vargas Dev Millbrook/11209539-01

P.O. NUMBER: 73519407

WATERWORKS NO.

			Client I.D.	BH-7	BH-13		
			Sample I.D.	B20-11183-1	B20-11183-2		
			Date Collected	24-Apr-20	24-Apr-20		
Parameter	Units	R.L.	Reference Method	Date/Site Analyzed			
Ion Ratio	AS/CS		Calc.	05-May-20/O	0.803	0.846	
Sodium Adsorption Ratio	-		Calc.	05-May-20/O	0.109	0.109	
TDS(ion sum calc.)	mg/L	1	Calc.	05-May-20/O	243	246	
Conductivity (calc.)	µmho/cm		Calc.	05-May-20/O	468	469	
TDS(calc.)/EC(actual)	-		Calc.	05-May-20/O	0.562	0.565	
EC(calc.)/EC(actual)	-		Calc.	05-May-20/O	1.08	1.08	
Langelier Index(25°C)	S.I.		Calc.	05-May-20/O	0.877	0.674	

1 Outside of 10% Acceptance Criteria



Christine Burke
Lab Manager

R.L. = Reporting Limit

Test methods may be modified from specified reference method unless indicated by an *

Site Analyzed=K-Kingston,W-Windsor,O-Ottawa,R-Richmond Hill,B-Barrie

The analytical results reported herein refer to the samples as received. Reproduction of this analytical report in full or in part is prohibited without prior consent from Caduceon Environmental Laboratories.

Appendix E

Water Balance Calculations

Appendix E.1

Revised Water Budget (Thornthwaite Method) - Average Values*

Weather Station: Peterborough A

Climate Station: 6166418

Elevation: 191 masl

Distance Away: ~ 10.2 km

Month	Mean Temperature (°C)	Heat Index	Unadjusted Potential ET (mm)	Daylight Correction Factor	Adjusted ET (mm)	Total Precipitation (mm)
January	-8.5	0	0	0.78	0	57.4
February	-7.5	0	0	0.88	0	51.5
March	-1.8	0	0	0.99	0	56.1
April	5.9	1.28	28.8	1.12	32.2	68.6
May	12.1	3.81	60.1	1.22	73.3	81.5
June	17	6.38	85.1	1.28	109.0	79.9
July	19.6	7.91	98.5	1.25	123.1	70.6
August	18.3	7.13	91.8	1.15	105.6	77
September	13.9	4.70	69.2	1.04	72.0	85.3
October	7.5	1.85	36.8	0.92	33.8	76.9
November	1.9	0.23	9.0	0.8	7.2	86.4
December	-4.4	0	0	0.76	0	64.2
TOTAL	6.2	33.3	479.3		556.2	855.4
TOTAL WATER SURPLUS: 299.2 mm						

Notes:

*Average values of precipitation were used. Average values of temperature were also used.

Appendix E.2
Water Budget Pre-Development

Catchment Designation	PRE-DEVELOPMENT SITE			TOTAL
	Agricultural Areas	Naturalized Areas	Forested Areas	
Area (m ²)	60222	80027	154540	294789
Pervious Area (m ²)	60222	80027	154540	294789
% Pervious	20.4%	27.1%	52.4%	100.0%
Impervious Area (m ²)	0	0	0	0
% Impervious	0%	0%	0%	0.0%
INFILTRATION FACTORS				
Topography Infiltration Factor	0.1	0.1	0.1	
Soil Infiltration Factor	0.2	0.2	0.2	
Land Cover Infiltration Factor	0.1	0.15	0.2	
MECP Infiltration Factor	0.4	0.45	0.5	
Actual Infiltration Factor	0.4	0.45	0.5	
Runoff Coefficient	0.6	0.55	0.5	
Runoff from Impervious Surfaces*	0	0	0	
INPUTS (PER UNIT AREA)				
Precipitation (mm/yr)	855	855	855	855
Run On (mm/yr)	0	0	0	0
Other Inputs (mm/yr)	0	0	0	0
Total Inputs (mm/yr)	855	855	855	855
OUTPUTS (PER UNIT AREA)				
Precipitation Surplus (mm/yr)	299	299	299	299
Net Surplus (mm/yr)	299	299	299	299
Evapotranspiration (mm/yr)	556	556	556	556
Infiltration (mm/yr)	120	135	150	139
Rooftop Infiltration (mm/yr)	0	0	0	0
Total Infiltration (mm/yr)	120	135	150	139
Runoff Pervious Areas	180	165	150	160
Runoff Impervious Areas	0	0	0	0
Total Runoff (mm/yr)	180	165	150	160
Total Outputs (mm/yr)	855	855	855	855
Difference (Inputs - Outputs)	0	0	0	0
INPUTS (VOLUMES)				
Precipitation (m ³ /yr)	51514	68455	132194	252163
Run On (m ³ /yr)	0	0	0	0
Other Inputs (m ³ /yr)	0	0	0	0
Total Inputs (m³/yr)	51514	68455	132194	252163
OUTPUTS (VOLUMES)				
Precipitation Surplus (m ³ /yr)	18017	23942	46234	88193
Net Surplus (m ³ /yr)	18017	23942	46234	88193
Evapotranspiration (m ³ /yr)	33497	44513	85959	163970
Infiltration (m ³ /yr)	7207	10774	23117	41098
Rooftop Infiltration (m ³ /yr)	0	0	0	0
Total Infiltration (m ³ /yr)	7207	10774	23117	41098
Runoff Pervious Areas (m ³ /yr)	10810	13168	23117	47095
Runoff Impervious Areas (m ³ /yr)	0	0	0	0
Total Runoff (m ³ /yr)	10810	13168	23117	47095
Total Outputs (m³/yr)	51514	68455	132194	252163
Difference (Inputs - Outputs)	0	0	0	0

Notes:

Naturalized areas are open, vacant areas that are not used for agriculture and are not forested areas

Table 2: Infiltration Factors		Table 3: Typical Ground Water Recharge Rates		
Description of Area/Development Site	Value of Infiltration Factor	Soil Texture	Ground Water Recharge Rate	
TOPOGRAPHY				
■ Flat land, average slope not exceeding 0.6 m per km	0.30	■ coarse sand and gravel	2500	70000
■ Rolling land, average slope of 2.8 m to 3.8 m per km	0.20	■ fine to medium sand	200 - 250	5000 - 7000
■ Hilly land, average slope of 28 m to 47 m per km	0.10	■ silty sand to sandy silt	150 - 200	4000 - 5000
SOIL				
■ Tight impervious clay	0.10	■ silt	125 - 150	3500 - 4300
■ Medium combinations of clay and loam	0.20	■ clayey silt	100 - 125	3000 - 3500
■ Open sandy loam	0.4	■ clay	less than 100	less than 2800
COVER				
■ Cultivated lands	0.1			
■ Woodland	0.2			

Appendix E.3

Water Budget Post-Development - No Mitigation Strategies

Catchment Designation	POST-DEVELOPMENT SITE																		TOTAL
	Low Density - Singles A, B, C			Med. Density - Townhouse D			Natural Heritage	SWM Pond	Road Widening	Road ROWs	Grass	Walkway	Medium Density (5-Storey Bldg)			Commercial			
	Lawns	Rooftops	Driveways	Lawns	Rooftops	Driveways				Asphalt			Landscaping	Rooftops	Asphalt	Landscaping	Rooftops	Asphalt	
Area (m ²)	13249	31796	7949	3139	11770	785	149540	16175	965	12896	12896	194	474	1422	474	2175	4033	24859	294789
Pervious Area (m ²)	13249	0	0	3139	0	0	149540	0	965	0	12896	194	474	0	0	2175	0	0	182631
% Pervious	4.5%	0%	0%	1%	0%	0%	50.7%	0%	0.3%	0%	4.4%	0.1%	0.2%	0%	0%	0.7%	0%	0%	62.0%
Impervious Area (m ²)	0	31796	7949	0	11770	785	0	16175	0	12896	0	0	0	1422	474	0	4033	24859	112158
% Impervious	0%	10.8%	2.7%	0%	4.0%	0.3%	0%	5.5%	0%	4.4%	0%	0%	0%	0.5%	0.2%	0%	1.4%	8.4%	38.0%
INFILTRATION FACTORS																			
Topography Infiltration Factor	0.1	0	0	0.1	0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0	0	0.1	0	0	
Soil Infiltration Factor	0.2	0	0	0.2	0	0	0.2	0	0.2	0	0.2	0.2	0.2	0	0	0.2	0	0	
Land Cover Infiltration Factor	0.15	0	0	0.15	0	0	0.2	0	0.15	0	0.15	0	0.15	0	0	0.15	0	0	
MECP Infiltration Factor	0.45	0	0	0.45	0	0.1	0.5	0.1	0.45	0.1	0.45	0.3	0.45	0	0	0.45	0	0	
Actual Infiltration Factor	0.45	0	0	0.45	0	0	0.5	0.05	0.45	0	0.45	0.4	0.45	0	0	0.45	0	0	
Runoff Coefficient	0.55	1	1	0.55	1	1	0.5	0.95	0.55	1	0.55	0.6	0.55	1	1	0.55	1	1	
Runoff from Impervious Surfaces*	0	0.8	0.8	0	0.8	0.8	0	0.8	0	0.8	0	0.8	0	0.8	0.8	0	0.8	0.8	
INPUTS (PER UNIT AREA)																			
Precipitation (mm/yr)	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855
Run On (mm/yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Other Inputs (mm/yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Total Inputs (mm/yr)	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855
OUTPUTS (PER UNIT AREA)																			
Precipitation Surplus (mm/yr)	299	684	684	299	684	684	299	684	299	684	299	299	299	684	684	299	684	684	446
Net Surplus (mm/yr)	299	684	684	299	684	684	299	684	299	684	299	299	299	684	684	299	684	684	446
Evapotranspiration (mm/yr)	556	171	171	556	171	171	556	171	556	171	556	556	556	171	171	556	171	171	410
Infiltration (mm/yr)	135	0	0	135	0	0	150	34	135	0	135	120	135	0	0	135	0	0	93
Rooftop Infiltration (mm/yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Total Infiltration (mm/yr)	135	0	0	135	0	0	150	34	135	0	135	120	135	0	0	135	0	0	93
Runoff Pervious Areas	165	0	0	165	0	0	150	0	165	0	165	180	165	0	0	165	0	0	94
Runoff Impervious Areas	0	684	684	0	684	684	0	650	0	684	0	0	0	684	684	0	684	684	258
Total Runoff (mm/yr)	165	684	684	165	684	684	150	650	165	684	165	180	165	684	684	165	684	684	353
Total Outputs (mm/yr)	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855
Difference (Inputs - Outputs)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
INPUTS (VOLUMES)																			
Precipitation (m ³ /yr)	11333	27199	6800	2685	10068	671	127917	13836	825	11031	11031	166	405	1216	405	1861	3450	21265	252163
Run On (m ³ /yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Other Inputs (m ³ /yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Total Inputs (m ³ /yr)	11333	27199	6800	2685	10068	671	127917	13836	825	11031	11031	166	405	1216	405	1861	3450	21265	252163
OUTPUTS (VOLUMES)																			
Precipitation Surplus (m ³ /yr)	3964	21759	5440	939	8054	537	44738	11069	289	8825	3858	58	142	973	324	651	2760	17012	131390
Net Surplus (m ³ /yr)	3964	21759	5440	939	8054	537	44738	11069	289	8825	3858	58	142	973	324	651	2760	17012	131390
Evapotranspiration (m ³ /yr)	7369	5440	1360	1746	2014	134	83178	2767	537	2206	7173	108	264	243	81	1210	690	4253	120772
Infiltration (m ³ /yr)	1784	0	0	423	0	0	22369	553	130	0	1736	23	64	0	0	293	0	0	27375
Rooftop Infiltration (m ³ /yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Total Infiltration (m ³ /yr)	1784	0	0	423	0	0	22369	553	130	0	1736	23	64	0	0	293	0	0	27375
Runoff Pervious Areas (m ³ /yr)	2180	0	0	516	0	0	22369	0	159	0	2122	35	78	0	0	358	0	0	27817
Runoff Impervious Areas (m ³ /yr)	0	21759	5440	0	8054	537	0	10515	0	8825	0	0	0	973	324	0	2760	17012	76199
Total Runoff (m ³ /yr)	2180	21759	5440	516	8054	537	22369	10515	159	8825	2122	35	78	973	324	358	2760	17012	104016
Total Outputs (m ³ /yr)	11333	27199	6800	2685	10068	671	127917	13836	825	11031	11031	166	405	1216	405	1861	3450	21265	252163
Difference (Inputs - Outputs)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

Notes:

*Evaporation from impervious areas was assumed to be 20% of precipitation.

Asphalt has 0% infiltration capability

Low Density Single Lots: Assume rooftops cover about 60% of the lot. Driveways cover about 15% of the lot; Grass (lawns) cover about 25% of the lot.

Medium Density Townhouse Lots: Assume rooftops cover about 75% of the lot. Driveways cover about 5% of the lot; Grass (lawns) cover about 20% of the lot.

Medium Density 5-storey Residential lot: Assume rooftop covers about 60% of the lot. Asphalt covers about 20% of the lot; Grass (lawn) cover about 20% of the lot.

Commercial Lots: Based upon information provided to GHD, assume rooftops covers about 13% of the lot. Asphalt parking covers about 80% of the lot; Landscaping covers about 7% of the lot.

Road ROWs assumed to be 50% asphalt and 50% grass

Appendix E.4

Water Budget Post-Development - With Downspout Disconnection Mitigation Strategies

Catchment Designation	POST-DEVELOPMENT SITE																			TOTAL
	Low Density - Singles A, B, C			Med. Density - Townhouse D			Natural Heritage	SWM Pond	Road Widening	Road ROWs		Walkway	Medium Density (5-Storey Bldg)			Commercial				
	Lawns	Rooftops	Driveways	Lawns	Rooftops	Driveways				Asphalt	Grass		Landscaping	Rooftops	Asphalt	Landscaping	Rooftops	Asphalt		
Area (m ²)	13249	31796	7949	3139	11770	785	149540	16175	965	12896	12896	194	474	1422	474	2175	4033	24859	294789	
Pervious Area (m ²)	13249	0	0	3139	0	0	149540	0	965	0	12896	194	474	0	0	2175	0	0	182631	
% Pervious	4.5%	0%	0%	1%	0%	0%	50.7%	0%	0.3%	0%	4.4%	0.1%	0.2%	0%	0%	0.7%	0%	0%	62.0%	
Impervious Area (m ²)	0	31796	7949	0	11770	785	0	16175	0	12896	0	0	0	1422	474	0	4033	24859	112158	
% Impervious	0%	10.8%	2.7%	0%	4.0%	0.3%	0%	5.5%	0%	4.4%	0%	0%	0%	0.5%	0.2%	0%	1.4%	8.4%	38.0%	
INFILTRATION FACTORS																				
Topography Infiltration Factor	0.1	0	0	0.1	0	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0	0	0.1	0	0		
Soil Infiltration Factor	0.2	0	0	0.2	0	0	0.2	0	0.2	0	0.2	0.2	0.2	0	0	0.2	0	0		
Land Cover Infiltration Factor	0.15	0	0	0.15	0	0	0.2	0	0.15	0	0.15	0	0.15	0	0	0.15	0	0		
MECP Infiltration Factor	0.45	0	0	0.45	0	0.1	0.5	0.1	0.45	0.1	0.45	0.3	0.45	0	0	0.45	0	0		
Actual Infiltration Factor	0.45	0	0	0.45	0	0	0.5	0.05	0.45	0	0.45	0.4	0.45	0	0	0.45	0	0		
Runoff Coefficient	0.55	1	1	0.55	1	1	0.5	0.95	0.55	1	0.55	0.6	0.55	1	1	0.55	1	1		
Runoff from Impervious Surfaces*	0	0.8	0.8	0	0.8	0.8	0	0.8	0	0.8	0	0.8	0	0.8	0.8	0	0.8	0.8		
INPUTS (PER UNIT AREA)																				
Precipitation (mm/yr)	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	
Run On (mm/yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Other Inputs (mm/yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Total Inputs (mm/yr)	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	
OUTPUTS (PER UNIT AREA)																				
Precipitation Surplus (mm/yr)	299	684	684	299	684	684	299	684	299	684	299	299	299	684	684	299	684	684	446	
Net Surplus (mm/yr)	299	684	684	299	684	684	299	684	299	684	299	299	299	684	684	299	684	684	446	
Evapotranspiration (mm/yr)	556	171	171	556	171	171	556	171	556	171	556	556	556	171	171	556	171	171	410	
Infiltration (mm/yr)	135	0	0	135	0	0	150	34	135	0	135	120	135	0	0	135	0	0	93	
%Rooftop Required to Meet Pre-Development	--	41%	--	--	41%	--	--	--	--	--	--	--	--	41%	--	--	41%	--	--	
Rooftop Infiltration (mm/yr)	0	280	0	0	280	0	0	0	0	0	0	0	0	280	0	0	280	0	47	
Total Infiltration (mm/yr)	135	280	0	135	280	0	150	34	135	0	135	120	135	280	0	135	280	0	139	
Runoff Pervious Areas	165	0	0	165	0	0	150	0	165	0	165	180	165	0	0	165	0	0	94	
Runoff Impervious Areas	0	404	684	0	404	684	0	650	0	684	0	0	0	404	684	0	404	684	212	
Total Runoff (mm/yr)	165	404	684	165	404	684	150	650	165	684	165	180	165	404	684	165	404	684	306	
Total Outputs (mm/yr)	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	855	
Difference (Inputs - Outputs)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
INPUTS (VOLUMES)																				
Precipitation (m ³ /yr)	11333	27199	6800	2685	10068	671	127917	13836	825	11031	11031	166	405	1216	405	1861	3450	21265	252163	
Run On (m ³ /yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Other Inputs (m ³ /yr)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Total Inputs (m ³ /yr)	11333	27199	6800	2685	10068	671	127917	13836	825	11031	11031	166	405	1216	405	1861	3450	21265	252163	
OUTPUTS (VOLUMES)																				
Precipitation Surplus (m ³ /yr)	3964	21759	5440	939	8054	537	44738	11069	289	8825	3858	58	142	973	324	651	2760	17012	131390	
Net Surplus (m ³ /yr)	3964	21759	5440	939	8054	537	44738	11069	289	8825	3858	58	142	973	324	651	2760	17012	131390	
Evapotranspiration (m ³ /yr)	7369	5440	1360	1746	2014	134	83178	2767	537	2206	7173	108	264	243	81	1210	690	4253	120772	
Infiltration (m ³ /yr)	1784	0	0	423	0	0	22369	553	130	0	1736	23	64	0	0	293	0	0	27375	
Rooftop Infiltration (m ³ /yr)	0	8901	0	0	3295	0	0	0	0	0	0	0	0	398	0	0	1129	0	13723	
Total Infiltration (m ³ /yr)	1784	8901	0	423	3295	0	22369	553	130	0	1736	23	64	398	0	293	1129	0	41098	
Runoff Pervious Areas (m ³ /yr)	2180	0	0	516	0	0	22369	0	159	0	2122	35	78	0	0	358	0	0	27817	
Runoff Impervious Areas (m ³ /yr)	0	12858	5440	0	4759	537	0	10515	0	8825	0	0	0	575	324	0	1631	17012	62476	
Total Runoff (m ³ /yr)	2180	12858	5440	516	4759	537	22369	10515	159	8825	2122	35	78	575	324	358	1631	17012	90293	
Total Outputs (m ³ /yr)	11333	27199	6800	2685	10068	671	127917	13836	825	11031	11031	166	405	1216	405	1861	3450	21265	252163	
Difference (Inputs - Outputs)	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	

Notes:

*Evaporation from impervious areas was assumed to be 20% of precipitation.

Asphalt has 0% infiltration capability

Low Density Single Lots: Assume rooftops cover about 60% of the lot. Driveways cover about 15% of the lot; Grass (lawns) cover about 25% of the lot.

Medium Density Townhouse Lots: Assume rooftops cover about 75% of the lot. Driveways cover about 5% of the lot; Grass (lawns) cover about 20% of the lot.

Medium Density 5-storey Residential lot: Assume rooftop covers about 60% of the lot. Asphalt covers about 20% of the lot; Grass (lawn) cover about 20% of the lot.

Commercial Lots: Based upon information provided to GHD, assume rooftops covers about 13% of the lot. Asphalt parking covers about 80% of the lot; Landscaping covers about 7% of the lot.

Road ROWs assumed to be 50% asphalt and 50% grass

Appendix E.5


Water Budget Summary

PARAMETER	SITE				
	<i>Pre-Development</i>	<i>Post-Development No Mitigation</i>	<i>Difference Pre- vs. Post-</i>	<i>Post-Development With Mitigation</i>	<i>Difference Pre- vs. Post-</i>
INPUTS (VOLUMES)					
Precipitation (m ³ /yr)	252163	252163	0%	252163	0%
Run On (m ³ /yr)	0	0	0%	0	0%
Other Inputs (m ³ /yr)	0	0	0%	0	0%
Total Inputs (m³/yr)	252163	252163	0%	252163	0%
OUTPUTS (VOLUMES)					
Precipitation Surplus (m ³ /yr)	88193	131390	49%	131390	49%
Net Surplus (m ³ /yr)	88193	131390	49%	131390	49%
Evapotranspiration (m ³ /yr)	163970	120772	-26%	120772	-26%
Infiltration (m ³ /yr)	41098	27375	-33%	27375	-33%
% Rooftop Runoff to balance infiltration	--	--	--	41%	--
Rooftop Infiltration (m ³ /yr)	0	0	0%	13723	--
Total Infiltration (m ³ /yr)	41098	27375	-33%	41098	0%
Runoff Pervious Areas (m ³ /yr)	47095	27817	-41%	27817	-41%
Runoff Impervious Areas (m ³ /yr)	0	76199	--	62476	--
Total Runoff (m ³ /yr)	47095	104016	121%	90293	92%
Total Outputs (m³/yr)	252163	252163	0%	252163	0%

To maintain pre-development infiltration values; 41% of post-development rooftop runoff needs to be infiltrated.

Attachment F

Slope Stability Analysis

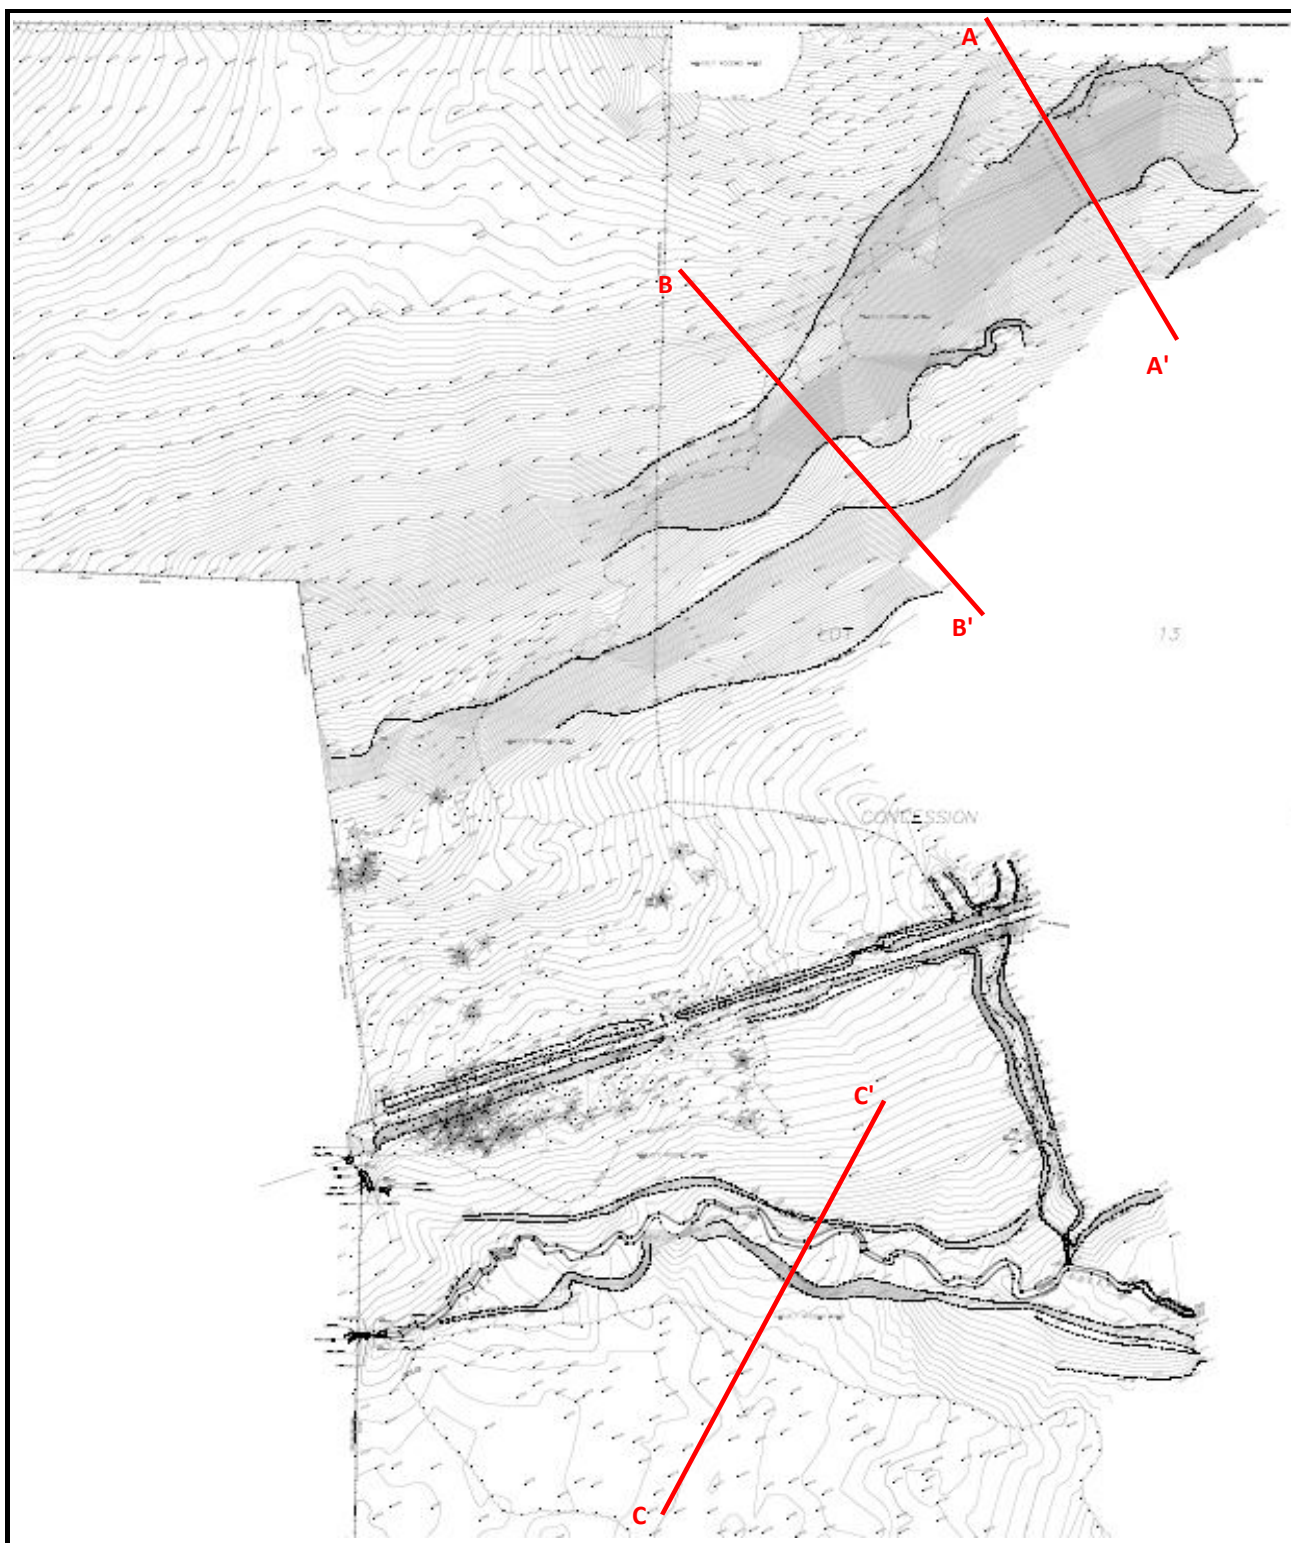

Base map produced prepared by IBW Surveyors, file name "P-0400 Top_v4.dwg" dated Jan. 14, 2020.

Scale:
Refer To Scale Bar
Coordinate System
NAD 1983 UTM
Zone 17




Vargas Properties Inc.
Part Lot 13, Concession 5
Millbrook, Ontario
Geotechnical Investigation

**Cross-Sections
Location Plan**

11209539-01
June, 2020

FIGURE F.1

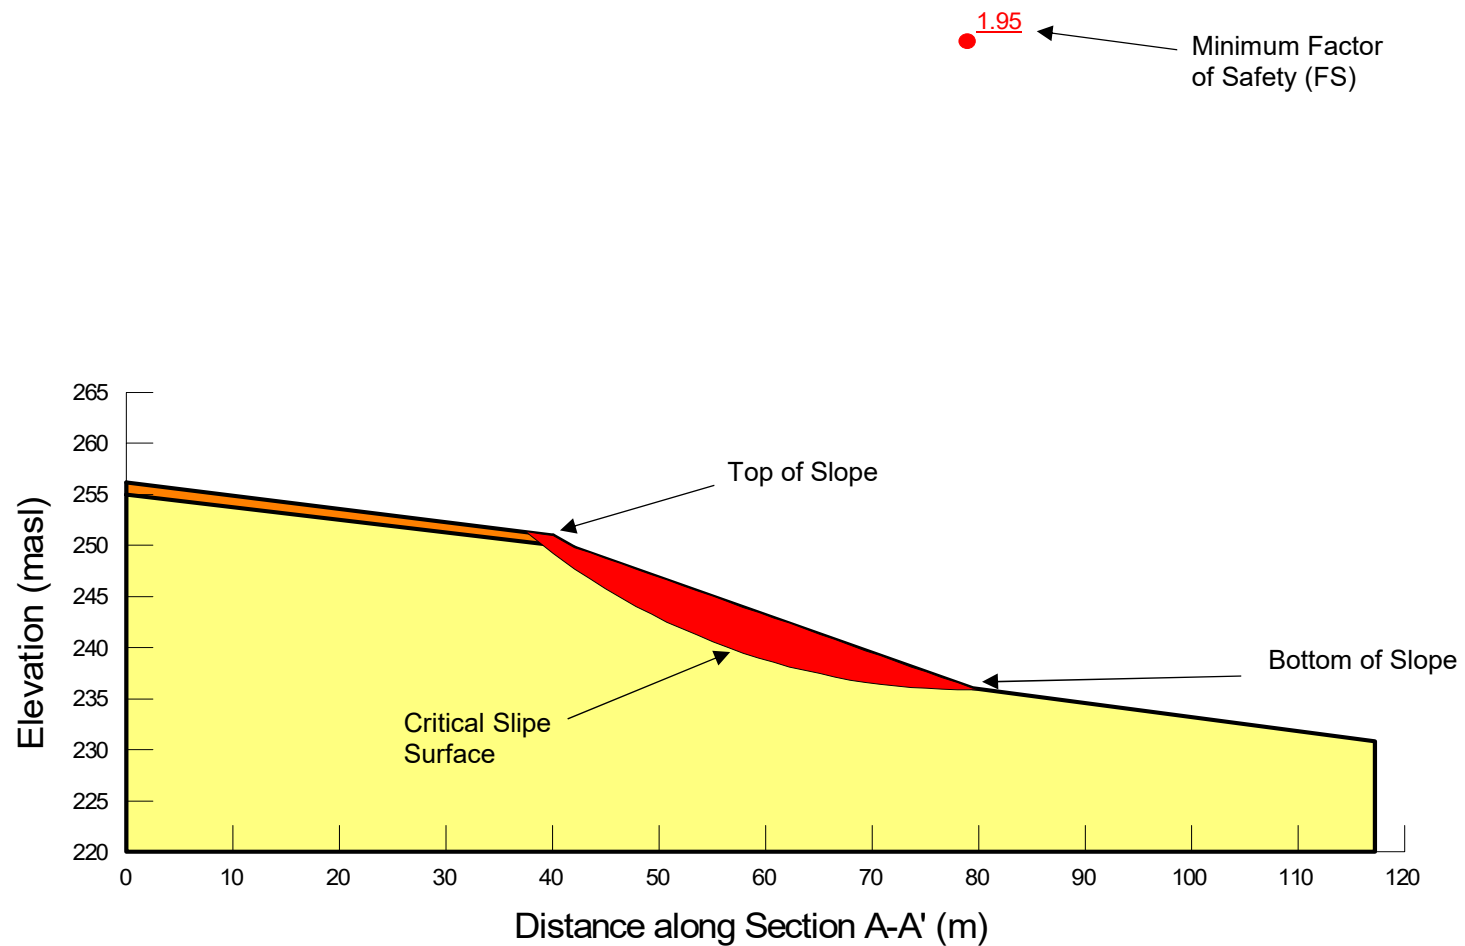

Materials

- Clayey Silt
- Glacial Till

Clayey Silt: Unit Weight = 20 kN/m³, Cohesion = 5 kPa, $\Phi = 28^\circ$

Glacial Till: Unit Weight = 21 kN/m³, Cohesion = 3 kPa, $\Phi = 32^\circ$

No Vertical Exaggeration. See Figure F.1 for Cross Section Location

Scale:
As Shown Above




Vargas Properties Inc.
Part Lot 13, Concession 5, Milbrook, Ontario
Geotechnical Investigation

CROSS SECTION A-A'

11209539-01
June, 2020

FIGURE F.2

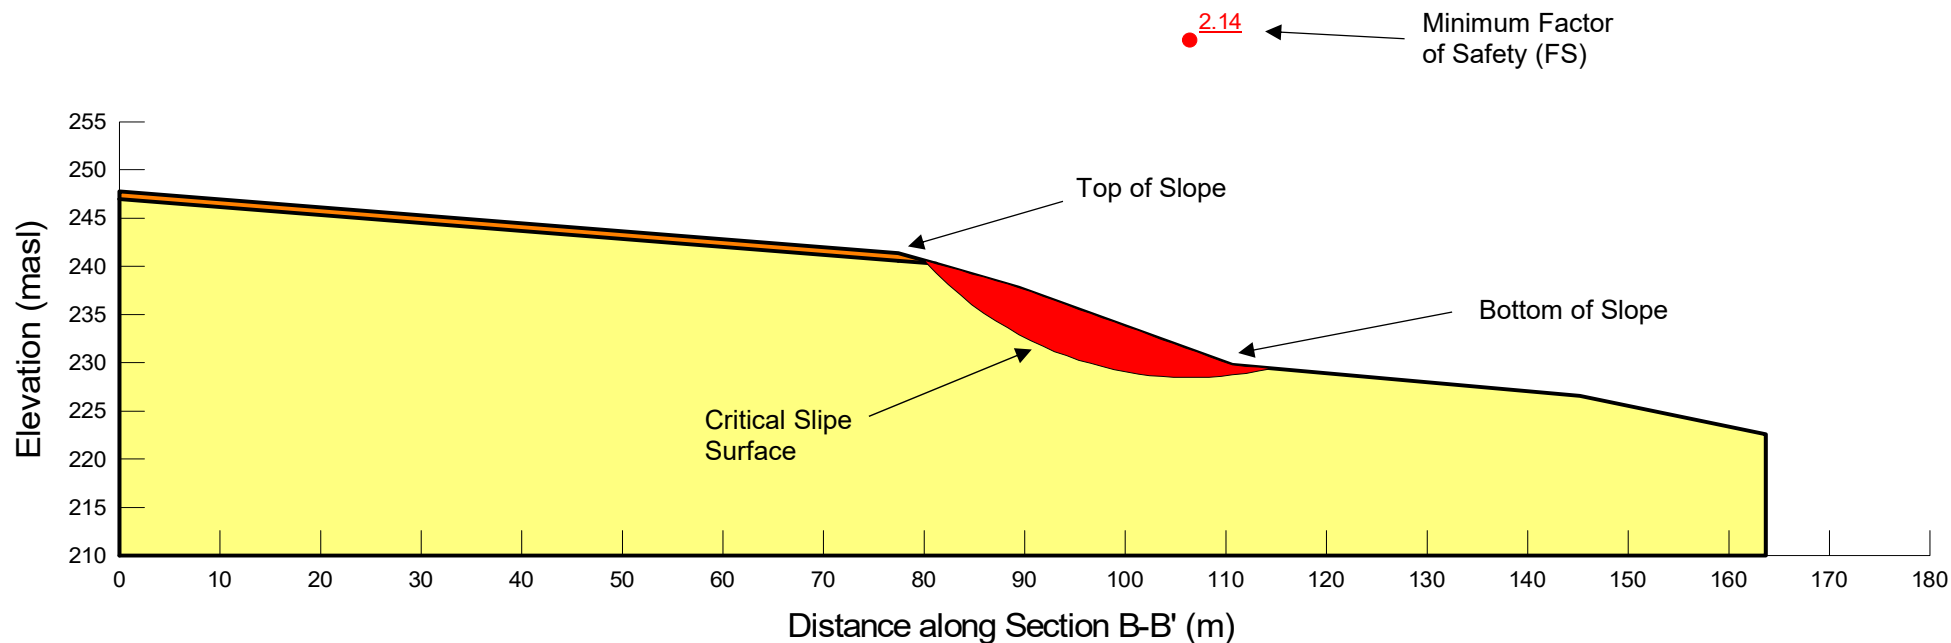

Materials

- Clayey Silt
- Glacial Till

Clayey Silt: Unit Weight = 20 KN/m³, Cohesion = 5 KPa, Phi = 28°

Glacial Till: Unit Weight = 21 KN/m³, Cohesion = 3 KPa, Phi = 32°

No Vertical Exaggeration. See Figure F.1 for Cross Section Location

Scale:
As Shown Above




Vargas Properties Inc.
Part Lot 13, Concession 5, Milbrook, Ontario
Geotechnical Investigation

CROSS SECTION B-B'

11209539-01
June, 2020

FIGURE F.3

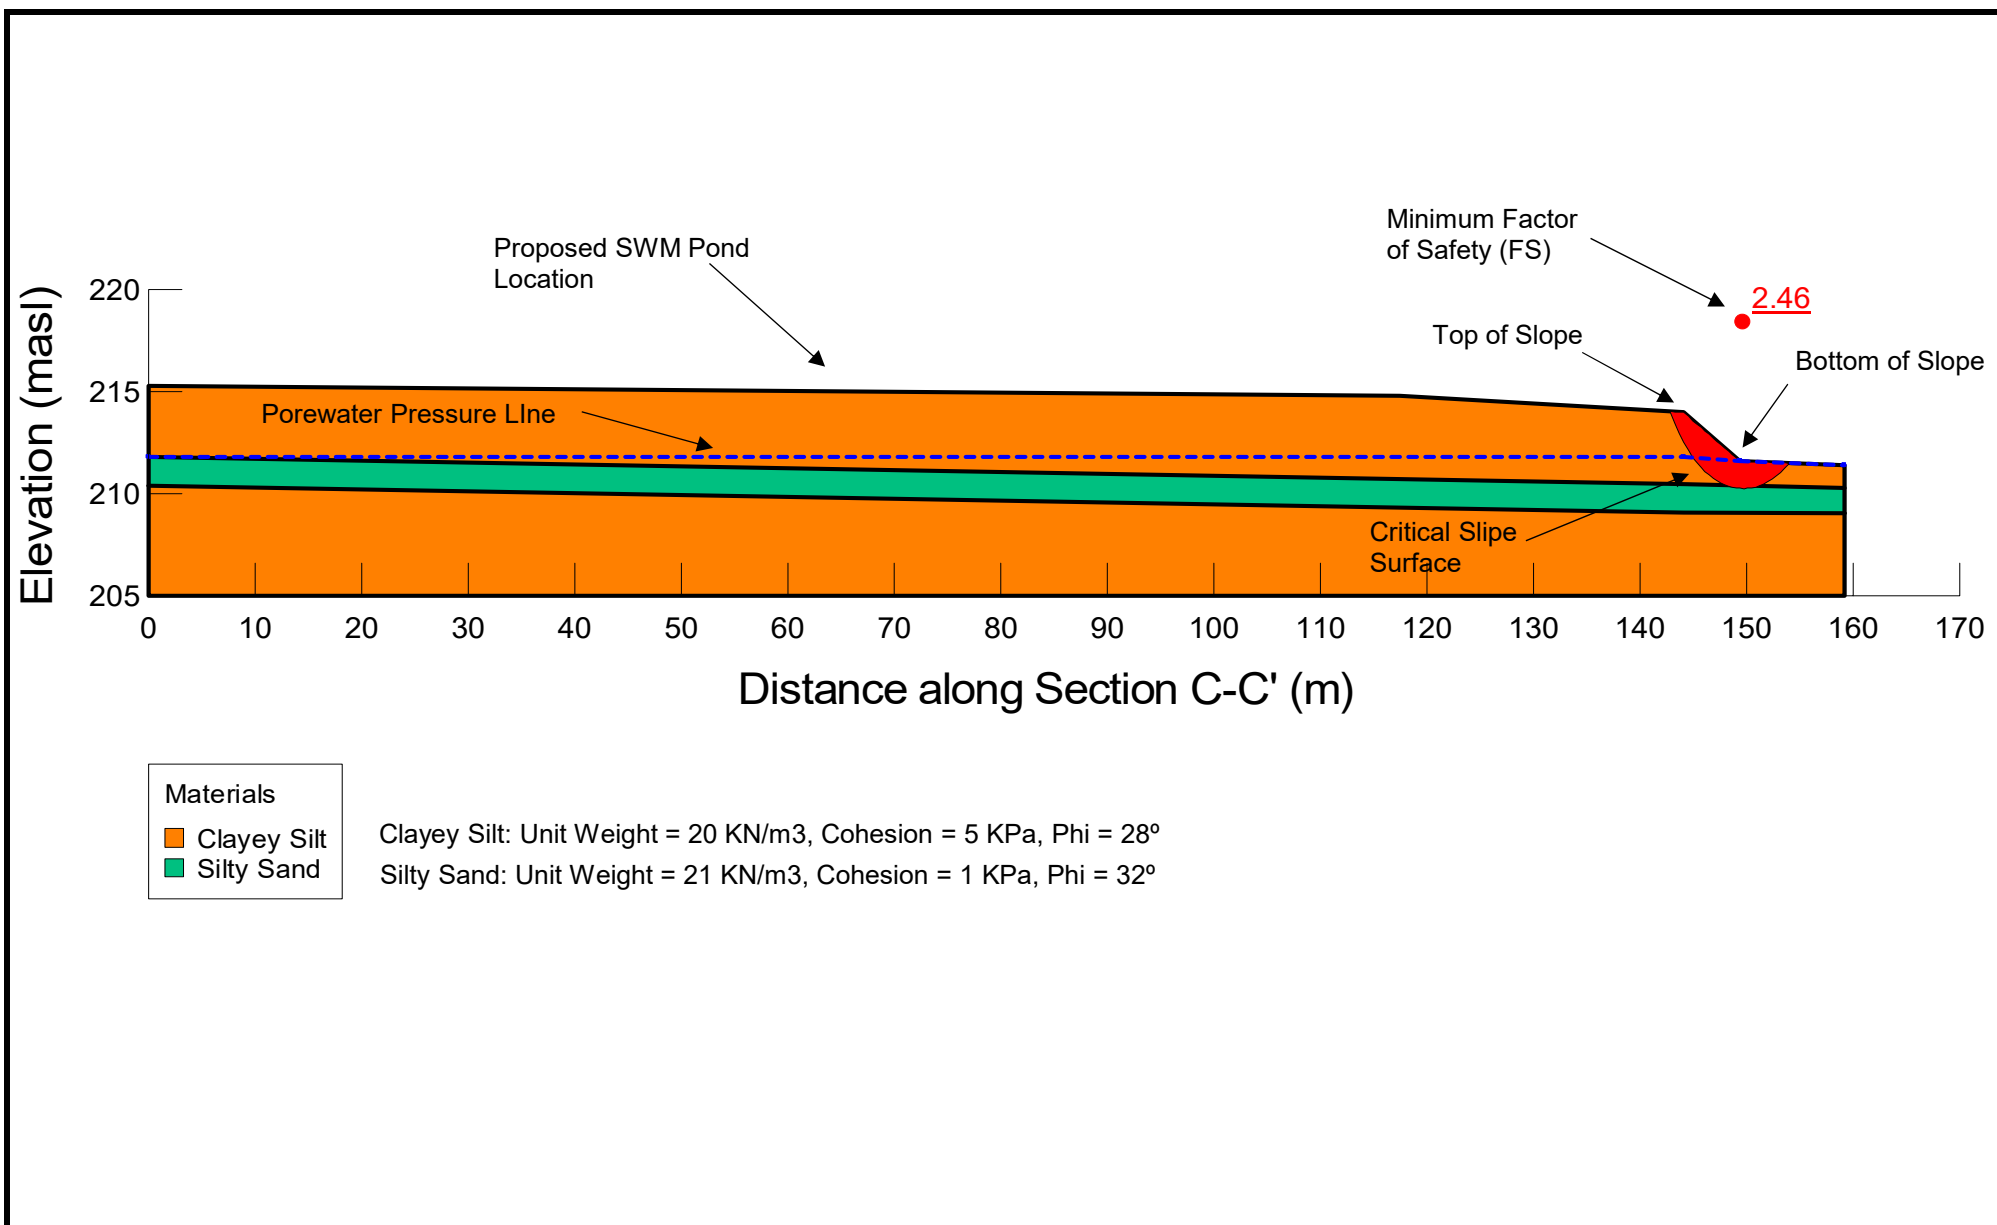

Vertical Exaggeration 2X. See Figure F.1 for Cross Section Location

Scale:
As Shown Above



Vargas Properties Inc.
Part Lot 13, Concession 5, Milbrook, Ontario
Geotechnical Investigation

CROSS SECTION C-C'

11209539-01
June, 2020

FIGURE F.4



about GHD

GHD is one of the world's leading professional services companies operating in the global markets of water, energy and resources, environment, property and buildings, and transportation. We provide engineering, environmental, and construction services to private and public sector clients.

David Workman, P.Geo
David.workman@ghd.com
905-728-1500

Nyle McIlveen, P.Eng
Nyle.mcilveen@ghd.com
705-749-3317

www.ghd.com